



Gippsland Water
2015-16 Annual Report
on Drinking Water Quality





Gippsland Water

Hazelwood Road
PO BOX 348
Traralgon VIC 3844

General enquiries **1800 050 500**
Faults and emergencies **1800 057 057**

www.gippswater.com.au

contactus@gippswater.com.au

ABN 75 830 750 413

© State of Victoria, Central Gippsland Region Water Corporation 2015. This publication is copyright. No part may be reproduced by any process except in accordance with the provisions of the *Copyright Act 1968*.

CONTENTS

1	INTRODUCTION	7
1.1	CHARACTERISATION OF THE SYSTEM.....	7
2	DRINKING WATER QUALITY MANAGEMENT FRAMEWORK	9
2	DRINKING WATER QUALITY POLICY	13
3	DRINKING WATER SUPPLY SYSTEMS	14
3.1.1	Map of the Gippsland Water system	14
3.1.2	Source of water.....	15
3.2	WATER QUALITY MANAGEMENT SYSTEM.....	20
3.2.1	Hazard and Risk Identification.....	20
3.2.2	Control Measures	20
3.2.3	Verification and Monitoring	21
3.2.4	System Auditing.....	21
3.3	WATER TREATMENT PROCESSES	21
3.3.1	Coagulation / Flocculation	22
3.3.2	Clarification / Sedimentation.....	22
3.3.3	Membrane Filtration.....	22
3.3.4	Filtration	22
3.3.5	Disinfection	23
3.3.6	Added Substances.....	24
4	SYSTEM ISSUES FOR 2015-16	25
5	QUALITY OF DRINKING WATER 2015-16	26
5.1	WATER QUALITY STANDARD PARAMETERS.....	26
5.2	EMERGENCY/INCIDENT MANAGEMENT	28
5.3	INCIDENT AND POTENTIAL WATER QUALITY EVENTS	28
5.4	EMERGENCIES AND WATER QUALITY EVENTS.....	29
5.5	OTHER EVENTS NOT REPORTABLE.....	30
6	COMPLAINTS	31
6.1	WATER QUALITY COMPLAINTS	31
6.2	A SUMMARY OF THE CUSTOMER COMPLAINT PROCESS.....	32
7	RISK MANAGEMENT PLAN AUDIT	35
8	WATER QUALITY RESULTS FOR 2015-16	37
8.1	ESCHERICHIA COLI (E. COLI).....	37
8.1.1	E. coli results.....	37
8.1.2	Actions taken in relation to non-compliance.....	38
8.2	CHLORINE BASED DISINFECTION BY-PRODUCT CHEMICALS.....	39
8.2.1	Chloroacetic acid results	39
8.2.2	Actions taken in relation to non-compliance.....	39
8.2.3	Dichloroacetic acid results.....	40
8.2.4	Actions taken in relation to non-compliance.....	40
8.2.5	Trichloroacetic acid results.....	41
8.2.6	Actions taken in relation to non-compliance.....	41
8.2.7	Trihalomethanes (THM) results.....	42
8.2.8	Actions taken in relation to non-compliance.....	42
8.3	OZONE BASED DISINFECTION BY-PRODUCT CHEMICALS	42
8.4	ALUMINIUM	43
8.4.1	Aluminium results.....	43
8.4.2	Actions taken in relation to non-compliance.....	43
8.5	TURBIDITY	44
8.5.1	Turbidity results	44

8.5.2	<i>Actions taken in relation to non-compliance</i>	45
8.6	FLUORIDE.....	46
8.6.1	<i>Fluoride results</i>	46
8.6.2	<i>Actions taken in relation to non-compliance</i>	47
8.6.3	<i>Localities which did not receive fluoridated water as a results of</i>	47
8.7	WATER TREATMENT PROJECTS & PROGRAMS UNDERTAKEN.....	49
8.8	OTHER ALGAE, PATHOGEN, CHEMICAL OR SUBSTANCE NOT SPECIFIED THAT MAY POSE A RISK TO HUMAN HEALTH.....	53
8.8.1	<i>Overall results</i>	53
8.8.2	<i>Manganese</i>	55
8.8.3	<i>Actions taken in relation to non-compliance</i>	55
8.8.4	<i>Lead</i>	56
8.8.5	<i>Actions taken in relation to non-compliance</i>	56
8.8.6	<i>Copper</i>	57
8.8.7	<i>Actions taken in relation to non-compliance</i>	57
8.9	AESTHETICS.....	58
8.9.1	<i>pH results</i>	58
8.9.2	<i>Actions taken in relation to non-compliance</i>	58
8.9.3	<i>Iron results</i>	59
8.9.4	<i>Actions taken in relation to non-compliance</i>	59
8.10	ANALYSIS OF RESULTS.....	60
9	UNDERTAKINGS UNDER SECTION 30 OF THE SDWA	62
10	EXEMPTIONS UNDER SECTION 20 OF THE SDWA	62
11	VARIATION IN AESTHETIC STANDARDS	62
12	REGULATED WATER	62
13	GLOSSARY OF TERMS	62
14	FURTHER INFORMATION	64
15	REFERENCES	64
	APPENDIX 1: RAW WATER MONITORING	66

TABLES

TABLE 1: GIPPSLAND WATER LOCALITY WATER SOURCE AND WATER TREATMENT PROCESS	15
TABLE 2: SUMMARY OF CHANGES TO THE SAFE DRINKING WATER REGULATIONS (SCHEDULE 2):	27
TABLE 3: SUMMARY OF NOTIFICATIONS UNDER SECTION 18	28
TABLE 4: SUMMARY OF INCIDENTS AND ACTIONS TAKEN UNDER SECTION 22	29
TABLE 5: WATER QUALITY COMPLAINTS PER 100 CUSTOMERS SUPPLIED	31
TABLE 6: RISK MANAGEMENT PLAN OPPORTUNITY FOR IMPROVEMENTS	35
TABLE 7: <i>E. COLI</i> RESULTS FOR LOCALITIES 2015-16	37
TABLE 8: <i>E. COLI</i> DETECTIONS FOR LOCALITIES 2015-16	38
TABLE 9: CHLOROACETIC ACID RESULTS FOR ALL LOCALITIES 2015-16	39
TABLE 10: DICHLOROACETIC ACID RESULTS FOR ALL LOCALITIES 2015-16	40
TABLE 11: TRICHLOROACETIC ACID FOR ALL LOCALITIES 2015-16	41
TABLE 12: TRIHALOMETHANES RESULTS FOR ALL LOCALITIES FOR 2015-16	42

TABLE 13: ALUMINIUM RESULTS FOR ALL LOCALITIES IN 2015-16.....	43
TABLE 14: TURBIDITY RESULTS FOR ALL LOCALITIES IN 2015-16	44
TABLE 15: FLUORIDE RESULTS FOR ALL FLUORIDATED LOCALITIES IN 2015-16.....	46
TABLE 16: OTHER SAMPLED PARAMETER RESULTS FOR ALL LOCALITIES IN 2015-16.....	53
TABLE 17: ROUTINE BGA MONITORING FOR RAW WATER SUPPLIES IN 2015-16.....	54
TABLE 18: MANGANESE RESULTS FOR ALL LOCALITIES IN 2015-16	55
TABLE 19: LEAD RESULTS FOR ALL LOCALITIES IN 2015-16.....	56
TABLE 20: COPPER RESULTS FOR ALL LOCALITIES IN 2015-16	57
TABLE 21: PH RESULTS FOR ALL LOCALITIES IN 2015-16	58
TABLE 22: IRON RESULTS FOR ALL LOCALITIES IN 2015-16	59
TABLE 23: COMPLIANCE BY LOCALITY AND POPULATION	60
TABLE 24: GLOSSARY OF TERMS	62

FIGURES

FIGURE 1: OVERVIEW OF WATER SUPPLY SYSTEM OPERATED BY GIPPSLAND WATER....	14
FIGURE 2: TOTAL CUSTOMER COMPLAINTS FOR 2015-16	31
FIGURE 3: CUSTOMER COMPLAINTS PER 100 CUSTOMERS FOR 2015-16.....	32
FIGURE 4: WATER QUALITY COMPLAINTS RESOLUTION PROCEDURE.....	33
FIGURE 5:-TYERS WATER SUPPLY LOCALITY PROJECT	49
FIGURE 6:-MIRBOO NORTH WATER SUPPLY LOCALITY PROJECT	49
FIGURE 7:-HEYFIELD WATER SUPPLY LOCALITY PROJECT.....	50
FIGURE 8:– FLUORIDE SATURATOR UPGRADE PROJECT.....	50
FIGURE 9:– WATER SUPPLY SYSTEM AUGMENTATION UPGRADE PROJECTS	51
FIGURE 10:– HEYFIELD SUPPLY SYSTEM UPGRADE PROJECTS	52

This page intentionally left blank

1 INTRODUCTION

1.1 CHARACTERISATION OF THE SYSTEM

The Central Gippsland Region Water Corporation, trading as Gippsland Water, was constituted on 21 December 1994 under the *Water Act 1989*.

Gippsland Water is the second largest regional water corporation in Victoria in terms of revenue earned and is the largest in terms of the total volume of water supplied and wastewater collected. It manages;

- 16 water treatment plants (WTP);
- 14 wastewater treatment plants (WWTP),
- Gippsland Water Factory
- two ocean outfalls,
- Soil and Organic Recycling Facility (SORF) and;
- Agribusiness

Gippsland Water provides water and wastewater services to customers in the central Gippsland region of Victoria. Its geographic region stretches from Drouin in the west to Stratford in the east, and from Mirboo North in the south to Rawson and Briagolong in the north.

Gippsland Water manages five business streams, one of which is the provision of water services. Its region consists of;

- 42 towns;
- approximately 70,000 properties connected to the 16 drinking water supply systems.

These towns are grouped into 35 localities for the purposes of monitoring and reporting in accordance with the Safe Drinking Water Regulations 2005 & 2015 (SDWR).

Gippsland Water is committed to providing responsible asset management, quality management, incident management and operational audit of the reticulated urban water supply system to ensure that customer service levels are achieved according to its Customer Charter targets and the *Safe Drinking Water Act 2003 (SDWA)*.

A major objective for the corporation is to achieve and maintain community confidence in the safety, reliability and quality of their water supply.

To ensure customers are provided with safe drinking water, Gippsland Water maintains a “*risk based*” drinking water quality management system, which covers the entire water supply system from the catchment to customers’ taps. The system entails

- detailed water quality risk identification processes
- audited control measures to manage risks
- verification systems, including an independent water quality monitoring program
- continuous improvement project to increase system capability, manage risk, and improve customer experiences

Our mission

We will manage the resources in our care in a manner that secures social, environmental and economic benefits to our customers, stakeholders and the Gippsland region.

Our vision

Efficient water and wastewater services for a healthy community and environment.

2 DRINKING WATER QUALITY MANAGEMENT FRAMEWORK

The regulatory environment in which Gippsland Water operates is to provide safe drinking water at **all** times. Safe drinking water is water that does not cause illness in those who consume it. To achieve this, the water must be free of pathogens and harmful chemicals.

Guidance regarding the structure of this report has been provided by the Department of Health and Human Services (DHHS) in accordance with the *Safe Drinking Water Act 2003* and the current Drinking Water Regulation Guidance Note, June 2016.

Drinking water supplied by Gippsland Water must meet the obligations under the Safe Drinking Water Act 2003 and the Safe Drinking Water Regulations 2005 & 2015. The Australian Drinking Water Guidelines 2011 (ADWG) are used as a benchmark for safe drinking water. The guidelines provide a framework for good management of drinking water supplies that if implemented, will ensure safety at the point of use

The ADWG include two types of guideline values:

- A health related guideline value, which is the concentration or measure of a water quality characteristic that, based on present knowledge, does not result in any significant risk to health of the consumer over a lifetime of consumption
- An aesthetic guideline value, which is the concentration or measure of a water quality characteristic that is associated with acceptability of water to the consumer, such as appearance, taste and odour.

The regulatory environment that provides guidance in the production of safe drinking water consists of:

- ***Victorian Safe Drinking Water Act 2003 (SDWA)***

The Victorian State Government passed the **Safe Drinking Water Act** in June 2003. This Act provides details of further requirements for Victorian Water Corporations.

The purpose of the Safe Drinking Water Act (2003) is to make provision for the supply of safe drinking water. In outline this Act:

- requires water suppliers and water storage managers to prepare and implement plans to manage risks in relation to drinking water and some types of non-potable water;
- provides for the auditing of those plans by approved auditors;
- requires water suppliers to ensure that the drinking water they supply meets quality standards specified by the regulations;
- requires water suppliers to disclose to the public information concerning the quality of drinking water;
- provides for the variation, after community consultation, of water quality standards that relate only to aesthetic factors;
- requires the reporting of known or suspected contamination of drinking water to the Secretary to the Department of Health and Human Services;
- empowers the Secretary to enforce this Act.

o ***Victorian Safe Drinking Water Regulations 2005/2015 (SDWR 2005/2015)***

The Victorian State Government passed the **Safe Drinking Water Regulations** in July 2005. This act provides details of further requirements for Victorian Water Corporations.

The purpose of the Safe Drinking Water Regulations (2005/2015) is to make provision for the supply of safe drinking water. In outline this Act:

- set out the further matters to be addressed in risk management plans and the risks to be specified in risk management plans
- describe the documents that are to be available for inspection in the risk management plan audit;
- prescribe the form of audit certificates to be given to the person who has commissioned a risk management plan audit at the completion of the audit;
- set out the risk management plan auditor approval criteria
- set out the drinking water standards;
- set out the requirements relating to the frequency of collection of samples of water quality analysis;
- empowers the Secretary to:
 - (i) divide areas supplied by water suppliers into water sampling localities;
 - (ii) specify locations within a water sampling locality at which samples of water are to be collected;
 - (iii) vary the frequency of collection for samples of water in certain circumstances;
 - (iv) approve persons to be water analysts (SDWR 2005);
- require all samples of water collected to be analysed by an accredited laboratory and a summary of results of the analysis to be given to the secretary;
- specify the issues relating to the quality of drinking water, in an annual report in respect of every financial year to be given to the Secretary by a water supplier and water storage manager;
- set out details to be included in an annual report to the secretary.

The Safe Drinking Water Regulations (2005) sunset on 17 July 2015, with the Safe Drinking Water Regulations (2015) coming into operation on 18th July 2015.

o ***Australian Drinking Water Guidelines 2011 (ADWG)***

The purpose of the Australian Drinking Water Guidelines 2011 is to 'provide the authoritative reference for use within Australia's administrative and legislative framework to ensure the accountability of drinking water suppliers. The ADWG are not mandatory, legally enforceable standards.

The guidelines set the framework for the management of drinking water quality known as the 12 elements

Gippsland Water has adopted the 12 elements of the ADWG 2011 that comprise:

1. Commitment to Drinking Water Quality Management.
2. Assessment of the Drinking Water Supply System.
3. Preventive Measures for Drinking Water Quality Management.
4. Operational Procedures and Process Control.
5. Verification of Drinking Water Quality.
6. Management of Incidents and Emergencies.
7. Employee Awareness and Training.

8. Community Involvement and Awareness.
9. Research and Development.
10. Documentation and Reporting.
11. Evaluation and Audit.
12. Review and Continual Improvement

○ **Health (Fluoridation) Act 1973**

The Health (Fluoridation) Act 1973 ('the Act') regulates the safe and effective addition of fluoride into drinking water supplies in Victoria.

Under the *Act*, the Secretary to the Department of Human Services has the power to direct Water Supply Authorities to commence water fluoridation.

○ **Code of Practice for Fluoridation of Drinking Water Supplies 2009**

The Department of Human Services released the **Code of Practice for Fluoridation of Drinking Water Supplies** in March 2009.

This code provides details of further requirements for Victorian Water Corporations.

The objective of the code is to provide for safe and effective addition of fluoride into the drinking water supply.

This will be achieved by specifying:

- (a) the optimum fluoride levels for drinking water supplies and the design control limits for fluoridation plants
- (b) the minimum requirements for the safe and effective addition of fluoride chemicals to drinking water supplies, covering the design and operation of a fluoridation plant
- (c) monitoring and reporting requirements for the proposed fluoridation scheme

The code also includes works undertaken on fluoridation plants and integrates the practices with the SDWA through:

- (a) the inclusion of water fluoridation into the corporations' risk management plan under the SDWA
- (b) integration and compliance with the auditing, notification and reporting requirements of the SDWA

The code also describes the gap analysis and subsequent works program associated with water fluoridation plant by;

- (a) the regulatory frame work including the procedure to fluoridate
- (b) safety in design
- (c) requirements for the design and control of fluoridation facilities
- (d) requirement for plant operation including monitoring, training or personnel, occupational health and safety, security and environmental protection

- **Health Based Targets (HBT)**

The National Health and Medical Research Council (NHMRC) released a discussion paper in 2009 on introducing a health-based target (HBT) for microbial water quality in the Australian Drinking Water Guidelines (ADWG). In December 2011, WSAA's Water Quality Network considered the HBT proposition at their annual meeting. Outcomes from that meeting formed the basis of a subsequent WSAA submission to NHMRC

The WSAA Drinking Water Source Assessment and Treatment Requirements Manual for the Application of Health-Based Treatment Targets Release No 2 September 2015 was adopted by Gippsland Water to assess the microbiological risk associated with its catchments and treatment processes in place (log removal requirements) to manage these risks (COR/14/88556).

The HBT comprises four parts

- (a) **Source water assessment** (microbial risk)
- (b) **Water Treatment Plant process assessment** (The water treatment assessment involves assigning estimates of pathogen reduction to the treatment processes deployed at a source)
- (c) **Water safety assessment** (comparing the log reduction required from the source assessment with the log reduction values claimable from the water treatment assessment)
- (d) **Water Safety Improvement Plan** (The water safety improvement plan involves planning improvements to improve water safety. Where the HBT is not achieved, the water supplier should undertake improvements)

2 DRINKING WATER QUALITY POLICY



WATER QUALITY

GIPPSLAND WATER'S DRINKING WATER QUALITY POLICY

We are committed to managing our “catchment to tap water supply systems” to provide safe drinking for our customers at all times.

We will demonstrate compliance with the current Safe Drinking Water Regulations, Safe Drinking Water Act and subordinate regulations.

We will openly and transparently report to customers, employees, the Board and external parties on our drinking water quality activities and performance.

www.gippswater.com.au | facebook.com/gippslandwater | twitter.com/gippswater

Table 1 (cont.): Gippsland Water Locality Water Source and Water treatment process

Locality	Estimated Population Serviced ¹	Source water	Storage	Water Treatment Plant	Treatment process										Sludge Thickening Dewatering	Added Substances					
					Coagulation & Flocculation	Clarification		Filtration		Disinfection			Other	Lime / Soda Ash		Alum Based Coagulants	Iron Based Coagulants	Potassium Permanganate	Polymers	Sodium Fluoride/ Hydrofluorosilicic Acid	
						Sedimentation / Clarification	Dissolved Air Flotation	Granular Media Filter	Membrane	Chlorine Gas	Chloramination	Sodium Hypochlorite									Calcium Hypochlorite
Warragul ³ (including Nilma, Drouin East)	18,390	Pederson Weir (Tarago River) Tarago Reservoir - (supplementary supply)	Tarago Reservoir (supplementary supply)	Warragul	X		X	X		X		Warragul South & Drouin		X ₁	X	Lime	Alum			LT20	Sodium Fluoride
Warragul South	160																				
Drouin	13,140																				
Rokeyby/Buln Buln	470																				
Coongulla/ Glenmaggie	260	Macalister River	Lake Glenmaggie	Coongulla	X			X				X		X	X	Soda Ash	Alum 90			1160, 1115	
Rawson	330	Trigger Creek	Amours Basins	Rawson	X		X	X				Rawson WTP, Parkers Comer			X	Soda Ash		PFS (Polymerised Ferric Sulphate)		1160	
Erica	340																				
Heyfield	2,060	Thomson River	Heyfield Raw water storage	Heyfield	X			X		X				X	X	Soda Ash		PFS (Polymerised Ferric Sulphate)		1115, 1160	

- 1 = The listed populations are for the water sampling localities calculated using 2006 census data to calculate the number of persons per dwelling per locality and then multiplying it with Gippsland Water's 2015-16 figures for number of connections. Figures have also been rounded to the nearest 10.
- 3 = The water supplied to Darnum changed from the Warragul System to the Moe System in March 2012.
- 4 = PAC/GAC used as required to treat for taste and odour compounds
- 5 = The Fluoride dosing system was not operational during the reporting period
- * = PACI-23 used as required to treat high turbidity raw water
- X₁ = Plant capability for activated carbon dosing (not currently in use)

Table 1 (cont.): Gippsland Water Locality Water Source and Water treatment process

Locality	Estimated Population Serviced ¹	Source water	Storage	Water Treatment Plant	Treatment process										Sludge Thickening Dewatering	Added Substances						
					Coagulation & Flocculation	Clarification		Filtration		Disinfection			Other	Lime / Soda Ash		Alum Based Coagulants	Iron Based Coagulants	Potassium Permanganate	Polymers	Sodium Fluoride/ Hydrofluosilicic Acid	Calgon	
						Sedimentation / Clarification	Dissolved Air Flotation	Granular Media Filter	Membrane	Chlorine Gas	Chloramination	Sodium Hypochlorite										Calcium Hypochlorite
Mirboo North	1,970	Little Morwell River	N/A	Mirboo North	X	X	X	X				X			X	Soda Ash	PASS			LT20		
Moe	11,660	Tanjil River and Narracan Creek	N/A	Moe	X	X		X		X				X	Soda Ash	Alum			LT20	Sodium Fluoride	X	
Newborough	7,400																					
Yallourn North	1,620																					
Trafalgar	3,770																					
Yarragon	1,640																					
Darnum ³	470																					
Neerim South	1,340	Tarago River	Tarago Reservoir	Neerim South	X			X		X (Noojee System)	X (Neerim South)			X	Soda Ash		PFS (Polymerised Ferric Sulphate)		1115, 1160		Sodium Fluoride	X
Noojee	330																					
Sale/Wurruk	17,880	Bore (Boisdale Aquifer)	N/A	Sale				X		X					Lime			X			Sodium Fluoride	

- 1 = The listed populations are for the water sampling localities calculated using 2006 census data to calculate the number of persons per dwelling per locality and then multiplying it with Gippsland Water's 2015-16 figures for number of connections. Figures have also been rounded to the nearest 10.
- 3 = The water supplied to Darnum changed from the Warragul System to the Moe System in March 2012. Darnum is not a designated locality under the SDWR
- 4 = PAC/GAC used as required to treat for taste and odour compounds
- 5 = The Fluoride dosing system was not operational during the reporting period
- * = PACI-23 used as required to treat high turbidity raw water
- X₁ = Plant capability for activated carbon dosing (not currently in use)

Table 1 (cont.): Gippsland Water Locality Water Source and Water treatment process

Locality	Estimated Population Serviced ¹	Source water	Storage	Water Treatment Plant	Treatment process										Sludge Thickening Dewatering	Added Substances							
					Coagulation & Flocculation	Clarification		Filtration		Disinfection			Other	Lime / Soda Ash		Alum Based Coagulants	Iron Based Coagulants	Potassium Permanganate	Polymers	Sodium Fluoride/ Hydrofluosilicic Acid	Calgon		
						Sedimentation / Clarification	Dissolved Air Flotation	Granular Media Filter	Membrane	Chlorine Gas	Chloramination	Sodium Hypochlorite										Calcium Hypochlorite	
Seaspray	230	Merrimans Creek	Seaspray Raw Water Storage	Seaspray	X			X					X	X	Soda Ash	Alum 90				1115, 1160			
Thorpdale	210	Easterbrook Creek (July 2015 – September 2015)	Thorpdale raw water storage	Thorpdale	X	X		X					X	X	Soda Ash	Alum		X (Temporary)					
		Tanjil River and Narracan Creek (September 2015 - ongoing)	N/A	Moe	X	X		X		X					X	Soda Ash	Alum				LT20		X
Willow Grove	350	Tanjil River	Blue Rock Lake	Willow Grove	X			X			X			X	Soda Ash	Alum				1115, 1160			

- 1 = The listed populations are for the water sampling localities calculated using 2006 census data to calculate the number of persons per dwelling per locality and then multiplying it with Gippsland Water's 2015-16 figures for number of connections. Figures have also been rounded to the nearest 10.
- 3 = The water supplied to Darnum changed from the Warragul System to the Moe System in March 2012.
- 4 = PAC/GAC used as required to treat for taste and odour compounds
- 5 = The Fluoride dosing system was not operational during the reporting period
- * = PACI-23 used as required to treat high turbidity raw water
- X₁ = Plant capability for activated carbon dosing (not currently in use)

3.2 WATER QUALITY MANAGEMENT SYSTEM

Gippsland Water utilises the ADWG Framework principles in its Water Quality Management System for the supply of safe drinking water. The ADWG Framework is based on the following twelve elements:

1. Commitment to Drinking Water Quality Management.
2. Assessment of the Drinking Water Supply System.
3. Preventive Measures for Drinking Water Quality Management.
4. Operational Procedures and Process Control.
5. Verification of Drinking Water Quality.
6. Management of Incidents and Emergencies.
7. Employee Awareness and Training.
8. Community Involvement and Awareness.
9. Research and Development.
10. Documentation and Reporting.
11. Evaluation and Audit.
12. Review and Continual Improvement

The 12 elements of the Water Quality Management System must be met and the key processes undertaken to meet these requirements include;

3.2.1 Hazard and Risk Identification

To determine the key risk to a water supply to enable control measures to be implemented. Gippsland Water undertakes an extensive hazard assessment process from the catchment to the tap involving management, operational staff, system operators and key stakeholders.

The risks identified during this process are reviewed regularly to identify changes to risks, new risks, or when processes and system changes occur.

3.2.2 Control Measures

Control measures are established to reduce the key risk or likelihood of the risk occurring. The intent is to manage or reduce the risk to an acceptable level. Within Gippsland Water's - Water Quality Management System this consists of;

- Critical Control Points (CCPs) that are alarmed and have the ability to stop processes before a water quality failure occurs. The CCPs are documented and apply to critical process steps in the treatment process
- Maintenance programs that include preventative maintenance of critical assets used in the treatment process and controls systems such as dosing systems, monitoring instrumentation for key assets and system based maintenance such as mains flushing, air scouring, tank and basin cleaning as well as asset maintenance and replacement programs
- Trained and competent water treatment technicians manage the operation and maintenance of water treatment plants and water supply systems. All technicians undertake industry based training to ensure a high level of knowledge of treatment processes and associated risks. Gippsland Water technicians are trained in accordance with the Department of Health and Human Services and Victorian Water Industry Associations Framework for Water Treatment Operator Competencies (2010) requirements to certificate 3 and certificate 4 level in water industry operations.

3.2.3 Verification and Monitoring

Verification and monitoring is used to confirm and authenticate the performance of water treatment processes and water supply systems to ensure compliance with SDWR 2005/2015 standards and ADWG health related and aesthetic guideline values. Verification and monitoring at Gippsland Water includes:

- Supervisory control and data acquisition systems (SCADA) at:
 - Individual water treatment plants
 - Secondary disinfection systems
 - Water supply treated water tanks, storages and pump stations
- System wide telemetry and alarms 24 hours a day, 7 days a week
 - Critical Control Point (CCP) alert and critical process alarms
- Water Treatment and Water Quality Technicians on call 24 hours a day, 7 days a week for system monitoring and alarm verification and response
- A drinking water quality monitoring program covering the catchment, water treatment plant process and water supply system testing and undertaken by an independent National Association of Testing Authorities (NATA) accredited laboratory that include;
 - Pathogenic microorganisms;
 - Inorganic chemicals, including inorganic disinfection by-products; and
 - Organic chemicals, including pesticides, pesticide residues and organic disinfection by-products;
 - Radiological parameters
 - Algal toxins (as required when algal events occur)
- A water treatment chemical quality assurance program undertaken by an independent laboratory that includes certificates of analysis prior to receipt of chemicals for use
- Calibration programs of on-line and benchtop critical instruments used for process control and alert and critical alarm processes by independent service providers
- Customer feedback captured through Gippsland Waters water quality complaint resolution procedure

3.2.4 System Auditing

Internal and external auditing programs have been established to assess compliance of the Water Quality Management System. This includes auditing;

- Water treatment plant records, systems and processes
- Water supply system infrastructure (water mains repairs, treated water storage tanks and basins)
- Challenging testing CCP alert and critical alarms
- Behavioural audits to verify compliance with control, verification and monitoring requirements

3.3 WATER TREATMENT PROCESSES

Gippsland Water operates 16 water supply systems, with 16 water treatment plants (WTP's), supplying 35 localities (42 towns).

The source waters are treated prior to distribution to Gippsland Water's customers with the objective of providing safe drinking water at all times. The treatment varies for each water supply system with the specific treatment process dependent on the quality and risks of the source water.

Table 1 identifies the regular treatment process for each of the water localities and lists the added substances and any periodic treatment activities. The treatment process used depends on the source and quality of the water to be treated. The corporation uses the following treatment processes to produce safe drinking water.

3.3.1 **Coagulation / Flocculation**

Coagulation is a process to remove very fine suspended particles often associated with turbidity, colour or colloidal matter in water. These particles have a negative charge that causes them to repel each other and stay suspended in water. The addition of a suitable 'coagulant' of iron and/or aluminium salt with a positive charge neutralises or destabilises the negative charge enabling the fine particles to join together to form larger particles. The flocculation (floc) process involves stirring the water gently after the coagulant has been added. This allows the particles to come into contact, and eventually causes it to stick together and form floc. This process removes the fine particles, dirt and colour present in the water.

Chemicals used for coagulation/flocculation at the water treatment plants include; aluminium sulphate, ferric sulphate and Polyaluminium silicate sulfate solution (PASS).

3.3.2 **Clarification / Sedimentation**

The clarification or sedimentation of the floc particles formed during the coagulation/flocculation process is usually carried out under still conditions (e.g. in the sedimentation tank or clarifier). A sedimentation tank relies on gravity to separate the floc from the water, which is heavy and falls to the bottom of the tank – leaving the 'cleaner' water on top. A clarifier uses a mechanical process to separate the floc, and the water is collected in troughs at the surface. Once the floc has been removed the clean water is sent to filters.

3.3.3 **Membrane Filtration**

Membrane filtration is used to remove suspended solids and some colloidal matter from the source water. The water is pumped through the filter membrane trapping suspended solids in the process. The concentrate (material that does not pass through the membrane) is periodically removed to waste to prevent the blocking of the membrane filters.

3.3.4 **Filtration**

The clarified water is passed through a filter consisting of several types of graded filter media (sand, gravel and coal) to remove any remaining particles, floc or dissolved chemicals that may have passed through the clarification/sedimentation process.

Another method used utilises Dissolved Air Flotation and Filtration (DAFF) which relies on the injection of microscopic air particles into the water stream, causing the flocculated particles to float to the surface. These particles are then drawn off the surface and off the filtration tank and removed to waste. The clear water then is filtered, as above, through graded filter media.

Over time, the filters gradually become clogged with trapped particles. A filter backwash is carried out to clean the filters, returning it to optimum condition. Air and water is forced up through the filter nozzles to agitate the filter bed and remove any trapped particles. The final turbidity of water leaving the filters, during normal plant operation, is less than 0.1 NTU (Nephelometric Turbidity Units - unit of measure for turbidity).

The backwash water produced during the filter cleaning process is discharged to the sludge thickening system to separate solids from process water. To maximise water use, the separated process water is then returned to the treatment plant and mixed with new raw water to recommence the treatment process.

3.3.5 **Disinfection**

Drinking water is disinfected to prevent the spread of waterborne pathogens that cause diseases such as dysentery, cholera, typhoid and gastroenteritis.

A low residual level of disinfection also ensures that the water remains disinfected once it leaves the water treatment plant until it arrives at the customer's tap.

In Gippsland Water's service area, chlorination is the most commonly used disinfectant because of its reliability and cost effectiveness. Chlorine is the most widely used disinfectant for water supplies in the world. The other disinfection treatment processes used in our region is chloramination

Chlorination

Chlorine is widely used throughout the world to disinfect drinking water and control disease-causing organisms. The type of chlorine used at our plants is either chlorine gas or sodium hypochlorite.

Chloramination

Chloramination is also used throughout the world as a means of disinfecting drinking water to control disease causing organisms. Small amounts of chlorine and ammonia are added to the water to form chloramines, providing a relatively long lasting process to safely disinfect water.

Secondary Disinfection

Disinfectant residuals decrease as water passes throughout the distribution system and within storage tanks. Secondary water disinfection plants are used to maintain adequate disinfection levels within the distribution system.

Gippsland Water operate a number of chlorination secondary disinfection sites that are in place to ensure disinfection residuals are maintained throughout the distribution system by topping up chlorine levels to maintain a balance between adequate disinfection residuals and aesthetic water quality.

3.3.6 **Added Substances**

Lime / Soda Ash

To assist with the treatment process and to ensure the pH level in the raw water (before treatment chemicals are added) and filtered water (after treatment) is within the required ranges, lime or soda ash is added. Lime or soda ash is added to the raw water to adjust the pH to ensure the optimum level for chemical reactions to occur in the coagulation / flocculation process.

Lime or soda ash is also added to the water before it leaves the water treatment plant to maintain the pH in the desired range to optimise the effectiveness of disinfection chlorinated systems and to minimise the risk of corrosion and improve water taste.

Potassium Permanganate

Potassium permanganate can be added to the water supply as required to reduce iron and manganese levels. When present in higher concentrations, these metals can cause staining of laundry and plumbing fixtures and contribute to 'dirty water' events.

Powdered activated carbon

Powdered activated carbon can be added to the water supply as required to remove compounds that contribute to taste and odour issues, usually associated with higher levels of certain algae in raw water.

Fluoridation

In accordance with DHHS requirements, Gippsland Water fluoridates the drinking water supplies of Moe, Morwell, Maffra Traralgon, Sale, and Warragul. All other systems are currently non-fluoridated. Any fluoride present in these non-fluoridated systems is due to naturally occurring sources. For information about the health issues associated with the water fluoridation program contact the Department of Health and Human Services (DHHS) on 1800 651 723

Calgon T

Calgon T can be added to the water supply as required as a sequestration agent to prevent the oxidation of trace levels of manganese in the water supply that can contribute to dirty water issues.

Distribution

After water is filtered and disinfected, it is relayed to customers through a vast network of tanks, basins, pumps and pipes. Gippsland Water uses positive pressure, gravity and backflow prevention to ensure safe drinking water. Positive pressure pushes contaminants away from the water supply system if leaks occur. The Corporation requires high risk properties install a testable backflow prevention device before connecting to the water supply network.

4 SYSTEM ISSUES FOR 2015-16

During the 2015-16 monitoring period, the following issues occurred in the Gippsland Water -water supply system;

- Morwell High Level reticulation system – one positive *E.coli* result identified in the Morwell system (November 2016).
- Sale reticulation system – two positive *E.coli* result identified in the Sale system (February 2016).
- Sale reticulation system – Widespread low pressure public compliant in the Sale system (June 2016).

These events were reportable under Section 22 of the SDWA, and as such are detailed in Section 6 of this report.

5 QUALITY OF DRINKING WATER 2015-16

The SDWR require a water quality monitoring program to be undertaken to verify compliance or non-compliance of specified water quality parameters as listed in the regulations. The quality of water is to be measured at a customer's tap in each of the 35 localities to determine that the water meets the specified quality standard. Over the reporting period, approximately 2,500 samples were collected for quality testing and over 28,000 tests performed. The following section provides a summary of the results against the water quality parameters monitored through the year at the required sampling frequency.

A brief explanation of the required water quality parameters is provided below. A more detailed explanation can be obtained from the ADWG prepared by the National Health and Medical Research Council.

5.1 WATER QUALITY STANDARD PARAMETERS

Escherichia coli (E. coli) – *E. coli* is the most common thermo-tolerant coliform present in faeces and is regarded as the most specific indicator of recent faecal contamination from warm blooded animals. The presence of *E. coli* in the water supply can therefore indicate the potential for other pathogenic bacteria to be present. Results from samples taken at customer taps that exceed the maximum level of this parameter are reported to DHHS, as required under Section 18 of the SDWA.

Chloroacetic (*), Dichloroacetic (*) and Trichloroacetic Acid (*)– These chloroacetic acids are produced in drinking water as by-products of the reaction between chlorine and naturally occurring organic matter derived from the decay of aquatic and terrestrial vegetative matter, present in water supplies. Results from samples taken at customer taps that exceed the maximum level of this parameter are reported to DHHS, as required under Section 18 of the SDWA.

Trihalomethanes (THM) – Trihalomethanes are a category of by-products produced in drinking water, principally as a result of disinfection chemicals (chlorine) reacting with naturally occurring organic matter derived from the decay of aquatic and terrestrial vegetative matter, present in water supplies. Results from samples taken at customer taps that exceed the maximum level of this parameter are reported to DHHS, as required under Section 18 of the SDWA

Acid Soluble Aluminium (*)– Aluminium concentrations may be present in water through natural leaching from soil and rock, or from the use of aluminium salts as coagulants in water treatment. The naturally occurring aluminium concentrations are removed using conventional water treatment practices. "Acid soluble aluminium" is the biologically available fraction of aluminium present in water. Results from samples taken at customer taps that exceed the maximum level of this parameter are reported to DHHS, as required under Section 18 of the SDWA.

Turbidity – Turbidity is caused by the presence of fine suspended matter such as clay, silt, colloidal particles, algae and other microscopic organisms in the water. In high levels, this matter gives the water the appearance of being dirty, muddy or milky. Turbidity is best removed by coagulation and filtration treatment processes.

Results from samples taken at customer taps that exceed the maximum level of this parameter are reported to DHHS, as required under Section 18 of the SDWA.

The Safe Drinking Water Regulations (2015) commenced on 18 July 2015. The changes in monitoring requirements are summarised in Table 2:

Table 2: Summary of changes to the Safe Drinking Water Regulations (Schedule 2):

Parameter	SDWR (2005) Water Quality Standard	SDWR (2015) Water Quality Standard
<i>Escherichia coli</i>	At least 98% of all samples collected in any 12 month period contain no <i>E.coli</i> per 100mL.	All samples of drinking water collected are found to contain no <i>Escherichia coli</i> per 100 millilitres, with the exception of any false positive sample.
Chloroacetic acid	0.15 mg/L	Removed from Regulation (Schedule 2)
Dichloroacetic acid	0.1 mg/L	Removed from Regulation (Schedule 2)
Trichloroacetic acid	0.1 mg/L	Removed from Regulation (Schedule 2)
Trihalomethanes	0.25 mg/L	0.25 mg/L
Bromate	0.02 mg/L*	Removed from Regulation (Schedule 2)
Formaldehyde	0.5 mg/L*	Removed from Regulation (Schedule 2)
Aluminium (Acid Soluble)	0.2 mg/L	Removed from Regulation (Schedule 2)
Turbidity	95% upper confidence limit of the mean of samples of drinking water collected in any 12 month period must be less than or equal to 5.0 NTU.	The 95th percentile of results for samples in any 12 month period must be less than or equal to 5.0 Nephelometric Turbidity Units.

*- Chemicals derived from disinfection or treatment with Ozone. Gippsland Water does not use Ozone in any of its treatment systems

EMERGENCY/INCIDENT MANAGEMENT

5.2 EMERGENCY/INCIDENT MANAGEMENT

Gippsland Water has aligned its incident/emergency management approach to the Australasian Inter-service Incident Management Systems (AIIMS) as part of its SDWA and SDWR emergency and incident management processes.

Gippsland Water has audited and updated its All Hazards Incident Management Plan in June 2016 to comply with the requirements of Part 7a of the Emergency Management Act (2013).

5.3 INCIDENT AND POTENTIAL WATER QUALITY EVENTS

Section 18 of the SDWA states:

'A water supplier must notify the secretary in writing if it becomes aware that the drinking water it is supplying to another person does not comply, or is not likely to comply, with any relevant water quality standard and must do so within 10 days after it becomes aware of the fact'

In 2015-16, the water quality events reported to the DHHS pursuant to section 18 of the SDWA are summarised below.

Table 3: Summary of notifications under Section 18

Water Sampling Locality Affected	Date and duration of incident	Location of incident	Nature of the incident	Drinking water supplies affected	Safe Drinking Water Regulations (Schedule 2) – Standard Not Met
Sale	16-17 th February 2016	Sale Water Reticulation	<i>E. coli</i> detected in drinking water (8 organism/100mL and 4 organism/100mL)	Sale Water Reticulation	<i>Escherichia coli</i> All samples of drinking water collected are found to contain no <i>Escherichia coli</i> per 100 millilitres, with the exception of any false positive sample.

Details of actions taken in response to this incident are detailed in Section 5.4.

5.4 EMERGENCIES AND WATER QUALITY EVENTS

Section 22 of the SDWA states:

‘(1) This section applies if an officer of a water supplier believes or suspects on reasonable grounds that the water supplied, or to be supplied for drinking purposes –

- a. may be the cause of illness; or
- b. may be the means by which an illness is being, has been or will be transmitted; or
- c. may contain any pathogens, substance, chemical or blue-green algae toxin, whether alone or in combination, at levels that may pose a risk to human health; or
- d. may cause widespread public complaint

‘(2) On forming that belief or suspicion, the officer must immediately report his or her belief or suspicion to the Secretary, and must make the report in the form required by the Secretary.’

During the 2015-16 reporting year, there were four reportable events that required notification to the Drinking Water Regulatory Unit of DHHS, under section 22 of the SDWA. These notifications are summarised below.

Table 4: Summary of incidents and actions taken under Section 22

Water Sampling Locality Affected	Date and duration of incident	Location of incident	Nature of the incident	Drinking water supplies affected	Actions taken in response to the incident	Was the community notified
Morwell	5 th November 2015	Morwell High Level Water Reticulation	<i>E. coli</i> detected in drinking water (2 organism/ 100mL)	Morwell High Level Water Reticulation	<p>Department of Health and Human Services (DHHS) Notification under section 22 SDWA.</p> <p>Extensive flushing undertaken throughout the reticulation network and additional monitoring of water quality parameters undertaken during and after the event. Additional disinfection undertaken at storage.</p> <p>All subsequent reticulation monitoring was compliant.</p> <p>The investigation report was submitted to DHHS, with the initial detection being determined to be a false positive, as per the Regulations (2015)</p> <p>Refresher training of sampling staff undertaken.</p>	No
Sale	16-17 th February 2016	Sale Water Reticulation	<i>E. coli</i> detected in drinking water (8 organism/ 100mL and 4 organism/ 100mL)	Sale Water Reticulation	<p>Department of Health and Human Services (DHHS) Notification under section 22 SDWA.</p> <p>Department of Health and Human Services (DHHS) Notification under section 22 SDWA.</p> <p>Extensive flushing undertaken throughout the reticulation network and additional</p>	Yes

Water Sampling Locality Affected	Date and duration of incident	Location of incident	Nature of the incident	Drinking water supplies affected	Actions taken in response to the incident	Was the community notified
					<p>monitoring of water quality parameters undertaken during and after the event.</p> <p>Initial positive sample occurred at Sale WTP tower on 16th February 2016. Pre flush resampling on the 17th February was all clear of E.coli however a second positive sample occurred after post flush resampling on the 17th February 2016 at extremity of reticulated water system.</p> <p>Follow up pre and post flush resampling on the 18th February 2016 was all clear</p> <p>All subsequent reticulation monitoring was compliant.</p> <p>A thorough investigation was undertaken and the Sale WTP tower sample points was relocated due to contamination risk.</p> <p>Refresher training of sampling staff undertaken.</p>	
Sale	8 th June 2016	Sale Water Reticulation	Widespread Public Complaint Notification	Sale Water Reticulation	<p>During a planned operational shut in the Sale system the town experienced reduced pressure for a short period of time.</p> <p>Approximately 172 pressure / supply complaints were reported during the event.</p> <p>No water quality issues were experienced.</p> <p>All reticulation monitoring sampling undertaken on the day and subsequently was compliant</p>	

5.5 OTHER EVENTS NOT REPORTABLE

There were no other events of note for the reporting period of 2015-16

6 COMPLAINTS

6.1 WATER QUALITY COMPLAINTS

A summary of customer complaints received by Gippsland Water relating to the quality of drinking water supplied is reported below.


Gippsland Water records and reports on customer complaints relating to dirty water, taste and odour problems, suspected illness/health concerns, blue water, and appearance of air-filled or “white” water received from the tap.

Table 5: Water quality complaints per 100 customers supplied

Type of Complaint	2015-16		2014-15	2013-14	2012-13	2011-12
	No. of Complaints	Complaints per 100 customers	Complaints per 100 customers	Complaints per 100 customers	Complaints per 100 customers	Complaints per 100 customers
Discoloured water	126	0.185	0.239	0.215	0.224	0.328
Taste / odour	76	0.112	0.115	0.106	0.104	0.294
Blue water	2	0.003	0.006	0.000	0.005	0.002
Air in water	18	0.026	0.064	0.058	0.058	0.075
Alleged illness	8	0.012	0.014	0.021	0.005	0.015
Total	230	0.339	0.439	0.400	0.396	0.715


The total number of complaints received by Gippsland Water was similar for the 2015-2016 reporting period than the previous year, although fewer complaints were recorded for discoloured water. The results are presented below by type and locality.

Figure 2: Total Customer Complaints for 2015-16

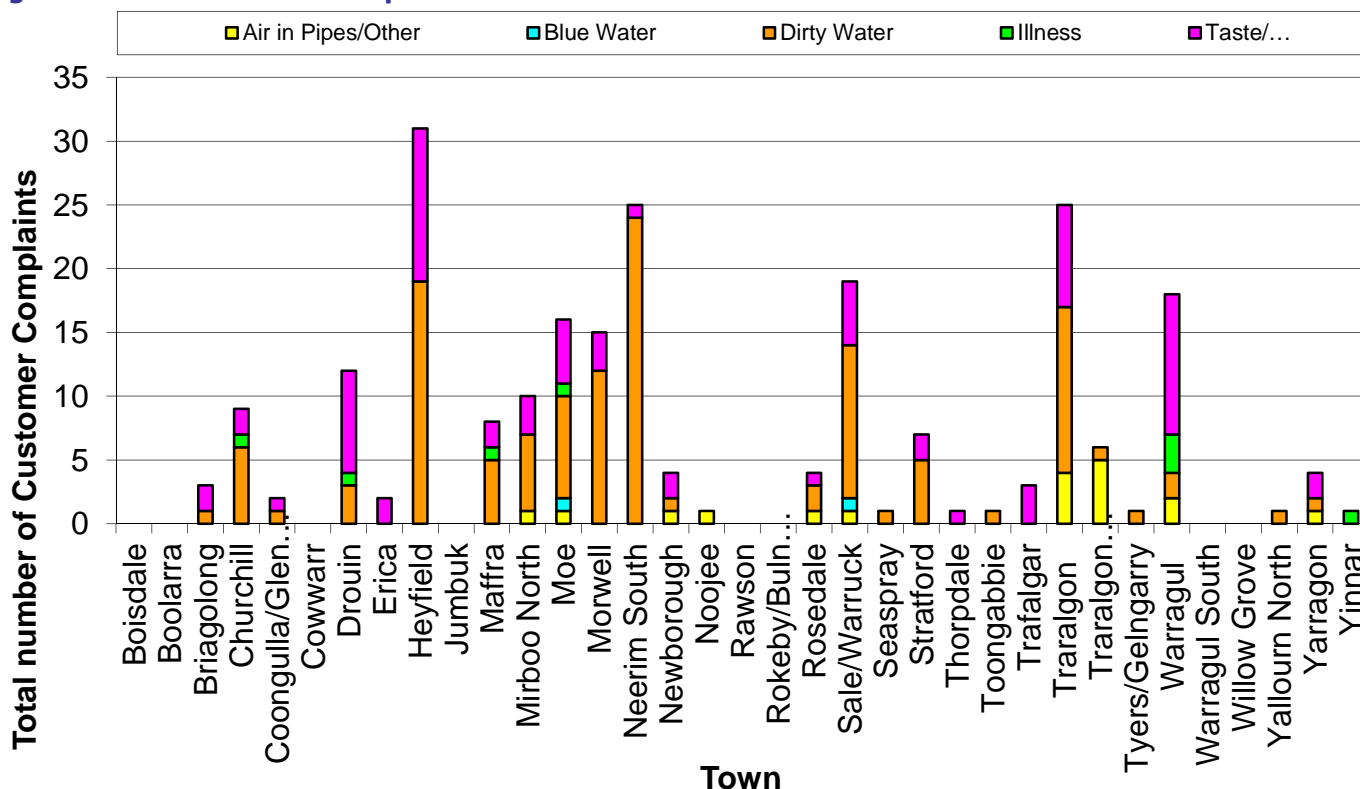

When calculating the number of complaints per 100 customers, there were no localities within Gippsland Water’s supply district which exceeded 4 complaints per 100 customers, as represented in the figure below.

Figure 3: Customer Complaints per 100 customers for 2015-16

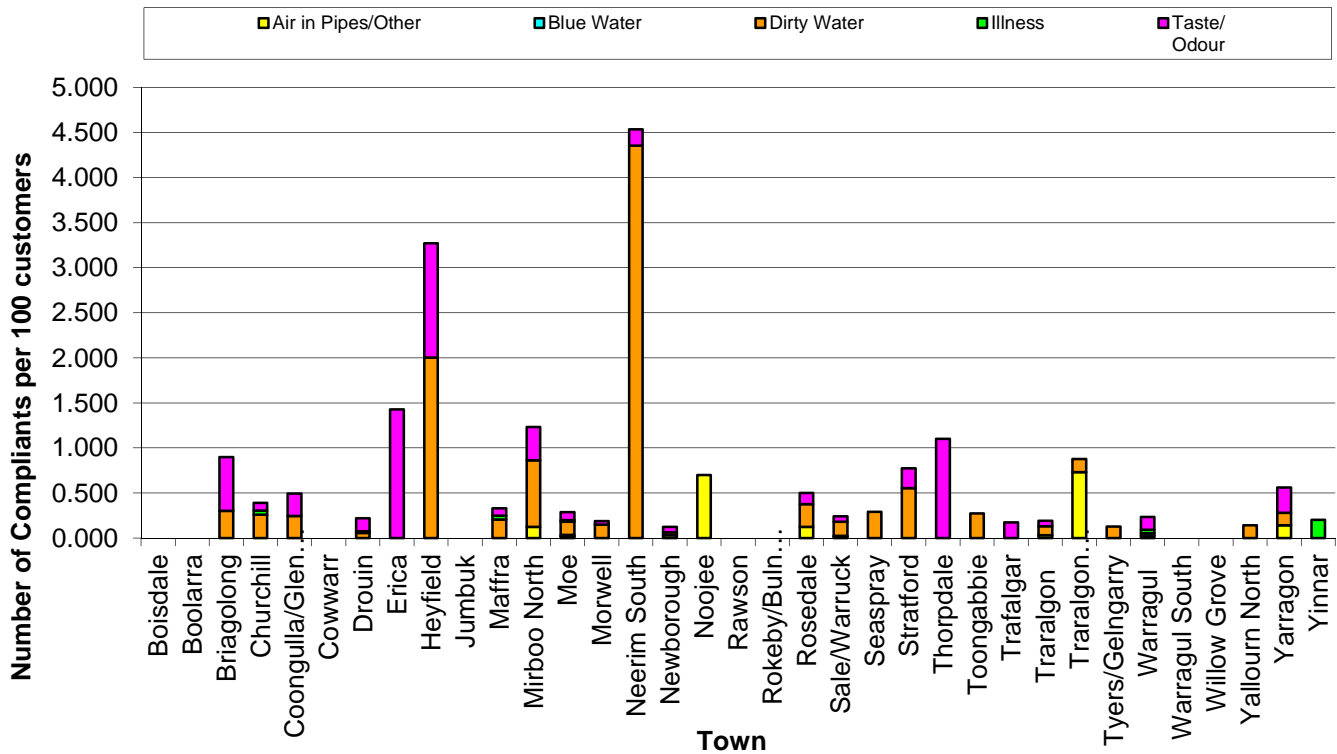


6.2 A SUMMARY OF THE CUSTOMER COMPLAINT PROCESS

Customer complaints are managed according to the following summary procedure:

- Customer complaints received by Gippsland Water’s Service Centre are recorded in a database. Details include information of who, where, time and nature of complaint.
- The Water Quality Group investigates by visiting the site and contacting the customer if necessary to determine details of the water quality problem.
- For complaints associated with taste and odour, dirty water, and air in pipes, field measurements are performed, the reticulation system is typically flushed then field measurements are taken again to verify the problem has been corrected.
- Follow up contact may be made with the customer to determine if they are satisfied with the quality of service or alternatively a standard Gippsland Water contact card is left with the customer. This also encourages customers to keep Gippsland Water informed of any reoccurrence of water quality problems.
- Details of actions undertaken are entered into a database to provide a record/history of the site, to document issues for maintenance programs, and to inform capital upgrade requirements where a history of system failures occurs.

This procedure is presented in more detail in the figure below.

Figure 4: Water Quality Complaints Resolution Procedure

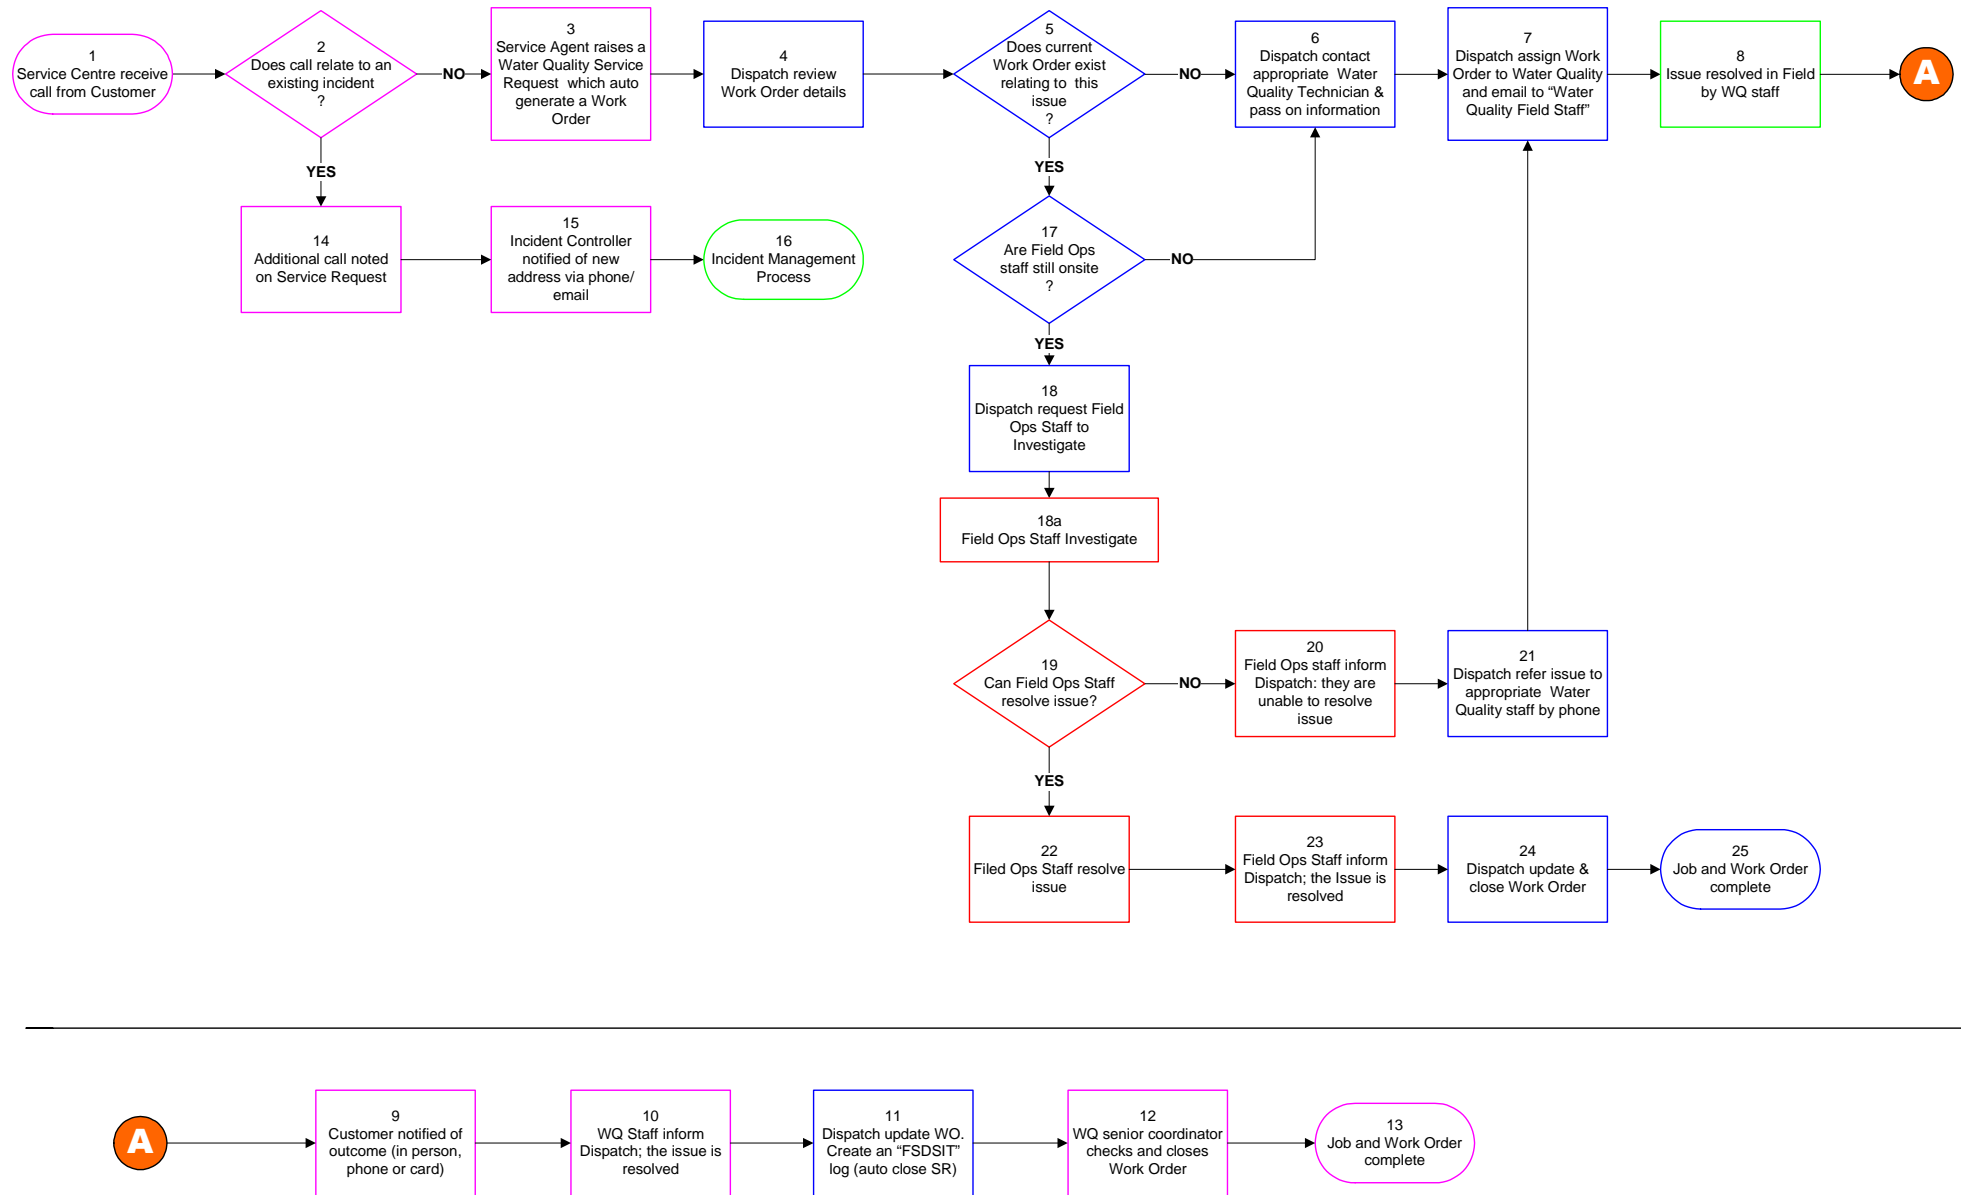

This page intentionally left blank

7 RISK MANAGEMENT PLAN AUDIT

Gippsland Water's Water Quality Risk Management Plan has been operational since 2005 and adopts the 12 elements outlined in the ADWG and preventative risk management strategies outlined in the SDWA.

In June 2016 Gippsland Water's Water Quality Risk Management Plan was audited by Department of Health and Human Services approved auditors for compliance with section 7(1) of the SDWA 2003 for compliance against the requirements of the Safe Drinking Water Regulations 2005 and Safe Drinking Water Regulations 2015. The audit also examined if opportunities identified in the previous audit (March 2014) had been satisfactorily addressed.

The June 2016 audit for the audit period 17 March 2014 to 30 June 2016 confirmed that Gippsland Water complied with the obligations of the SDWA, with six (6) opportunities for improvement (OFI) identified (refer below).

Table 6: Risk Management Plan Opportunity for Improvements

Opportunity for Improvement (OFI)	GW Action Identified
<p>OFI 1: GW should consider including a user's guide at the beginning of the DWQM (Drinking Water Quality Management Manual) to assist users to locate information relating to specific SDWA and environmental compliance</p>	<p>GW Action: A review of the DWQM (Drinking Water Quality Management Manual) has been undertaken and the user guide incorporated as Section 18 of the Manual (COR/10/10458 Gippsland Water Drinking Water Quality Manual). Extract from table of contents below</p>
<p>OFI 2: GW should examine the development of better training and more stringent controls related to sampling</p>	<p>GW Action: Gippsland Water have undertaken a review of the training requirements specific to the water quality sampling protocols. The review of certificate III training program based on new National Training Requirements has been completed and new training program implemented for new staff. Ongoing and review and training associated with sampling SOP is part of the WTQC Technical Group Activity Management Plan (COR/10/13993)</p>
<p>OFI 3: GW should consider diverting filtered water to waste, or at least to the head of the plant, during the filter ripening period</p>	<p>GW Action: In 2015 City Water Technology undertook an assessment of diversion options at a select number of water treatment plants (Neerim South COR/15/26531, Warragul COR/15/26527, Traralgon COR/15/28404). City Water Technology option reports were forwarded to Gippsland Waters Asset planning group for inclusion in Pricing Submission risk assessment and prioritisation process (Diversion of Off Specification Water)</p>

<p>OFI 4: GW should consider the installation of UPS back-up power supplies at gravity-fed WTP's</p>	<p>GW Action: In progress as Water Treatment Quality and Catchment (WTQC) and ICT SCADA 2016/17 action item identified. SCADA / Workgroup position and direction to rollout across all plants (Feasibility Study to be undertaken during 2016/17, review implementation program during 17/18)</p>
<p>OFI 5: GW should replace the aged floating treated water basin covers as a matter of urgency</p>	<p>GW Action: Floating cover replacement program Asset Mgt/Planning (COR/14/78146 Treated Water Basins Asset Class Plan, COR/14/104125 Treated Water Basins Decision Support Workbook). Replacement program in progress through Pricing Submission 3 and 4 based on risk and prioritisation process</p>
<p>OFI 6: GW should ensure that the documentation of all backflow prevention devices is completed as a matter of urgency in order to eliminate the associated water quality risks</p>	<p>GW Action: 2016/17 corporate project. Review of backflow prevention requirements including re-assessment of residential and non-residential customers register, risk assess and rank against AS/NZ Std, review business policy and procedures with respect to processing of applications (fire service, trade waste customer), notification of customers identified, registration at GW in CIBS, annual testing requirements letter , data/document management , annual audit plan</p>

Gippsland Water developed an action plan and has addressed the opportunities for improvement during the 2016-17 reporting period

8 WATER QUALITY RESULTS FOR 2015-16

8.1 ESCHERICHIA COLI (E. COLI)

8.1.1 E. coli results

Compliance under the SDWR (2015) requires all samples of drinking water collected within a locality to contain no *E. coli* organism/100ml of drinking water. All Gippsland Water localities achieved compliance with this standard for the 2015-16 reporting period.

For the period 1st July 2015 to 18th July 2015, compliance was with the SDWR (2005), which required that 98% of all samples of drinking water collected in any 12-month period must contain no *E. coli* organism/100ml. All Gippsland Water sites achieved 100% compliance with this standard for this time period.

Table 7: *E. coli* results for localities 2015-16 (1st July 2015 to 17th July 2015)

Locality	Frequency of sampling	No. of samples*	No. of Non complying results	Max result (organisms/100mL)	% with no <i>E. coli</i>	Complying (Yes/No)
Boisdale	Weekly	2	0	0	100%	Yes
Boolarra	Weekly	3	0	0	100%	Yes
Briagolong	Weekly	2	0	0	100%	Yes
Churchill	Weekly	3	0	0	100%	Yes
Coongulla-Glenmaggie	Weekly	3	0	0	100%	Yes
Cowwarr	Weekly	2	0	0	100%	Yes
Drouin	Weekly	4*	0	0	100%	Yes
Erica	Weekly	2	0	0	100%	Yes
Heyfield	Weekly	3	0	0	100%	Yes
Jumbuk	Weekly	2	0	0	100%	Yes
Maffra	Weekly	3	0	0	100%	Yes
Mirboo North	Weekly	3	0	0	100%	Yes
Moe	Weekly	4*	0	0	100%	Yes
Morwell	Weekly	4*	0	0	100%	Yes
Neerim South	Weekly	2	0	0	100%	Yes
Newborough	Weekly	2	0	0	100%	Yes
Noojee	Weekly	2	0	0	100%	Yes
Rawson	Weekly	2	0	0	100%	Yes
Rokey-Buln Buln	Weekly	2	0	0	100%	Yes
Rosedale	Weekly	2	0	0	100%	Yes
Sale-Wurru	Weekly	4*	0	0	100%	Yes
Seaspray	Weekly	2	0	0	100%	Yes
Stratford	Weekly	2	0	0	100%	Yes
Thorpdale	Weekly	3	0	0	100%	Yes
Toongabbie	Weekly	2	0	0	100%	Yes
Trafalgar	Weekly	2	0	0	100%	Yes
Traralgon	Weekly	7*	0	0	100%	Yes
Traralgon South-Hazelwood North	Weekly	2	0	0	100%	Yes
Tyers-Glengarry	Weekly	3	0	0	100%	Yes
Warragul	Weekly	3*	0	0	100%	Yes
Warragul South	Weekly	2	0	0	100%	Yes
Willow Grove	Weekly	2	0	0	100%	Yes
Yallourn North	Weekly	3	0	0	100%	Yes
Yarragon	Weekly	2	0	0	100%	Yes
Yinnar	Weekly	2	0	0	100%	Yes

* The number of samples collected in a locality is determined by the *ADWG* recommendations (Section 10-5) regarding population-based sampling frequency for *E. coli*. Localities with populations greater than 5,000 have more than one sample taken per week. The data presented refers to the period under the Safe Drinking Water Regulations (2005) – 1 July 2015 to 17 July 2015.

For the reporting period 1 July 2015 to 17 July 2015, all localities were compliant with the requirements of the Safe Drinking Water Regulations (2005).

Table 8 below details all E.coli notifications for the reporting period 18 July 2015 to 30 June 2016 under the Safe Drinking Water Regulations (2015).

Table 8: *E. coli* detections for localities 2015-16 (18th July 2015 to 30th June 2016)

Locality	No. of investigations conducted (s. 22)	No. of confirmed false positives	No. of investigations where standard not met (s. 18)
Morwell	1	1	0
Sale	1	0	1

8.1.2 Actions taken in relation to non-compliance

Two E.coli detections occurred within the Sale Locality between 16 – 17 February 2016. The Department of Health and Human Services (DHHS) was notified under section 22 SDWA.

The initial positive sample occurred at Sale WTP Tower on 16 February 2016. Once notification of the detection was received, additional samples were collected from multiple sites throughout the reticulation prior to an extensive flushing program being undertaken. All the pre flush samples collected on the 17 February 2016 showed no E.coli present.

Extensive flushing was undertaken throughout the reticulation network and additional monitoring and sampling of water quality parameters was undertaken.

The additional sampling (post flush) conducted on 17 February 2016 returned a second positive sample, from a location at the extremity of reticulated water system. It is possible that this detection occurred as a result of scouring biofilm from the inside of the pipe or via contamination at the point of sampling. As the exact cause of the detection could not be identified, the result was not declared a false positive.

Further extensive sampling, flushing and re-sampling was undertaken on 18 February 2016, with all samples collected showing no E.coli present.

All subsequent reticulation monitoring was compliant.

A thorough investigation was undertaken and a report submitted to DHHS. During the investigation, it was determined that the Sale WTP tower sample point was in close proximity to connected redundant pipework. It is possible that this may have led to the contamination of the initial sample. The pipework has been removed and the sample point relocated.

Refresher training of sampling techniques with staff has been undertaken.

8.2 CHLORINE BASED DISINFECTION BY-PRODUCT CHEMICALS

8.2.1 Chloroacetic acid results

For compliance with the SDWR (2005), a sample result must not exceed 0.15 mg/L for chloroacetic acid. All Gippsland Water sites achieved 100% compliance with this standard for the 2015-16 reporting period.

Table 9: Chloroacetic acid results for all localities 2015-16

Locality	Frequency of sampling	No. of samples	No. of non complying samples	Max (mg/L)	Min (mg/L)	Complying (Yes/No)
Boisdale	Monthly	1	0	<0.005	<0.005	Yes
Boolarra	Monthly	1	0	<0.005	<0.005	Yes
Briagolong	Monthly	1	0	<0.005	<0.005	Yes
Churchill	Monthly	1	0	<0.005	<0.005	Yes
Coongulla-Glenmaggie	Monthly	1	0	<0.005	<0.005	Yes
Cowwarr	Monthly	1	0	<0.005	<0.005	Yes
Drouin	Monthly	1	0	<0.005	<0.005	Yes
Erica	Monthly	1	0	<0.005	<0.005	Yes
Heyfield	Monthly	1	0	<0.005	<0.005	Yes
Jumbuk	Monthly	1	0	<0.005	<0.005	Yes
Maffra	Monthly	1	0	<0.005	<0.005	Yes
Mirboo North	Monthly	1	0	<0.005	<0.005	Yes
Moe	Monthly	1	0	<0.005	<0.005	Yes
Morwell	Monthly	1	0	<0.005	<0.005	Yes
Neerim South	Monthly	1	0	<0.005	<0.005	Yes
Newborough	Monthly	1	0	<0.005	<0.005	Yes
Noojee	Monthly	1	0	<0.005	<0.005	Yes
Rawson	Monthly	1	0	<0.005	<0.005	Yes
Rokeby-Buln Buln	Monthly	1	0	<0.005	<0.005	Yes
Rosedale	Monthly	1	0	<0.005	<0.005	Yes
Sale-Wurruk	Monthly	1	0	<0.005	<0.005	Yes
Seaspray	Monthly	1	0	<0.005	<0.005	Yes
Stratford	Monthly	1	0	<0.005	<0.005	Yes
Thorpdale	Monthly	1	0	<0.005	<0.005	Yes
Toongabbie	Monthly	1	0	<0.005	<0.005	Yes
Trafalgar	Monthly	1	0	<0.005	<0.005	Yes
Traralgon	Monthly	1	0	<0.005	<0.005	Yes
Traralgon South-Hazelwood North	Monthly	1	0	<0.005	<0.005	Yes
Tyers-Glengarry	Monthly	1	0	<0.005	<0.005	Yes
Warragul	Monthly	1	0	<0.005	<0.005	Yes
Warragul South	Monthly	1	0	<0.005	<0.005	Yes
Willow Grove	Monthly	1	0	<0.005	<0.005	Yes
Yallourn North	Monthly	1	0	<0.005	<0.005	Yes
Yarragon	Monthly	1	0	<0.005	<0.005	Yes
Yinnar	Monthly	1	0	<0.005	<0.005	Yes

8.2.2 Actions taken in relation to non-compliance

All localities complied with this water quality parameter.

On 18th July 2015, the Safe Drinking Water Regulations (2015) came into effect which removed the requirement to monitor this parameter. Based on the monitoring history and assessed risk, the frequency of monitoring of this parameter was reduced.

8.2.3 Dichloroacetic acid results

For compliance with the SDWR (2005), a sample result must not exceed 0.1 mg/L dichloroacetic acid. All Gippsland Water sites achieved 100% compliance with this standard for the 2015-16 reporting period.

Table 10: Dichloroacetic acid results for all localities 2015-16

Locality	Frequency of sampling	No. of samples	No. of non complying samples	Max (mg/L)	Min (mg/L)	Complying (Yes/No)
Boisdale	Monthly	1	0	0.006	0.006	Yes
Boolarra	Monthly	1	0	<0.005	<0.005	Yes
Briagolong	Monthly	1	0	<0.005	<0.005	Yes
Churchill	Monthly	1	0	0.006	0.006	Yes
Coongulla-Glenmaggie	Monthly	1	0	<0.005	<0.005	Yes
Cowwarr	Monthly	1	0	0.028	0.028	Yes
Drouin	Monthly	1	0	0.005	0.005	Yes
Erica	Monthly	1	0	<0.005	<0.005	Yes
Heyfield	Monthly	1	0	<0.005	<0.005	Yes
Jumbuk	Monthly	1	0	<0.005	<0.005	Yes
Maffra	Monthly	1	0	0.006	0.006	Yes
Mirboo North	Monthly	1	0	<0.005	<0.005	Yes
Moe	Monthly	1	0	<0.005	<0.005	Yes
Morwell	Monthly	1	0	0.007	0.007	Yes
Neerim South	Monthly	1	0	0.009	0.009	Yes
Newborough	Monthly	1	0	<0.005	<0.005	Yes
Noojee	Monthly	1	0	0.009	0.009	Yes
Rawson	Monthly	1	0	0.007	0.007	Yes
Rokeby-Buln Buln	Monthly	1	0	0.007	0.007	Yes
Rosedale	Monthly	1	0	0.013	0.013	Yes
Sale-Wurruk	Monthly	1	0	<0.005	<0.005	Yes
Seaspray	Monthly	1	0	0.008	0.008	Yes
Stratford	Monthly	1	0	<0.005	<0.005	Yes
Thorpdale	Monthly	1	0	<0.005	<0.005	Yes
Toongabbie	Monthly	1	0	0.013	0.013	Yes
Trafalgar	Monthly	1	0	<0.005	<0.005	Yes
Traralgon	Monthly	1	0	0.008	0.008	Yes
Traralgon South-Hazelwood North	Monthly	1	0	0.006	0.006	Yes
Tyers-Glengarry	Monthly	1	0	0.012	0.012	Yes
Warragul	Monthly	1	0	0.006	0.006	Yes
Warragul South	Monthly	1	0	<0.005	<0.005	Yes
Willow Grove	Monthly	1	0	<0.005	<0.005	Yes
Yallourn North	Monthly	1	0	0.006	0.006	Yes
Yarragon	Monthly	1	0	<0.005	<0.005	Yes
Yinnar	Monthly	1	0	<0.005	<0.005	Yes

8.2.4 Actions taken in relation to non-compliance

All localities complied with this water quality parameter.

On 18th July 2015, the Safe Drinking Water Regulations (2015) came into effect which removed the requirement to monitor this parameter. Based on the monitoring history and assessed risk, the frequency of monitoring of this parameter was reduced.

8.2.5 Trichloroacetic acid results

For compliance with the SDWR (2005), a sample result must not exceed 0.1 mg/L trichloroacetic acid. All Gippsland Water sites achieved 100% compliance with this standard for the 2015-16 reporting period.

Table 11: Trichloroacetic acid for all localities 2015-16

Locality	Frequency of sampling	No. of samples	No. of non complying samples	Max (mg/L)	Min (mg/L)	Complying (Yes/No)
Boisdale	Monthly	1	0	0.008	0.008	Yes
Boolarra	Monthly	1	0	0.017	0.017	Yes
Briagolong	Monthly	1	0	<0.005	<0.005	Yes
Churchill	Monthly	1	0	0.008	0.008	Yes
Coongulla-Glenmaggie	Monthly	1	0	<0.005	<0.005	Yes
Cowwarr	Monthly	1	0	0.020	0.020	Yes
Drouin	Monthly	1	0	0.006	0.006	Yes
Erica	Monthly	1	0	0.006	0.006	Yes
Heyfield	Monthly	1	0	0.020	0.020	Yes
Jumbuk	Monthly	1	0	0.020	0.020	Yes
Maffra	Monthly	1	0	<0.005	<0.005	Yes
Mirboo North	Monthly	1	0	<0.005	<0.005	Yes
Moe	Monthly	1	0	<0.005	<0.005	Yes
Morwell	Monthly	1	0	0.008	0.008	Yes
Neerim South	Monthly	1	0	0.008	0.008	Yes
Newborough	Monthly	1	0	<0.005	<0.005	Yes
Noojee	Monthly	1	0	0.007	0.007	Yes
Rawson	Monthly	1	0	0.006	0.006	Yes
Rokeby-Buln Buln	Monthly	1	0	0.007	0.007	Yes
Rosedale	Monthly	1	0	0.018	0.018	Yes
Sale-Wurruk	Monthly	1	0	<0.005	<0.005	Yes
Seaspray	Monthly	1	0	0.008	0.008	Yes
Stratford	Monthly	1	0	0.005	0.005	Yes
Thorpdale	Monthly	1	0	<0.005	<0.005	Yes
Toongabbie	Monthly	1	0	0.017	0.017	Yes
Trafalgar	Monthly	1	0	<0.005	<0.005	Yes
Traralgon	Monthly	1	0	<0.005	<0.005	Yes
Traralgon South-Hazelwood North	Monthly	1	0	0.008	0.008	Yes
Tyers-Glengarry	Monthly	1	0	0.014	0.014	Yes
Warragul	Monthly	1	0	0.006	0.006	Yes
Warragul South	Monthly	1	0	0.015	0.015	Yes
Willow Grove	Monthly	1	0	<0.005	<0.005	Yes
Yallourn North	Monthly	1	0	<0.005	<0.005	Yes
Yarragon	Monthly	1	0	<0.005	<0.005	Yes
Yinnar	Monthly	1	0	0.016	0.016	Yes

8.2.6 Actions taken in relation to non-compliance

All localities complied with this water quality parameter.

On 18th July 2015, the Safe Drinking Water Regulations (2015) came into effect which removed the requirement to monitor this parameter. Based on the monitoring history and assessed risk, the frequency of monitoring of this parameter was reduced.

8.2.7 Trihalomethanes (THM) results

For compliance with the SDWR (2005 & 2015), a sample result must not exceed 0.25 mg/L trihalomethanes. All Gippsland Water sites achieved 100% compliance with this standard for the 2015-16 reporting period.

Table 12: Trihalomethanes results for all localities for 2015-16

Locality	Frequency of sampling	No. of samples	No. of non complying samples	Max (mg/L)	Min (mg/L)	Complying (Yes/No)
Boisdale	Monthly	12	0	0.049	0.035	Yes
Boolarra	Monthly	12	0	0.087	0.049	Yes
Briagolong	Monthly	12	0	0.010	0.004	Yes
Churchill	Monthly	12	0	0.067	0.022	Yes
Coongulla-Glenmaggie	Monthly	12	0	0.036	<0.001	Yes
Cowwarr	Monthly	12	0	0.084	0.044	Yes
Drouin	Monthly	12	0	0.068	0.027	Yes
Erica	Monthly	12	0	0.050	0.019	Yes
Heyfield	Monthly	12	0	0.043	0.014	Yes
Jumbuk	Monthly	12	0	0.087	0.049	Yes
Maffra	Monthly	12	0	0.059	0.014	Yes
Mirboo North	Monthly	12	0	0.035	0.016	Yes
Moe	Monthly	12	0	0.047	0.021	Yes
Morwell	Monthly	12	0	0.052	0.015	Yes
Neerim South	Monthly	12	0	0.048	0.030	Yes
Newborough	Monthly	12	0	0.051	0.027	Yes
Noojee	Monthly	12	0	0.036	0.020	Yes
Rawson	Monthly	12	0	0.045	0.015	Yes
Rokeby-Buln Buln	Monthly	12	0	0.058	0.030	Yes
Rosedale	Monthly	12	0	0.120	0.046	Yes
Sale-Wurruk	Monthly	12	0	0.038	0.020	Yes
Seaspray	Monthly	12	0	0.170	0.110	Yes
Stratford	Monthly	12	0	0.045	0.029	Yes
Thorpdale	Monthly	12	0	0.069	0.033	Yes
Toongabbie	Monthly	12	0	0.062	0.042	Yes
Trafalgar	Monthly	12	0	0.041	0.022	Yes
Traralgon	Monthly	12	0	0.033	0.011	Yes
Traralgon South-Hazelwood North	Monthly	12	0	0.057	0.022	Yes
Tyers-Glengarry	Monthly	12	0	0.054	0.038	Yes
Warragul	Monthly	12	0	0.077	0.021	Yes
Warragul South	Monthly	12	0	0.084	0.039	Yes
Willow Grove	Monthly	12	0	0.003	<0.001	Yes
Yallourn North	Monthly	12	0	0.054	0.036	Yes
Yarragon	Monthly	12	0	0.052	0.030	Yes
Yinnar	Monthly	12	0	0.063	0.031	Yes

8.2.8 Actions taken in relation to non-compliance

All localities complied with this water quality parameter.

8.3 OZONE BASED DISINFECTION BY-PRODUCT CHEMICALS

Gippsland Water has no ozone dosing systems and therefore the ozone based chemical concentrations of bromate and formaldehyde have not been included in the routine testing program.

8.4 ALUMINIUM

8.4.1 Aluminium results

For compliance with the SDWR (2005), a sample result must not exceed a maximum of 0.2mg/L aluminium (acid soluble) in drinking water. All Gippsland Water sites achieved 100% compliance with this standard for the 2015-16 reporting period.

Table 13: Aluminium results for all localities in 2015-16

Locality	Frequency of Sampling	No. of Samples	No. of non complying samples	Max (mg/L)	Min (mg/L)	Complying (Yes/No)
Boisdale	Monthly	1	0	<0.01	<0.01	Yes
Boolarra	Monthly	1	0	0.01	0.01	Yes
Briagolong	Monthly	1	0	<0.01	<0.01	Yes
Churchill	Monthly	1	0	0.01	0.01	Yes
Coongulla & Glenmaggie	Monthly	1	0	<0.01	<0.01	Yes
Cowwarr	Monthly	1	0	<0.01	<0.01	Yes
Drouin	Monthly	1	0	0.02	0.02	Yes
Erica	Monthly	1	0	<0.01	<0.01	Yes
Heyfield	Monthly	1	0	<0.01	<0.01	Yes
Jumbuk	Monthly	1	0	0.01	0.01	Yes
Maffra	Monthly	1	0	<0.01	<0.01	Yes
Mirboo North	Monthly	1	0	<0.01	<0.01	Yes
Moe	Monthly	1	0	0.02	0.02	Yes
Morwell	Monthly	1	0	0.02	0.02	Yes
Neerim South	Monthly	1	0	<0.01	<0.01	Yes
Newborough	Monthly	1	0	0.01	0.01	Yes
Noojee	Monthly	1	0	<0.01	<0.01	Yes
Rawson	Monthly	1	0	<0.01	<0.01	Yes
Rokeby & Buln Buln	Monthly	1	0	0.02	0.02	Yes
Rosedale	Monthly	1	0	0.01	0.01	Yes
Sale/Wurruk	Monthly	1	0	<0.01	<0.01	Yes
Seaspray	Monthly	1	0	<0.01	<0.01	Yes
Stratford	Monthly	1	0	<0.01	<0.01	Yes
Thorpdale	Monthly	1	0	0.01	0.01	Yes
Toongabbie	Monthly	1	0	<0.01	<0.01	Yes
Trafalgar	Monthly	1	0	0.01	0.01	Yes
Traralgon	Monthly	1	0	0.04	0.04	Yes
Traralgon South & Hazelwood North	Monthly	1	0	0.02	0.02	Yes
Tyers & Glengarry	Monthly	1	0	<0.01	<0.01	Yes
Warragul	Monthly	1	0	0.02	0.02	Yes
Warragul South	Monthly	1	0	0.03	0.03	Yes
Willow Grove	Monthly	1	0	0.01	0.01	Yes
Yallourn North	Monthly	1	0	0.02	0.02	Yes
Yarragon	Monthly	1	0	0.01	0.01	Yes
Yinnar	Monthly	1	0	0.01	0.01	Yes

8.4.2 Actions taken in relation to non-compliance

All localities complied with this water quality parameter.

On 18th July 2015, the Safe Drinking Water Regulations (2015) came into effect which removed the requirement to monitor this parameter. Based on the monitoring history and assessed risk, the frequency of monitoring of this parameter was reduced.

8.5 TURBIDITY

8.5.1 Turbidity results

For compliance with the SDWR (2015), the 95th Percentile of results for samples of drinking water collected in any 12-month period, must be less than or equal to 5.0 NTU (Nephelometric Turbidity Unit). All Gippsland Water sites achieved 100% compliance with this standard for the 2015-16 reporting period.

For the period 1st July 2015 to 18th July 2015, compliance was with the SDWR (2005), which required that the 95% upper confidence limit of the mean of all values for samples of drinking water collected in any 12-month period, must have turbidity measured as less than or equal to 5.0 NTU (Nephelometric Turbidity Unit). All Gippsland Water sites achieved 100% compliance with this standard for this time period.

Table 14: Turbidity results for all localities in 2015-16

Locality	Frequency of Sampling	No. of Samples	No. of non complying samples	Max (NTU)	Min (NTU)	95% Percentile (Results in 12 month period)*	Complying (Yes/No)
Boisdale	Weekly	52	0	0.2	<0.1	0.2	Yes
Boolarra	Weekly	53	0	0.5	0.2	0.4	Yes
Briagolong	Weekly	52	0	0.2	<0.1	0.2	Yes
Churchill	Weekly	52	0	0.3	<0.1	0.2	Yes
Coongulla & Glenmaggie	Weekly	53	0	1.7	<0.1	0.4	Yes
Cowwarr	Weekly	52	0	1.1	<0.1	0.3	Yes
Drouin	Weekly	52	0	0.2	<0.1	0.2	Yes
Erica	Weekly	52	0	3.4	<0.1	1.1	Yes
Heyfield	Weekly	53	0	6.5	<0.1	0.4	Yes
Jumbuk	Weekly	52	0	0.3	0.1	0.2	Yes
Maffra	Weekly	52	0	1.9	<0.1	0.1	Yes
Mirboo North	Weekly	53	0	0.3	<0.1	0.2	Yes
Moe	Weekly	52	0	0.2	<0.1	0.2	Yes
Morwell	Weekly	53	0	0.5	<0.1	0.2	Yes
Neerim South	Weekly	52	0	1.0	0.1	0.4	Yes
Newborough	Weekly	52	0	0.2	<0.1	0.1	Yes
Noojee	Weekly	52	0	1.1	0.2	0.4	Yes
Rawson	Weekly	52	0	1.6	0.1	0.4	Yes
Rokeby & Buln Buln	Weekly	52	0	0.2	<0.1	0.2	Yes
Rosedale	Weekly	52	0	5.2	<0.1	1.3	Yes
Sale/Wurruk	Weekly	52	0	0.6	<0.1	0.2	Yes
Seaspray	Weekly	52	0	1.6	0.2	1.0	Yes
Stratford	Weekly	52	0	0.3	<0.1	0.2	Yes
Thorpdale	Weekly	53	0	0.8	0.1	0.7	Yes
Toongabbie	Weekly	52	0	0.3	<0.1	0.3	Yes
Trafalgar	Weekly	52	0	0.2	<0.1	0.1	Yes
Traralgon	Weekly	53	0	1.2	<0.1	0.5	Yes
Traralgon South & Hazelwood North	Weekly	52	0	0.3	<0.1	0.2	Yes
Tyers & Glengarry	Weekly	53	0	1.0	<0.1	0.4	Yes
Warragul	Weekly	52	0	0.3	<0.1	0.2	Yes
Warragul South	Weekly	52	0	0.2	0.1	0.2	Yes
Willow Grove	Weekly	52	0	0.3	<0.1	0.2	Yes
Yallourn North	Weekly	52	0	1.4	<0.1	0.2	Yes
Yarragon	Weekly	52	0	0.1	<0.1	0.1	Yes
Yinnar	Weekly	52	0	0.4	0.1	0.4	Yes

*For calculation purposes, all results reported as <0.1 NTU were rounded to 0.1 NTU

8.5.2 Actions taken in relation to non-compliance

All localities complied with this water quality parameter.

8.6 FLUORIDE

Fluoride testing has been performed in the water supply systems where fluoride is added to the water (supplies of Maffra, Warragul, Sale, Traralgon, Morwell and Moe).

Gippsland Water has sampled localities on a weekly basis even though some of the localities listed in table 11 require monthly samples according to section 5.1.4 of the Code of Practice for Fluoridation of Drinking Water Supplies (i.e. if a fluoride plant supplies five or more water sampling localities then the authority must take a sample each month from a water sampling point in each water sampling locality supplied from those plant such that a sample is collected from the distribution system at least once per week).

8.6.1 Fluoride results

Based on health considerations, no single sample concentration of fluoride in drinking water should exceed 1.5 mg/L, and the average level of fluoride should not exceed 1.0 mg/L. All Gippsland Water sites achieved 100% compliance with this standard for the 2015-16 reporting period.

The obligation target is defined as the annual average concentration of fluoride being greater than 0.6 mg/L, excluding when dosing did not occur. A number of sites failed to achieve this target due to significant maintenance activities during the reporting period where the dosing systems were inactive. These are discussed in detail below.

Table 15: Fluoride results for all fluoridated localities in 2015-16

Treatment Plant	Locality	Frequency of Sampling	Actual No. of Samples	Operating Target	Max (mg/L)	Min (mg/L)	Overall Average ¹ (mg/L)	Operating Average ² (mg/L)	Comply ³ (Yes / No)	Meeting Obligations ⁴ (Yes/No)
Maffra*	Boisdale	Weekly	52	0.9	<0.05	<0.05	<0.05	N/A	Yes	No
	Maffra	Weekly	52	0.9	<0.05	<0.05	0.05	N/A	Yes	No
	Stratford	Weekly	52	0.9	<0.05	<0.05	<0.05	N/A	Yes	No
Morwell	Churchill	Monthly	52	0.9	0.97	<0.05	0.68	0.85	Yes	Yes
	Boolarra	Monthly	53	0.9	0.94	<0.05	0.64	0.84	Yes	Yes
	Jumbuk	Monthly	52	0.9	0.99	<0.05	0.67	0.87	Yes	Yes
	Morwell	Weekly	53	0.9	0.96	<0.05	0.72	0.90	Yes	Yes
	Traralgon South/ Hazelwood North	Monthly	52	0.9	0.97	<0.05	0.71	0.89	Yes	Yes
	Yinnar	Monthly	52	0.9	0.95	<0.05	0.68	0.86	Yes	Yes
Moe ⁵	Moe	Weekly	52	0.9	0.89	<0.05	0.60	0.67	Yes	Yes
	Newborough	Monthly	52	0.9	0.89	<0.05	0.62	0.68	Yes	Yes
	Trafalgar	Monthly	52	0.9	0.90	<0.05	0.60	0.67	Yes	Yes
	Yallourn North	Monthly	53	0.9	0.85	<0.05	0.62	0.65	Yes	Yes
	Thorpdale ⁶	Monthly	13	0.9	0.87	<0.05	0.75	0.76	Yes	Yes
	Yarragon	Monthly	52	0.9	0.89	<0.05	0.60	0.66	Yes	Yes
Sale	Sale/Wurruk	Weekly	52	0.9	1.10	<0.05	0.67	0.95	Yes	Yes
Traralgon*	Traralgon	Weekly	53	0.9	<0.05	<0.05	<0.05	N/A	Yes	No
Warragul	Drouin	Weekly	52	0.9	0.92	<0.05	0.51	0.68	Yes	Yes
	Rokeby/Buln Buln	Weekly	52	0.9	0.88	<0.05	0.51	0.68	Yes	Yes
	Warragul	Weekly	52	0.9	0.89	<0.05	0.50	0.67	Yes	Yes
	Warragul South	Weekly	52	0.9	0.76	<0.05	0.46	0.63	Yes	Yes

1 = The average value calculated based on all monitoring conducted over the 2015-16 reporting period, including the when dosing did not occur.

2 = The average calculated excluding the times where dosing did not occur.

3 = Complying is defined as any sample not exceeding 1.5 mg/L, or the 12-month rolling average not exceeding 1.0 mg/L.

4 = Meeting Obligation is defined as the annual average concentration of fluoride was greater than 0.6 mg/L excluding when dosing did not occur

5 = Fluoride dosing at the Moe Water Treatment plant recommenced on 18th November 2014 and continued for the remainder of the reporting period.

6 = Water Carting to Thorpdale from the Moe System (Trafalgar) commenced during the reporting period (September 2015)

* = Dosing did not occur during the reporting period.

8.6.2 Actions taken in relation to non-compliance

All systems achieved compliance against the standard (no single sample concentration of fluoride in drinking water should exceed 1.5 mg/L, and the average level of fluoride should not exceed 1.0 mg/L).

Systems supplied by the Traralgon and Maffra Fluoridation plants did not achieve an overall obligation target of 0.6 mg/L for the reporting period. This was due to the systems being turned off for maintenance when fluoride concentrations dropped below 0.2 mg/L.

8.6.3 Localities which did not receive fluoridated water as a result of treatment plant issues and upgrades

The Gippsland Water fluoride dosing systems upgrade program continued during the 2015-16 year. Gippsland Water is upgrading the fluoride systems from a dissolvable PVA bag process to a fully enclosed delivery system to improve health and safety associated with the handling of sodium fluoride powder.

- Traralgon

The fluoride dosing system at the Traralgon water treatment plant was turned off for the duration of the reporting period.

This was due to safety concerns raised through the use of dissolvable PVA bags containing the sodium fluoride. Issues occurred where the bags were not dissolving fully, with residual bag material entering the dosing pumps and causing blockages. To reduce exposure due to the continual need to clean and maintain the system, the decision was made to turn the system off whilst investigation into an appropriate solution could be found and implemented. A new fluorosafe system has been installed and recommissioned on 28th June 2016.

- Maffra

The fluoride dosing system at the Maffra water treatment plant was turned off for the duration of the reporting period.

This was due to issues of supply and containers of the fluorosilicic acid (FSA). Options regarding the continued use of FSA at this site were assessed, with a final decision to upgrade the site to the new fluorosafe system being taken. It is anticipated that this project will be completed by 30th September 2016.

In line with the Fluoride Code of Practice, an independent technical assessment prior to commissioning has been undertaken and corrective actions implemented. This process has been undertaken in conjunction with, and coordinated by, the Department of Health and Human Services.

- Warragul

The fluoride dosing system at the Warragul water treatment plant was operational during the reporting period. The system was recommissioned in September 2015.

Systems upgrades were undertaken due to safety concerns raised through the use of dissolvable PVA bags containing the sodium fluoride. Issues occurred where the bags were not fully dissolving, with residual bag material entering the dosing pumps and causing blockages. To reduce exposure due to the continual need to clean and maintain the system, the decision was made to install a new fluorosafe system.

- Sale

Major upgrade works on the Sale Water Treatment Plant were undertaken during the reporting period, including the fluoride dosing system. As a result of this, the dosing system was not operational between 1st July and 21st October 2015.

- Morwell

The fluoride dosing system at the Morwell water treatment plant was turned off during maintenance works between 1st July to 10th September 2015.

- Moe

The fluoride dosing system at the Moe water treatment plant was upgraded in 2014, with the system being recommissioned in November 2014. The Fluoride system was independently audited by the Department of Health and Human Services 3rd Party Auditor for compliance against the Fluoride Code of Practice. The recommendations of this report either have been or are currently being implemented.

8.7 WATER TREATMENT PROJECTS & PROGRAMS UNDERTAKEN

During the 2015-16 reporting period Gippsland Water undertook a number of works, programs or projects to ensure that continual improvements were made to ensure the ongoing provision of safe drinking water to its customers. These included:

- Treated water storage basins and tank condition assessment undertaken as part of the ongoing inspection, maintenance and cleaning program
- Ongoing water treatment plant filter upgrades and refurbishment program
- Installation and upgrades of remote disinfection sites
- Ongoing implementation of water reticulation mains air scouring program
- Ongoing replacement and upgrade of water quality on-line and field instrumentation

Figure 5:-Tyers Water Supply Locality Project



Water treatment plant chlorination system and controls system upgrade project for improved water treatment plant process control management.

Figure 6:-Mirboo North Water Supply Locality Project

Water treatment plant upgrade to cover media filter for water quality microbiological management and occupational health and safety compliance



Figure 7:-Heyfield Water Supply Locality Project



Water treatment plant office and laboratory upgrade project for improved water quality and water treatment plant management.



Figure 8:- Fluoride Saturator Upgrade Project

Water treatment plant fluoride saturator upgrades at Traralgon, Moe, Morwell, Sale, Warragul and Maffra. The upgrades replace the Hydrofluorosilicic Acid system at Maffra and dissolved PVA bags at all other sites. The new systems incorporate a bottle with a foil sealed outlet for improved handling safety and use a sealed handling/cutting/rinsing arrangement. The system also includes a timed washing system to ensure the fluoride delivery system is fully closed. An independent audit of the Moe system was undertaken for compliance against the Code of Practice for Fluoridation of Drinking Water Supplies 2009. Gippsland Water developed an action plan and has addressed the opportunities for improvement during the 2016-17 reporting period.

Thorpdale Water Supply System Augmentation Upgrade Project

In September 2015 Gippsland Water made the decision to cease producing water at the Thorpdale WTP and cart water from the Moe water supply system due to;

1. high iron and manganese concentrations exceeding ADWG levels in the Thorpdale raw water supply; and
2. the inability of the current plant configuration to cope with this;
3. an increased exposure to health risks associated with producing water from the Thorpdale water treatment plant due to its age, condition and current controls configuration .

The decision was made that into the foreseeable future, potable water to Thorpdale will be provided via a trucking arrangement utilising potable water supplied from the Moe WTP (via Trafalgar). This arrangement is intended to remain in place until the final engineering solution for provision of the future water supply to Thorpdale is determined and implemented. A workshop held internally recently has identified the final engineering solution for provision of the future water supply to Thorpdale is still some years away.

The potable water sourced from the Moe WTP is fluoridated, and consequently as a result of this decision, fluoridated potable water will be supplied to the community of Thorpdale for the foreseeable future.

Figure 9:– Water Supply System Augmentation Upgrade Projects



Minor upgrade works across multiple sites that included replacement of high lift pumps to transfer treated water from water treatment plant to system storages, upgrades of diesel generator points at all Water Treatment Plants for alternative emergency power supply, installation of chemical bund enclosures and removal of identified



Figure 10:– Heyfield Supply System Upgrade Projects



Installation of floating '**Aqua Armour**' modules and containment booming to cover the remaining exposed area of the Heyfield raw water basin to achieve 80% cover at 80% water depth for improved algae management and reduced evaporation in the Heyfield Water Treatment Plant off stream raw water storage.



8.8 OTHER ALGAE, PATHOGEN, CHEMICAL OR SUBSTANCE NOT SPECIFIED THAT MAY POSE A RISK TO HUMAN HEALTH

8.8.1 Overall results

During the reporting period, the corporation monitored for the following health-related aspects of the drinking water supplied to customer taps. Table 13 lists the parameters and the frequency of samples taken across all localities, comparing the results to the ADWG and the health-based guideline value.

Table 16: Other sampled parameter results for all localities in 2015-16

Parameter	Frequency of sampling	No. samples	Maximum Value Recorded for All Localities (mg/L)	Results According to ADWG guideline values			
				Health Based Guideline value (mg/L)	Result	Locality	
Nitrite	Weekly*/6 Monthly	261	0.40	≤ 3	All results below ADWG health guideline values		
Mercury	Quarterly	140	<0.0001	≤ 0.001			
Chromium	Quarterly	140	<0.001	≤ 0.05			
Cadmium	Quarterly	140	<0.0002	≤ 0.002			
Nitrate	Weekly*/Quarterly	140	1.4	≤ 50			
Nickel	Annually	35	0.004	≤ 0.02			
Arsenic	Annually/Quarterly	35	<0.001	≤ 0.01			
Cyanide	Annually	35	<0.005	≤ 0.08			
Selenium	Annually/Quarterly	105	<0.001	≤ 0.01			
Beryllium	Annually/6 Monthly	66	<0.01	≤ 0.06			
Chloryl Hydrate	Monthly	420	0.02	≤ 0.1			
2, 4-Dichlorophenoxy acetic acid	Monthly	420	<0.01	≤ 0.03			
Nitrosodimethylamine	Monthly**	24**	0.000008	≤ 0.0001			
2,4,6-Trichlorophenol	Monthly***	416	<0.001	≤ 0.02			
2,4-Dichlorophenol	Monthly***	416	<0.001	≤ 0.2			
2- Chlorophenol	Monthly***	416	<0.001	≤ 0.3			
Pentachlorophenol	Monthly	420	<0.001	≤ 0.01			
Parameter	Frequency of sampling	No. samples	Maximum Value Recorded for All Localities (mg/L)	Aesthetic Based Guideline value (mg/L)			
Chloride	Annually/Quarterly	105	140	≤250			
Zinc	Annually	35	0.025	≤3			
Hardness (CaCO ₃)	Annually/Quarterly	105	130	≤200			
Total Dissolved Solids	Annually/Quarterly	105	360	≤600			
Silica	Annually/Quarterly	105	15	≤80			
Sulphate	Annually/Quarterly	105	45	≤250			

*- Weekly monitoring undertaken on Chloraminated systems

** - Monthly monitoring undertaken on Chloraminated systems

***- Frequency Increased from Quarterly to monthly during reporting period

Monitoring for other parameters such as radiological, pesticides, protozoan organisms is conducted routinely. A complete list of raw water parameters monitored is contained in Appendix 1. Additional monitoring is performed on a risk basis and as the need arises.

The following table contains Blue Green Algae (BGA) monitoring undertaken across Gippsland Water storages based on visual and water quality triggers. Major raw water supply/storages are routinely monitored for BGA as part of the routine catchment monitoring program.

For water storages not managed by Gippsland Water, the Water Storage Manager (Melbourne Water – Tarago, Southern Rural Water – Blue Rock & Lake Glenmaggie) undertakes monitoring and advised Gippsland Water of the results in accordance with their respective Algae Management Plans.

Table 17: Routine BGA monitoring for raw water supplies in 2015-16

Location	Jul '15	Aug '15	Sept '15	Oct '15	Nov '15	Dec '15	Jan '16	Feb '16	Mar '16	Apr '16	May '16	Jun '16
Maffra Weir							1	1	1	1	1	1
Heyfield Raw Water Storage	1	1	1	1	1	1	2	2	2	2	2	2
Thorpdale Raw Water Storage							1	1	1	1	1	1
Neerim South Tarago Reservoir							1	1	1	1	1	1
Rawson Amours Basin							1	1	1	1	1	1
Seaspray Raw Water Storage	1	1	1	1	1	1	2	2	2	2	2	2
Blue Rock Lake (Southern Rural Water BGA Program)	1	1	1	2	2	2	2	2	2	1	1	1
Lake Glenmaggie (Southern Rural Water BGA Program)	1	1	1	2	2	2	2	2	2	1	1	1
Tarago Reservoir (Melbourne Water BGA Program)	1	1	1	1	1	2	2	2	2	2	1	1
Moondarra Surface	1	1	1	1	1	1	1	1	1	1	1	1
Moondarra Pipe line	1						1	1	1	1	1	1
Moondarra Upper reaches	<i>As required</i>											

During the reporting period, there was one Blue Green Algae or algal blooms of concern at the Heyfield water treatment plant off stream raw water storage.

An alternate source was available during this period whilst algal monitoring was undertaken during this period. Notification as the local storage manager occurred through Department of Environment, Land, Water and Planning (DELWP) portal as required under the DELWP Blue Green Algae Circular 2015-16

Testing of the algal bloom was undertaken, with the results indicating that the species was not producing toxins. The raw water storage basin was partially drained by storage irrigation to surrounding farmland with neighbour permission, including the implementation of exclusion/withholding period for stock. Once the algal bloom finished and algal cell numbers returned below the DELWP Blue Green Algae Circular 2015-16 limits, the Heyfield off stream raw water storage was refilled and returned to service.

8.8.2 Manganese

Manganese can be naturally present in either soluble or insoluble forms in water. When concentrations exceed the aesthetic guideline of 0.1 mg/L, manganese can create unacceptable tastes in water, as well as stain fixtures and laundry. The ADWG guideline value is measured against the health guideline value of 0.5 mg/L in ADWG. Gippsland Water sites achieved 100% manganese ADWG guideline value.

Table 18: Manganese results for all localities in 2015-16

Locality	Frequency of Sampling	No. of Samples	Max (mg/L)	Min (mg/L)	ADWG Guideline Value (Yes/No)
Boisdale	Monthly	12	0.001	<0.001	Yes
Boolarra	Monthly	12	<0.001	<0.001	Yes
Briagolong	Monthly	12	0.005	<0.001	Yes
Churchill	Monthly	12	<0.001	<0.001	Yes
Coongulla & Glenmaggie	Monthly	12	0.001	<0.001	Yes
Cowwarr	Monthly	12	0.002	<0.001	Yes
Drouin	Monthly	12	0.002	<0.001	Yes
Erica	Monthly	12	0.011	0.004	Yes
Heyfield	Monthly	12	0.009	0.002	Yes
Jumbuk	Monthly	12	<0.001	<0.001	Yes
Maffra	Monthly	12	0.003	<0.001	Yes
Mirboo North	Monthly	12	0.003	<0.001	Yes
Moe	Monthly	12	0.005	<0.001	Yes
Morwell	Monthly	12	0.003	<0.001	Yes
Neerim South	Monthly	12	0.016	0.007	Yes
Newborough	Monthly	12	0.001	<0.001	Yes
Noojee	Monthly	12	0.025	0.006	Yes
Rawson	Monthly	12	0.019	0.004	Yes
Rokeyby & Buln Buln	Monthly	12	0.009	<0.001	Yes
Rosedale	Monthly	12	0.002	<0.001	Yes
Sale/Wurruk	Monthly	12	0.002	0.001	Yes
Seaspray	Monthly	12	0.019	0.008	Yes
Stratford	Monthly	12	0.003	<0.001	Yes
Thorpdale	Monthly	12	0.038	<0.001	Yes
Toongabbie	Monthly	12	0.001	<0.001	Yes
Trafalgar	Monthly	12	0.002	<0.001	Yes
Traralgon	Monthly	12	0.001	<0.001	Yes
Traralgon South & Hazelwood North	Monthly	12	0.002	<0.001	Yes
Tyers & Glengarry	Monthly	12	0.004	<0.001	Yes
Warragul	Monthly	12	0.003	<0.001	Yes
Warragul South	Monthly	12	0.001	<0.001	Yes
Willow Grove	Monthly	12	0.010	0.001	Yes
Yallourn North	Monthly	12	<0.001	<0.001	Yes
Yarragon	Monthly	12	<0.001	<0.001	Yes
Yinnar	Monthly	12	<0.001	<0.001	Yes

8.8.3 Actions taken in relation to non-compliance

All localities complied with this water quality parameter.

8.8.4 Lead

Lead can be present in drinking water as a result of dissolution from natural sources or from household plumbing. Based on health considerations in the ADWG guidelines, concentrations of lead in drinking water should not exceed 0.01 mg/L. Gippsland Water sites achieved 100% ADWG guideline value against lead guideline values for all customer tap sites.

Table 19: Lead results for all localities in 2015-16

Locality	Frequency of Sampling	No. of Samples	Max (mg/L)	Min (mg/L)	ADWG Guideline Value (Yes/No)
Boisdale	Quarterly	4	<0.001	<0.001	Yes
Boolarra	Quarterly	4	<0.001	<0.001	Yes
Briagolong	Quarterly	4	0.002	<0.001	Yes
Churchill	Quarterly	4	<0.001	<0.001	Yes
Coongulla & Glenmaggie	Quarterly	4	<0.001	<0.001	Yes
Cowwarr	Quarterly	4	<0.001	<0.001	Yes
Drouin	Quarterly	4	<0.001	<0.001	Yes
Erica	Quarterly	4	0.003	<0.001	Yes
Heyfield	Quarterly	4	<0.001	<0.001	Yes
Jumbuk	Quarterly	4	<0.001	<0.001	Yes
Maffra	Quarterly	4	0.001	<0.001	Yes
Mirboo North	Quarterly	4	<0.001	<0.001	Yes
Moe	Quarterly	4	<0.001	<0.001	Yes
Morwell	Quarterly	4	0.002	<0.001	Yes
Neerim South	Quarterly	4	<0.001	<0.001	Yes
Newborough	Quarterly	4	<0.001	<0.001	Yes
Noojee	Quarterly	4	<0.001	<0.001	Yes
Rawson	Quarterly	4	<0.001	<0.001	Yes
Rokeby & Buln Buln	Quarterly	4	<0.001	<0.001	Yes
Rosedale	Quarterly	4	<0.001	<0.001	Yes
Sale/Wurruk	Quarterly	4	<0.001	<0.001	Yes
Seaspray	Quarterly	4	<0.001	<0.001	Yes
Stratford	Quarterly	4	<0.001	<0.001	Yes
Thorpdale	Quarterly	4	<0.001	<0.001	Yes
Toongabbie	Quarterly	4	<0.001	<0.001	Yes
Trafalgar	Quarterly	4	<0.001	<0.001	Yes
Traralgon	Quarterly	4	<0.001	<0.001	Yes
Traralgon South & Hazelwood North	Quarterly	4	<0.001	<0.001	Yes
Tyers & Glengarry	Quarterly	4	<0.001	<0.001	Yes
Warragul	Quarterly	4	<0.001	<0.001	Yes
Warragul South	Quarterly	4	<0.001	<0.001	Yes
Willow Grove	Quarterly	4	<0.001	<0.001	Yes
Yallourn North	Quarterly	4	<0.001	<0.001	Yes
Yarragon	Quarterly	4	<0.001	<0.001	Yes
Yinnar	Quarterly	4	<0.001	<0.001	Yes

8.8.5 Actions taken in relation to non-compliance

All localities complied with this water quality parameter.

8.8.6 Copper

Copper is present in raw water supplies at very low concentrations. Copper can be found in higher concentrations in drinking water as a result of corrosion of copper pipes and fittings. Based on health considerations in the ADWG guideline, concentrations of copper in drinking water should not exceed 2 mg/L. The aesthetic guideline value is 1 mg/L. Gippsland Water sites achieved 100% ADWG guideline value against both copper guideline values.

Table 20: Copper results for all localities in 2015-16

Locality	Frequency of Sampling	No. of Samples	Max (mg/L)	Min (mg/L)	ADWG Guideline Value (Yes/No)
Boisdale	Quarterly	4	0.009	0.004	Yes
Boolarra	Quarterly	4	0.004	<0.001	Yes
Briagolong	Quarterly	4	0.010	0.003	Yes
Churchill	Quarterly	4	0.007	0.004	Yes
Coongulla & Glenmaggie	Quarterly	4	0.003	<0.001	Yes
Cowwarr	Quarterly	4	0.040	<0.001	Yes
Drouin	Quarterly	4	0.014	0.003	Yes
Erica	Quarterly	4	0.14	0.005	Yes
Heyfield	Quarterly	4	0.059	0.011	Yes
Jumbuk	Quarterly	4	0.011	0.004	Yes
Maffra	Quarterly	4	0.10	0.005	Yes
Mirboo North	Quarterly	4	0.022	0.008	Yes
Moe	Quarterly	4	0.014	0.004	Yes
Morwell	Quarterly	4	0.030	0.003	Yes
Neerim South	Quarterly	4	0.043	0.013	Yes
Newborough	Quarterly	4	0.011	0.003	Yes
Noojee	Quarterly	4	0.019	0.013	Yes
Rawson	Quarterly	4	0.038	<0.001	Yes
Rokeby & Buln Buln	Quarterly	4	0.007	0.002	Yes
Rosedale	Quarterly	4	0.054	0.001	Yes
Sale-Wurruk	Quarterly	4	0.003	<0.001	Yes
Seaspray	Quarterly	4	0.029	0.011	Yes
Stratford	Quarterly	4	0.023	<0.001	Yes
Thorpdale	Quarterly	4	0.008	<0.001	Yes
Toongabbie	Quarterly	4	0.025	0.011	Yes
Trafalgar	Quarterly	4	0.004	<0.001	Yes
Traralgon	Quarterly	4	0.004	0.001	Yes
Traralgon South & Hazelwood North	Quarterly	4	0.004	<0.001	Yes
Tyers & Glengarry	Quarterly	4	0.026	0.005	Yes
Warragul	Quarterly	4	0.007	<0.001	Yes
Warragul South	Quarterly	4	0.009	0.001	Yes
Willow Grove	Quarterly	4	0.057	0.019	Yes
Yallourn North	Quarterly	4	0.005	0.002	Yes
Yarragon	Quarterly	4	0.001	<0.001	Yes
Yinnar	Quarterly	4	0.019	<0.001	Yes

8.8.7 Actions taken in relation to non-compliance

All localities complied with this water quality parameter.

8.9 AESTHETICS

8.9.1 pH results

In addition to the monitoring of parameters to determine compliance against the SDWA regulations, pH is routinely monitored in the reticulation system. The ADWG guidelines suggest that the drinking water be between pH 6.5 and pH 8.5. The pH results for all towns are provided below.

Table 21: pH results for all localities in 2015-16

Locality	Frequency of Sampling	No. of Samples	Max (units)	Min (units)	Average (units)
Boisdale	Weekly	52	7.9	7.5	7.7
Boolarra	Weekly	53	8.2	7.2	7.6
Briagolong	Weekly	52	7.3	6.8	7.1
Churchill	Weekly	52	8.1	7.0	7.4
Coongulla & Glenmaggie	Weekly	53	9.0	7.5	8.2
Cowwarr	Weekly	52	8.5	6.9	7.6
Drouin	Weekly	52	8.2	6.8	7.3
Erica	Weekly	52	8.2	6.6	7.4
Heyfield	Weekly	53	7.6	6.8	7.2
Jumbuk	Weekly	52	7.7	7.2	7.4
Maffra	Weekly	52	7.6	6.9	7.2
Mirboo North	Weekly	53	7.6	7.1	7.3
Moe	Weekly	52	7.9	6.8	7.2
Morwell	Weekly	53	7.6	6.9	7.2
Neerim South	Weekly	52	7.4	6.9	7.1
Newborough	Weekly	52	7.8	7.0	7.3
Noojee	Weekly	52	9.2	7.2	7.7
Rawson	Weekly	52	7.7	7.0	7.2
Rokeby & Buln Buln	Weekly	52	8.3	6.8	7.3
Rosedale	Weekly	53	8.9	6.6	7.9
Sale/Wurruk	Weekly	52	8.9	7.7	8.0
Seaspray	Weekly	52	7.6	6.8	7.2
Stratford	Weekly	52	7.7	7.2	7.4
Thorpdale	Weekly	53	9.0	6.8	7.9
Toongabbie	Weekly	52	7.5	7.1	7.3
Trafalgar	Weekly	52	7.5	7.1	7.3
Traralgon	Weekly	53	7.4	6.9	7.1
Traralgon South & Hazelwood North	Weekly	52	9.2	7.1	7.4
Tyers & Glengarry	Weekly	53	7.5	7.0	7.2
Warragul	Weekly	53	8.5	6.7	7.3
Warragul South	Weekly	52	8.5	7.0	7.6
Willow Grove	Weekly	52	7.4	7.1	7.3
Yallourn North	Weekly	53	7.8	7.1	7.3
Yarragon	Weekly	52	9.1	7.6	8.3
Yinnar	Weekly	52	8.4	7.1	7.5

8.9.2 Actions taken in relation to non-compliance

Some systems have experienced elevated pH results, as a result of long residence of water in the reticulation, cement-lined pipes in parts of the reticulation and reduced flushing programs due to the permanent water saving rules in place. All average pH results were within the range of 6.5 to 8.5.

ADWG states that cement mortar lined pipes can significantly increase the pH and a value up to 9.2 may be tolerated provided monitoring indicates no deterioration in the microbiological quality.

8.9.3 Iron results

Iron can become apparent in taste in water at about 0.3 mg/L and above. High concentrations can give water a rust-brown appearance and cause staining of laundry and plumbing fittings. Based on aesthetic considerations the concentration in the ADWG guidelines of iron in drinking water should not exceed 0.3 mg/L however no health-based guideline value has been set for iron. All sites except Seaspray and Heyfield achieved 100% ADWG guideline value against the aesthetic iron guideline value.

Table 22: Iron results for all localities in 2015-16

Locality	Frequency of Sampling	No. of Samples	Max (mg/L)	Min (mg/L)	Complying (Yes/No)
Boisdale	Monthly	12	0.01	<0.01	Yes
Boolarra	Monthly	12	0.08	0.03	Yes
Briagolong	Monthly	12	0.01	<0.01	Yes
Churchill	Monthly	12	0.02	<0.01	Yes
Coongulla & Glenmaggie	Monthly	12	0.04	<0.01	Yes
Cowwarr	Monthly	12	<0.01	<0.01	Yes
Drouin	Monthly	12	0.01	<0.01	Yes
Erica	Monthly	12	0.17	0.01	Yes
Heyfield	Monthly	12	0.40	<0.01	No
Jumbuk	Monthly	12	0.08	<0.01	Yes
Maffra	Monthly	12	<0.01	<0.01	Yes
Mirboo North	Monthly	12	0.01	<0.01	Yes
Moe	Monthly	12	0.03	<0.01	Yes
Morwell	Monthly	12	0.03	<0.01	Yes
Neerim South	Monthly	12	0.04	<0.01	Yes
Newborough	Monthly	12	<0.01	<0.01	Yes
Noojee	Monthly	12	0.09	0.02	Yes
Rawson	Monthly	12	0.13	0.02	Yes
Rokeyby & Buln Buln	Monthly	12	0.02	<0.01	Yes
Rosedale	Monthly	12	0.10	<0.01	Yes
Sale/Wurruk	Monthly	12	0.02	<0.01	Yes
Seaspray	Monthly	12	0.53	0.02	No
Stratford	Monthly	12	0.03	<0.01	Yes
Thorpdale	Monthly	12	0.06	0.01	Yes
Toongabbie	Monthly	12	<0.01	<0.01	Yes
Trafalgar	Monthly	12	<0.01	<0.01	Yes
Traralgon	Monthly	12	0.02	<0.01	Yes
Traralgon South & Hazelwood North	Monthly	12	0.05	<0.01	Yes
Tyers & Glengarry	Monthly	12	0.01	<0.01	Yes
Warragul	Monthly	12	0.02	<0.01	Yes
Warragul South	Monthly	12	0.03	<0.01	Yes
Willow Grove	Monthly	12	0.02	<0.01	Yes
Yallourn North	Monthly	12	0.12	<0.01	Yes
Yarragon	Monthly	12	<0.01	<0.01	Yes
Yinnar	Monthly	12	0.10	<0.01	Yes

8.9.4 Actions taken in relation to non-compliance

For the Seaspray reticulation, cleaning of the system to remove built up sediment by air scouring was undertaken in November 2015.

For the Heyfield reticulation, cleaning of the system to remove built up sediment by air scouring is scheduled to occur in September 2016.

8.10 ANALYSIS OF RESULTS

Comparison to previous years

The water quality standards required under the SDWR have been represented as trend data over three financial years. This information allows for a comparison of data for the major towns.

An analysis by the percentage of water sampling localities where the drinking water complied with each of health based parameter, over three reporting periods, is shown below. The table also shows an analysis of the percentage of customers supplied with drinking water that complied with the standards.

Table 23: Compliance by locality and population

Parameter	Percentage by Locality			Percentage by Population		
	2013-2014	2014-2015	2015-2016	2013-2014	2014-2015	2015-2016
Aluminum	97.1%	100%	100%	99.8%	100%	100%
Chloroacetic Acid	100%	100%	100%	100%	100%	100%
Dichloroacetic Acid	100%	100%	100%	100%	100%	100%
<i>E. coli</i>	100%	100%	97.1%	100%	100%	88.5%
Trichloroacetic Acid	100%	100%	100%	100%	100%	100%
Trihalomethanes	100%	100%	100%	100%	100%	100%
Turbidity	100%	100%	100%	100%	100%	100%
Nitrite	100%	100%	100%	100%	100%	100%
Nitrate	100%	100%	100%	100%	100%	100%
Fluoride	100%	100%	100%	100%	100%	100%
Mercury	100%	100%	100%	100%	100%	100%
Chromium	100%	100%	100%	100%	100%	100%
Cadmium	100%	100%	100%	100%	100%	100%
Nickel	100%	100%	100%	100%	100%	100%
Arsenic	100%	100%	100%	100%	100%	100%
Selenium	100%	100%	100%	100%	100%	100%
Beryllium	100%	100%	100%	100%	100%	100%
Copper	100%	100%	100%	100%	100%	100%
Barium	100%	100%	100%	100%	100%	100%
Lead	97.1%	100%	100%	99.9%	100%	100%
Manganese	100%	100%	100%	100%	100%	100%
Cyanide	100%	100%	100%	100%	100%	100%
Selenium	100%	100%	100%	100%	100%	100%
Molybdenum	100%	100%	100%	100%	100%	100%
Acrylamide	100%	100%	100%	100%	100%	100%
Boron	100%	100%	100%	100%	100%	100%
Chloryl Hydrate	100%	100%	100%	100%	100%	100%
2, 4-Dichlorophenoxy acetic acid	100%	100%	100%	100%	100%	100%
Nitrosodimethylamine	100%	100%	100%	100%	100%	100%
2,4,6-Trichlorophenol	100%	100%	100%	100%	100%	100%
2,4-Dichlorophenol	100%	100%	100%	100%	100%	100%
2- Chlorophenol	100%	100%	100%	100%	100%	100%
Pentachlorophenol	100%	100%	100%	100%	100%	100%

Results for all listed tests for all localities either maintained or improved compliance during the 2015-16 reporting period, with the exception of *E.coli*, which decreased due to the detection within the Sale locality. Overall compliance was also impacted by the change in Regulations for *E.coli* from 98% to 100%.

This page intentionally left blank

9 UNDERTAKINGS UNDER SECTION 30 OF THE SDWA

Gippsland Water has no undertakings relevant to the 2015-16 reporting year.

10 EXEMPTIONS UNDER SECTION 20 OF THE SDWA

Gippsland Water has no exemptions relevant to the 2015-16 reporting year.

11 VARIATION IN AESTHETIC STANDARDS

Gippsland Water has no variations in aesthetic standards sought under section 19 of the SDWA.

12 REGULATED WATER

Gippsland Water does not manage any regulated water supplies.

13 GLOSSARY OF TERMS

Table 24: Glossary of Terms

ADWG	<i>Australian Drinking Water Guidelines 2011</i> prepared by National Health and Medical Research Council that details a framework for the management of drinking water
DHHS	Department of Health and Human Services
CCP	A physical point in treatment processes that can be controlled either by SCADA, or manually, and has a significant impact on water quality.
Detection limit	The lowest concentration of analytical parameter in the sample that can be detected by the process laboratory.
Drinking Water Supply systems	Towns supplied with water from a common water source (WTP, supply mains and reticulation pipe-work).
<i>E. coli</i>	<i>Escherichia coli</i> .
Locality	Under the SDWR, a specified area that is supplied with drinking water by a water supplier.
mg/L	Milligram per litre.
NTU	Nephelometric Turbidity Units.
Properties	A registered customer connection to the drinking water supply.
RMP	Risk Management Plan
SCADA system	A Supervisory Control And Data Acquisition (SCADA) system consists of human-machine interface, computerised logics, telemetry communication system, electronically actuated instruments and sensors. SCADA allows remote control and monitor of all key process
SDWA	<i>Safe Drinking Water Act 2003</i> Act No.46/2003.
SDWR	Safe Drinking Water Regulations 2005 S.R No.88/2005 Safe Drinking Water Regulations 2015 S.R No.88/2015

Source Water	Raw water supply for town, prior to treatment.
THM	Trihalomethane.
WTP	A facility where raw water is directed through various treatment processes and produces treated water fit for human consumption
100mL	100 millilitres.
<	Less than.
>	Greater than.
≤	Less than or equal to.
≥	Greater than or equal to.

14 FURTHER INFORMATION

Customers and members of the public may access drinking water quality data by contacting Gippsland Water on 1800 066 401 or visiting www.gippswater.com.au.

15 REFERENCES

National Health and Medical Research Council. *Australian Drinking Water Guidelines 2011*.
Web address www.nhmrc.gov.au

Department of Health and Human Services *2015-2016 – Guidance: Water Quality Annual Report (Section 26 Safe Drinking Water Act 2003), July 2016*

Safe Drinking Water Act 2003 No.46/2003

Safe Drinking Water Regulations 2005 S.R No.88/2005

Safe Drinking Water Regulations 2015 S.R No.88/2015

Health (Fluoridation) Act (1973)

Code of Practice for Fluoridation of Drinking Water Supplies *Health (Fluoridation) Act 1973* Department of Human Services (March 2009)

This page intentionally left blank

APPENDIX 1: RAW WATER MONITORING

Locality	Source water	Nature of Other Raw Water Monitoring Programs		
		Weekly/Fortnightly	Monthly	Annual / Quarterly
Morwell Churchill Yinnar Jumbuk Boolarra Traralgon South / Hazelwood North	Moondarra Res via Tyers River	Physicals <ul style="list-style-type: none"> Absorbance (254nm) Colour True (465nm) Dissolved Oxygen SUVA (245nm) Turbidity Electrical Conductivity @25°C pH 	Physicals <ul style="list-style-type: none"> Alkalinity Bicarbonate as CaCO₃ Alkalinity Total as CaCO₃ Dissolved Organic Carbon (DOC) Total Organic Carbon (TOC) Total Dissolved Solids (TDS) SUVA (245nm) Chlorophyll a 	Physicals* <ul style="list-style-type: none"> Total Dissolved Solids (TDS) Suspended Solids Chemical Inorganic <ul style="list-style-type: none"> Cyanide Dissolved Organic Carbon (DOC) Total Organic Carbon (TOC) Bromide Fluoride
Traralgon				
Tyers/Glengarry Rosedale Covwarr Toongabbie				
Maffra	Macalister River	Microbiological <ul style="list-style-type: none"> <i>Escherichia coli</i> Total Coliforms Heterotrophic Plate Count Metals* <ul style="list-style-type: none"> Iron Total Manganese Total Mercury 	Chemical Inorganic <ul style="list-style-type: none"> Ammonia as N Bromide Chloride Fluoride Nitrate as N Nitrite as N Organic Nitrogen as N Phosphorous, Reactive as P Phosphorous Total as N Sulphate Total Kjeldahl Nitrogen as N Total Nitrogen as N 	Metals* <ul style="list-style-type: none"> Aluminium Total Arsenic Total Selenium Cadmium Total Copper Total Lead Total Mercury Zinc Total
Stratford				
Boisdale				
Briagolong	Bore (Freestone Creek Aquifer)	Biological <ul style="list-style-type: none"> Algae Blue Green Algae (sampling frequency may vary depending on the season and results received) 	Radiological <ul style="list-style-type: none"> Gross Alpha Activity Gross Beta Activity 	Microbiological <ul style="list-style-type: none"> <i>Cryptosporidium spp</i> <i>Giardia spp</i>
Warragul (including Nilma, Darnum, Drouin East)	Pederson Weir (Tarago River) Tarago Reservoir - (supplementary supply)			
Warragul South				
Drouin				
Rokeby/Buln Buln				
Coongulla/ Glenmaggie	Macalister River			
Rawson	Trigger Creek			
Erica				

Locality	Source water	Nature of Other Raw Water Monitoring Programs		
		Weekly/Fortnightly	Monthly	Annual / Quarterly
Heyfield	Thomson River			<p><u>Pesticides, Herbicides and Chemical Organics**</u></p> <ul style="list-style-type: none"> • 2,4,5 T (Herbicide) • 2,4,5 TP (Silvex) • 2,4,6- T • 2,4 D • 2,6 D • 2,4 DB • 3-Hydroxy Carbofuran • 4-CPA • Aldrin • Aldicarb • Ametryn • Asulam • Atrazine • Azinphs-ethyl • Azinphos-methyl • Bendiocarb • Benomyl • Bentazon • BHC (alpha) • BHC (beta) • BHC (delta) • Bifenthrin • Brodifacoum • Bromacil • Bromophos-ethyl • Bromoxynil • Carbaryl • Carbofenothon • Carbofuran • Chlordane (cis) • Chlordane (trans) • Chlorfenvinphos • Chloropyrifos • Chloropyrifos - methyl • Chlorsulfuron • Chlorothalonil
Mirboo North	Little Morwell River			
Moe	Tanjil River and Narracan Creek		<p><u>Metals</u></p> <ul style="list-style-type: none"> • Aluminium Total • Arsenic Total • Calcium Total • Cadmium Total • Copper Total • Iron Total • Iron Soluble • Lead Total • Mercury • Potassium • Magnesium • Manganese Total • Manganese Soluble • Selenium • Zinc Total 	
Newborough				
Yallourn North				
Trafalgar				
Yarragon				
Neerim South		Tarago River		
Noojee				
Sale/Wurruk	Bore (Boisdale Aquifer)		<p><u>Chlorophenols (Sale Bores Only)</u></p> <ul style="list-style-type: none"> • 2,3,4,5 Tetrachlorophenol • 2,6-Dichlorophenol • 2-Chlorophenol • 4-Chloro-3-Methylphenol • Total Phenols (Halogenated) • Pentachlorophenol • 2,4,5-Trichlorophenol 	
Seaspray	Merrimans Creek			
Thorpdale	Easterbrook Creek			
Willow Grove	Tanjil River			

Locality	Source water	Nature of Other Raw Water Monitoring Programs		
		Weekly/Fortnightly	Monthly	Annual / Quarterly
				<ul style="list-style-type: none"> • Chlopyralid • Coumaphos • Cynazine • Cyfluthrin • Cypermethrin • Cyprodinil • Cyproconazole • Cyromazine • 4,4-DDD • 4,4-DDE • 4,4-DDT • Deltamethrin & Tralomethrin • Demeton-O • Demeton-S • Demeton-S-methyl • Diazinon • Dicamba • Dichlorprop • Dichlorvos • Deildrin • Dinoseb • Dicofop-methyl • Difenconazole • Diflufenican • Dimethoate • Diquat • Disulfoton • Diuron • Endosulfan (alpha) • Endosulfan (beta) • Endosulfan Sulphate • Eldrin • Eldrin aldehyde • Endrin Ketone • ENP • Ethion • Ethoprophos • Fenamiphos

Locality	Source water	Nature of Other Raw Water Monitoring Programs		
		Weekly/Fortnightly	Monthly	Annual / Quarterly
				<ul style="list-style-type: none"> • Fenarimol • Fenchlorphos (Ronnel) • Fenitrothion • Fensulfothion • Fenthion • Fenvalerate & Esfenvalerate • Fiprinol • Fluroxypyr • Fluometuron • Flusilazole • Fluvalinate • Glyphosate • Heptachlor • Heptachlor Epoxide • Hexachlorobenzene • Haxazinone • Hexaconazole • Iprodione • Irgarol • Lindane • Malathion • MCPA • MCPB • Mecoprop • Methidathion • Metolachlor • Methiocarb • Methomyl • Methoxychlor • Metribuzin • Mevinphos • Molinate • Monocrotophos • Omethoate • Oryzalin • Oxamyl • Oxychlordan • Oxyfluorfen

Locality	Source water	Nature of Other Raw Water Monitoring Programs		
		Weekly/Fortnightly	Monthly	Annual / Quarterly
				<ul style="list-style-type: none"> • Paclobutrazole • Paraquat • Parathion (methyl & ethyl) • Penconazole • Pendimethalin • Permethrin • Phorate • Picloram • Pirimiphos-ethyl • Pirimiphos-methyl • Profenofos • Prometon • Prometryn • Propachlor • Propazine • Prophos • Propiconazole • Prothiofos • Pyrimethanil • Simazine • Simetryn • Sulfotep • Sulprofos • Tebuconazole • Temephos • Terbutylazine • Terbufos • Tebuthiuron • Terbutryn • Tetrachlovinphos • Tetraethylthiopyrphos • Thiamethoxam • Thiobencarb • Thiodicarb • Triazophos • Trichlorfon • Trichloronate • Triclopyr

Locality	Source water	Nature of Other Raw Water Monitoring Programs		
		Weekly/Fortnightly	Monthly	Annual / Quarterly
				<ul style="list-style-type: none"> • Trifluralin • Tukuthion

*Reduced frequency of monitoring in some catchments based on risk profile

** Note all Pesticides, Herbicides and Chemical Organics results were within ADWG guideline values

Not all parameters were measured at all localities or source waters.

Purpose of Monitoring - Risk Management within Catchment and Raw Water Supply Systems

Comprehensiveness (Frequency) – Weekly, Fortnightly, Monthly, Quarterly and Annual Monitoring or as Risks Identified



GIPPSLAND
WATER

Gippsland Water

Hazelwood Road
PO BOX 348
Traralgon VIC 3844

General enquiries **1800 050 500**
Faults and emergencies **1800 057 057**

www.gippswater.com.au

contactus@gippswater.com.au

ABN 75 830 750 413
