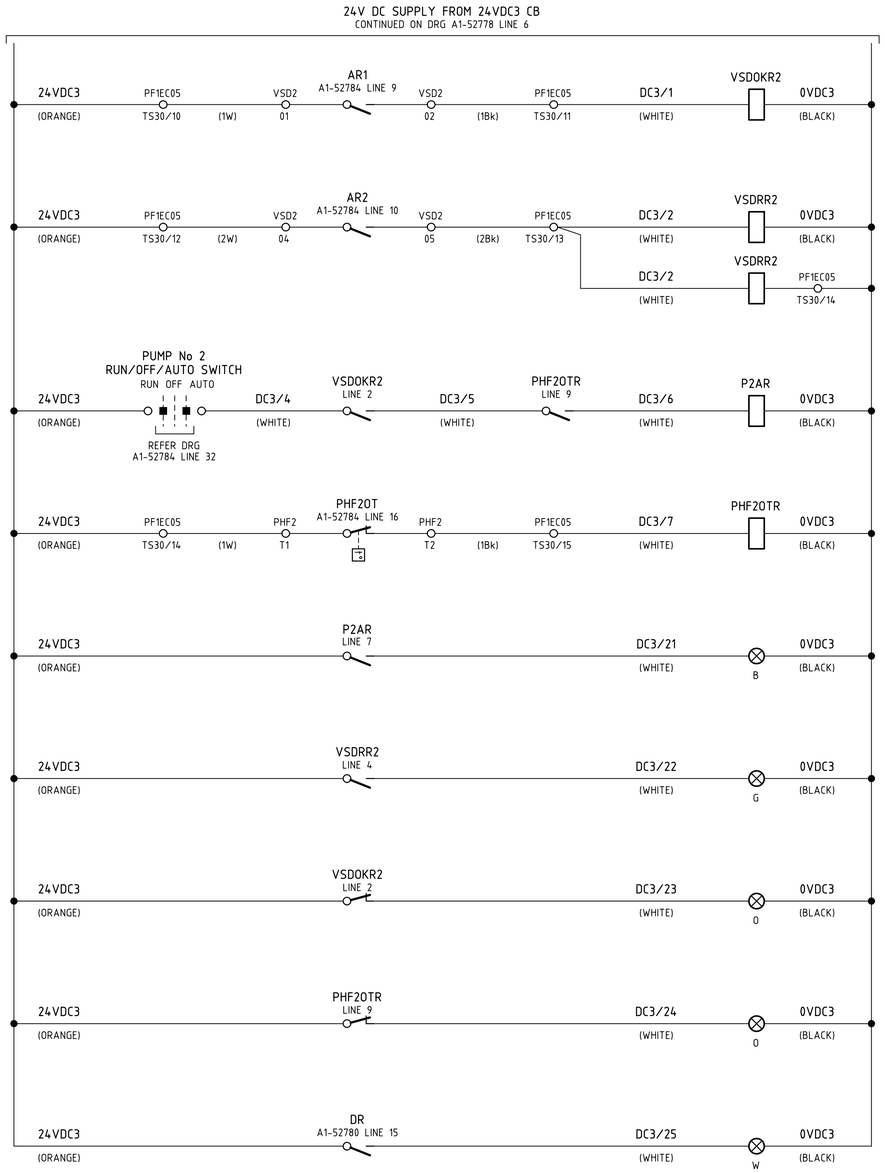



PUMP No 2
VSD FAULT



PUMP No 2
VSD RUNNING



PUMP No 2
VSD RUNNING

PUMP No 2
AVAILABLE



PHF2
OVER TEMP

PUMP No 2
AVAILABLE
INDICATION

PUMP No 2
RUNNING
INDICATION

PUMP No 2
VSD FAULT
INDICATION

PUMP No 2
PHF OVER TEMP
INDICATION

PUMP No 2
DUTY
INDICATION

DO NOT SCALE

GIPPSLAND WATER DRAWING STATUS: STANDARD DRAWING

GIPPSLAND WATER FACILITY CODE: XXCPXX

DRAWING No.: A1-52785 REV.: 3

GIPPSLAND WATER

STANDARD SEWERAGE PUMP STATION
PUMP STATION 30kW TO 160kW (VSD) - CT METERED
PUMP No 2 (QB1PP02)
ELECTRICAL SCHEMATIC DIAGRAM - SHEET 2 OF 2

DESIGNED BY:

OPTIMUM DRAFTING PTY LTD
A.B.N. 28 065 272 942

CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.
DESIGNED: 25/01/2018 - STD DRG
DRAWN: 25/01/2018 - OPT/CT
CHECKED: 25/01/2018 - P STEWART

REVISIONS

No.	DATE	DESCRIPTION	APP'D
3	7/9/20	UPDATED DRAWING SHEETS.	P.S.
2	9/10/13	REVISED DRAWING.	M.B.
1	18/3/13	REVISED TERMINALS TS11/3 & 4.	P.J.
0	24/9/12	INITIAL ISSUE.	P.J.

REFERENCES

PLAN No.	TITLE
A1-52770	STD SPS - PUMP STN 30kW TO 160kW (VSD) - CT METERED - I & C - DRG INDEX