



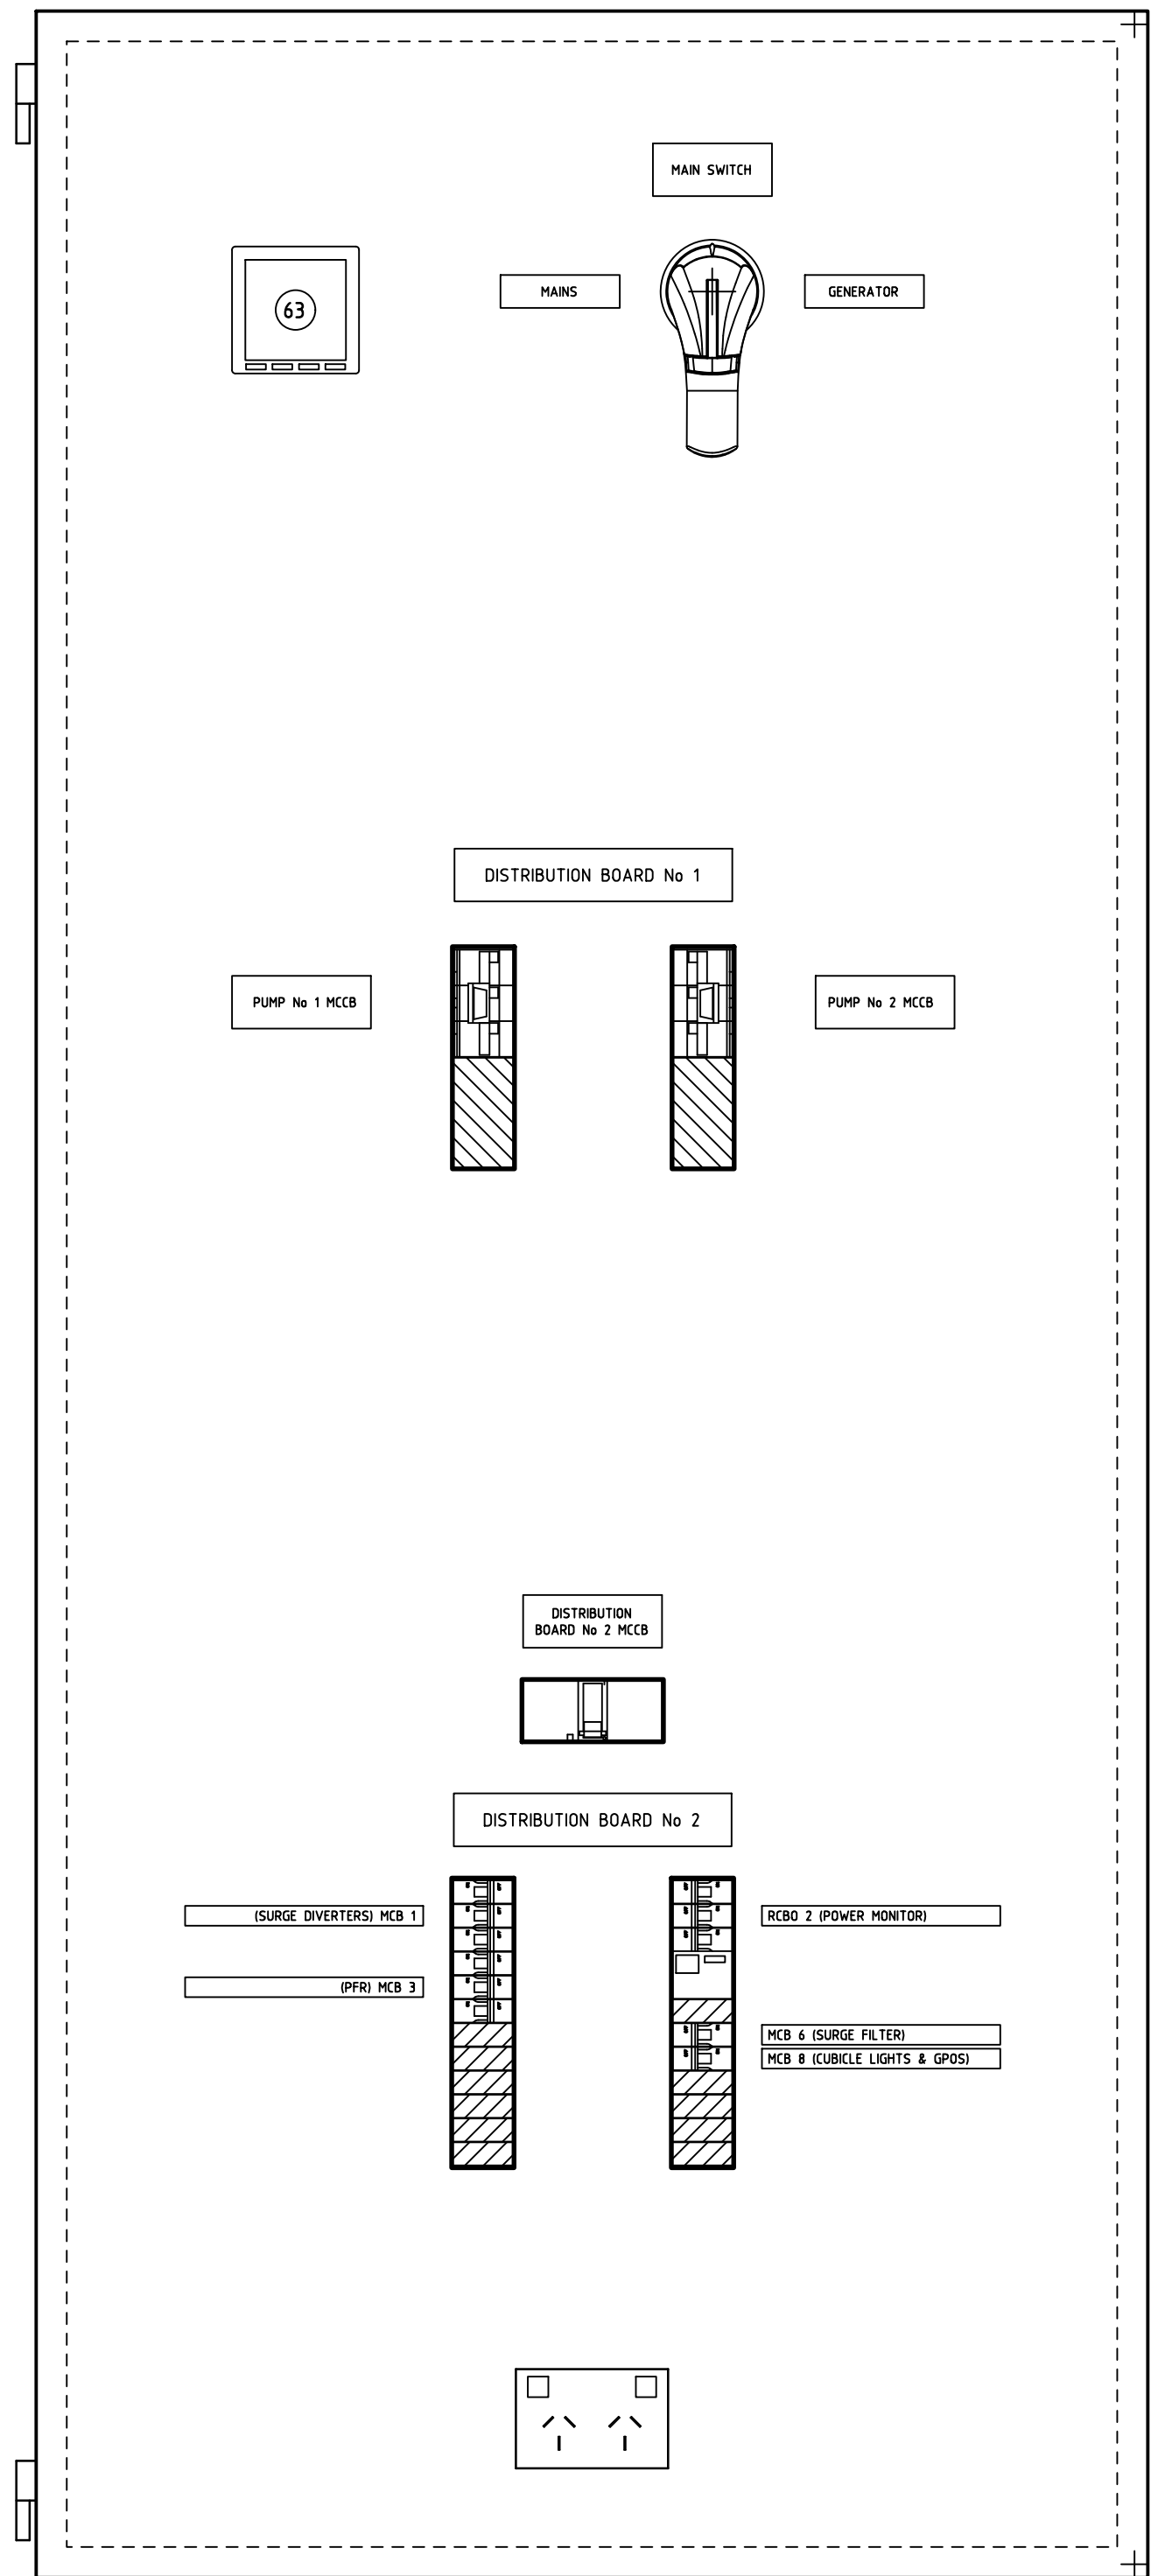

NOTES:

1. MAIN SWITCH TOP HAT
REFER A1-52805 FOR DETAILS
2. CT TOP HAT
REFER A1-52805 FOR DETAILS
3. DISTRIBUTION BOARD 1 TOP HAT
REFER A1-52805 FOR DETAILS
4. DISTRIBUTION BOARD 2 MAIN SWITCH TOP HAT
REFER A1-52805 FOR DETAILS
5. DISTRIBUTION BOARD 2 TOP HAT
REFER A1-52805 FOR DETAILS
6. BARE CONNECTIONS NOT OTHERWISE SHROUDED OR PROTECTED FROM
PHYSICAL CONTACT SHALL BE COVERED WITH HEATSHRINK OR SIMILAR

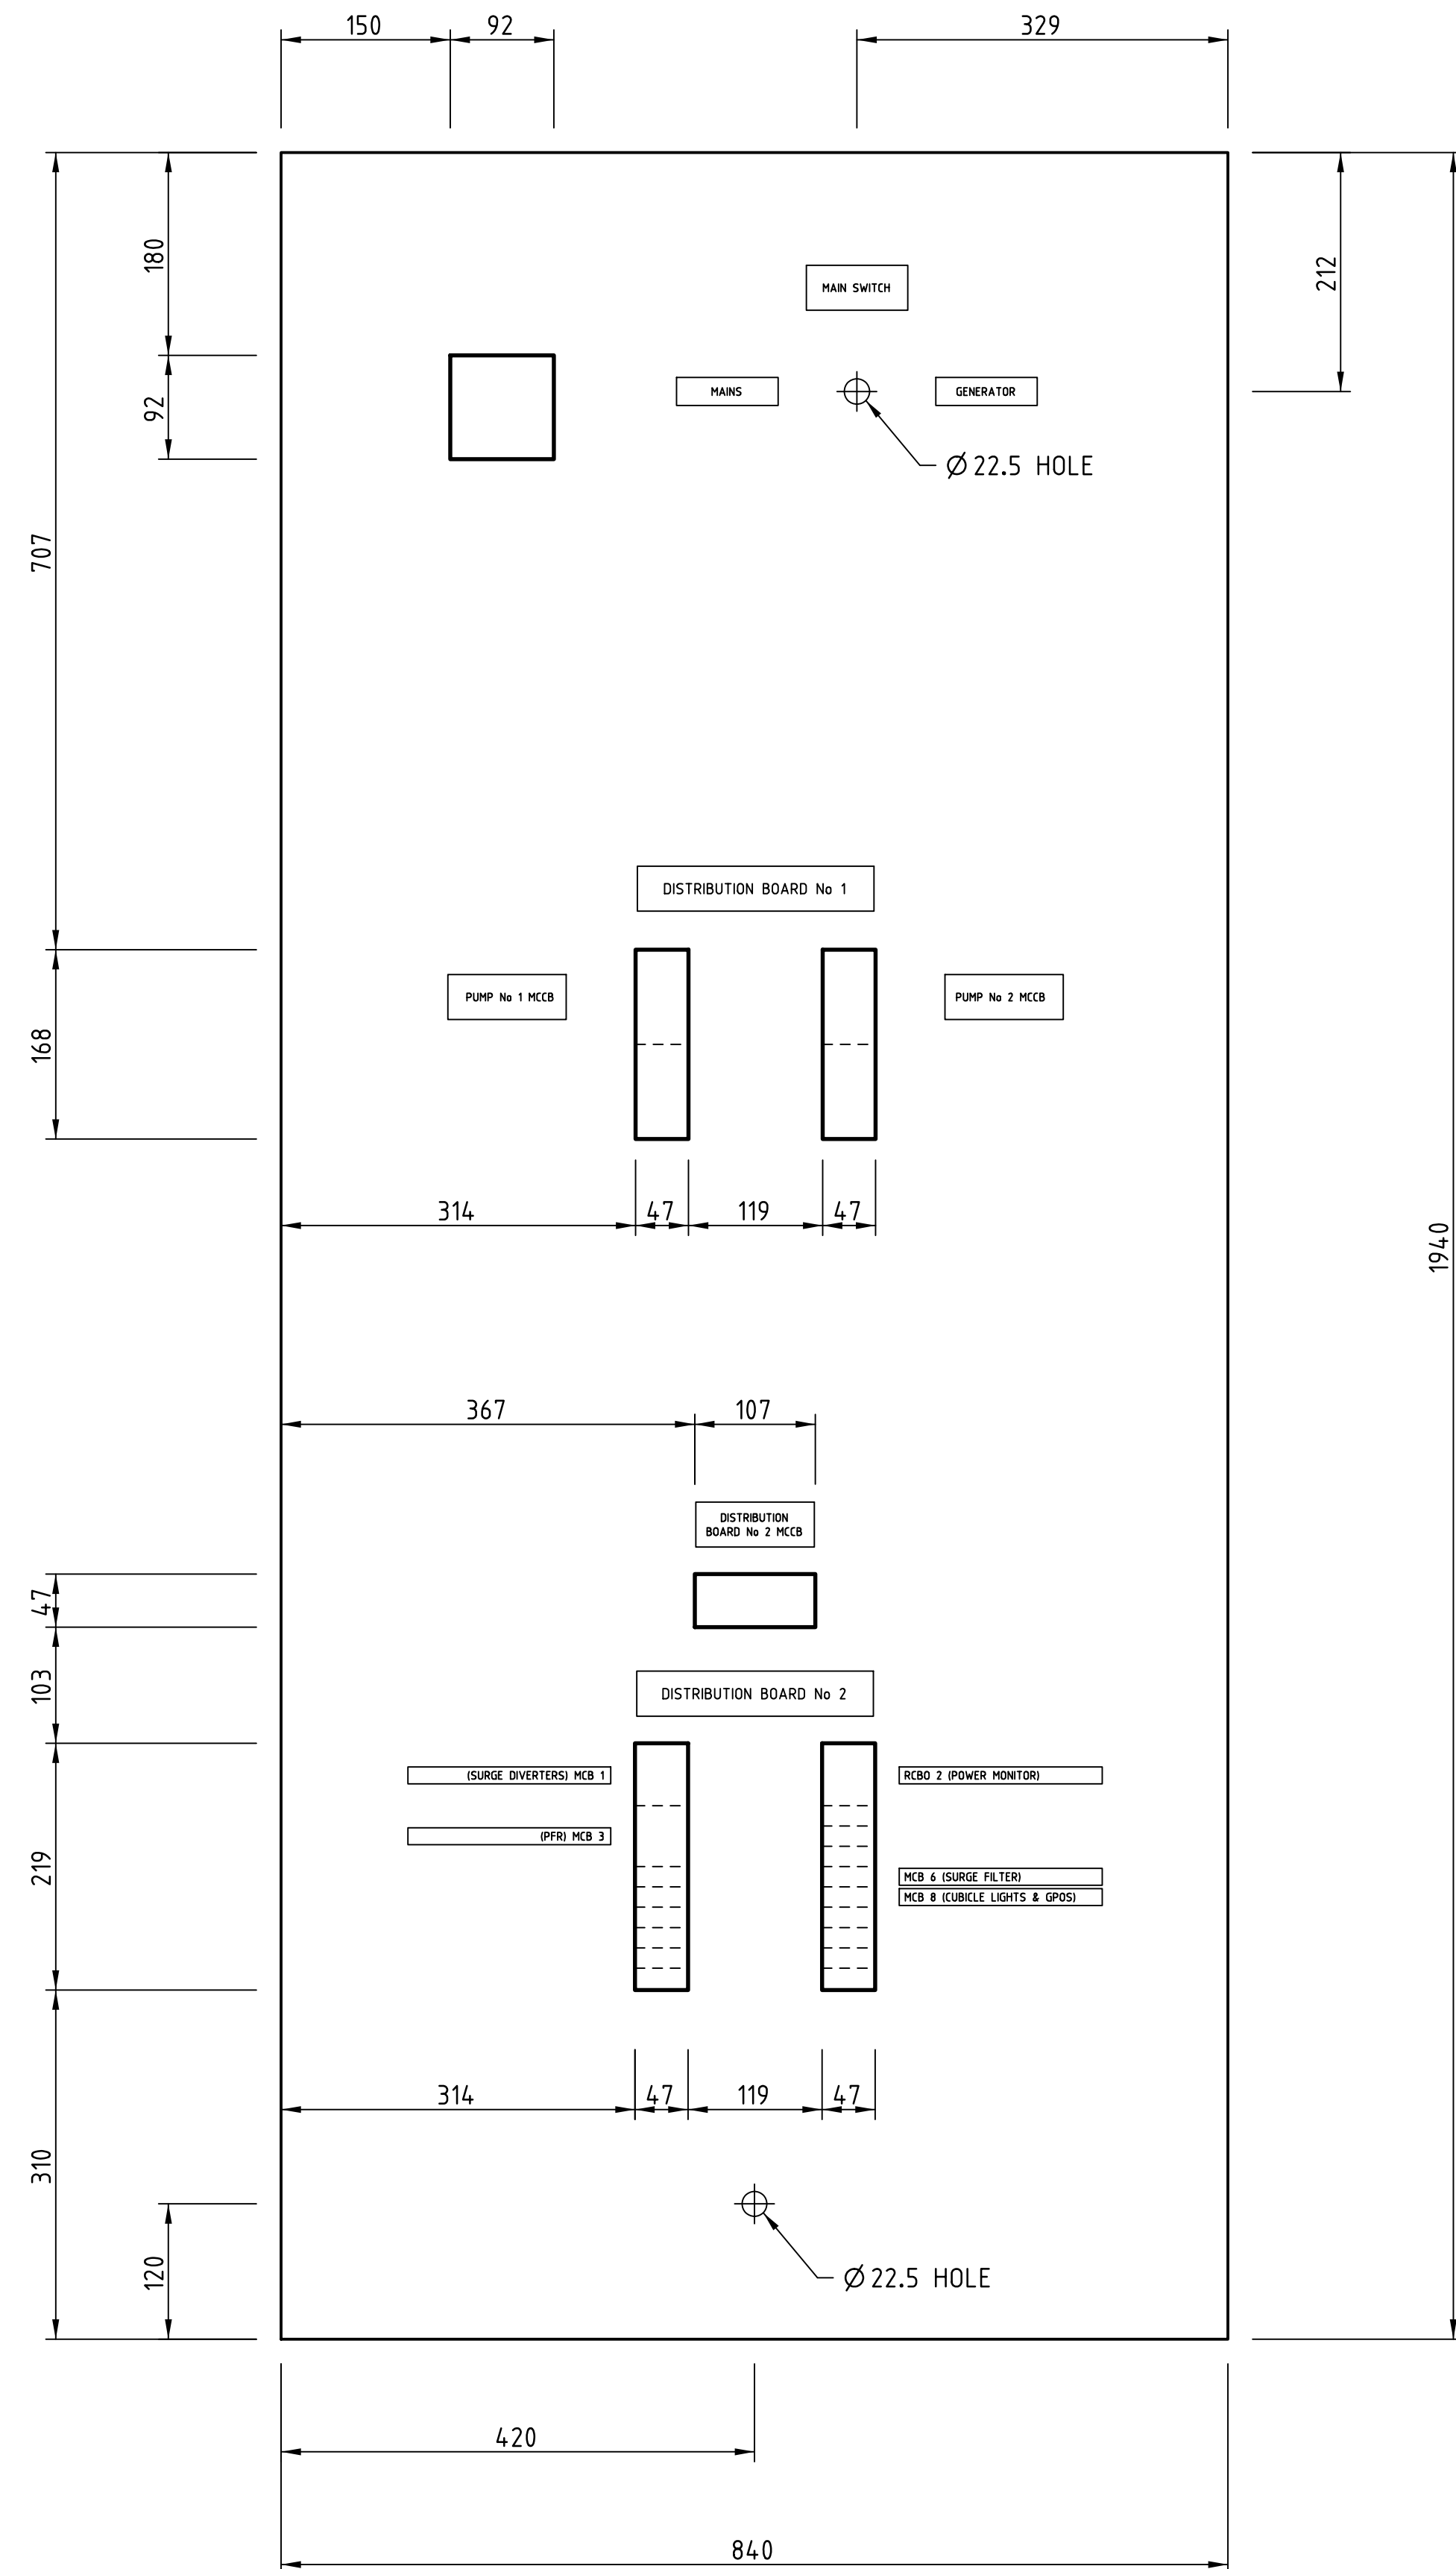

No.	DATE	DESCRIPTION	APP'D	REFERENCES	PLAN No.	TITLE
3	18/5/21	SCOMEK SWITCH CHANGED TO 4 POLE.	P.S.			
2	7/9/20	UPDATED DRAWING SHEETS.	P.S.			
1	9/10/13	REVISED DRAWING.	M.B.			
0	24/9/12	INITIAL ISSUE.	P.J.			

DESIGNED BY:		
TITLE		

DO NOT SCALE	GIPPSLAND WATER DRAWING STATUS	STANDARD DRAWING	GIPPSLAND WATER FACILITY CODE XXCPXX
CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.		GIPPSLAND WATER	
DESIGNED: 25/01/2018 - STD DRG		DRAWING No. REV.	
DRAWN: 25/01/2018 - OPT/CT		A1-52803 3	
CHECKED: 25/01/2018 - P STEWART		STANDARD SEWERAGE PUMP STATION PUMP STATION 30kW TO 160kW (VSD) - CT METERED SUPPLY CUBICLE - MAIN DISTRIBUTION GEAR TRAY & ESCUTCHEON DOOR LAYOUT - 30kW - SHEET 1 OF 3	

STANDARD SEWERAGE PUMP STATION
PUMP STATION 30kW TO 160kW (VSD) - CT METERED
SUPPLY CUBICLE - MAIN DISTRIBUTION GEAR TRAY
& ESCUTCHEON DOOR LAYOUT - 30kW - SHEET 1 OF 3