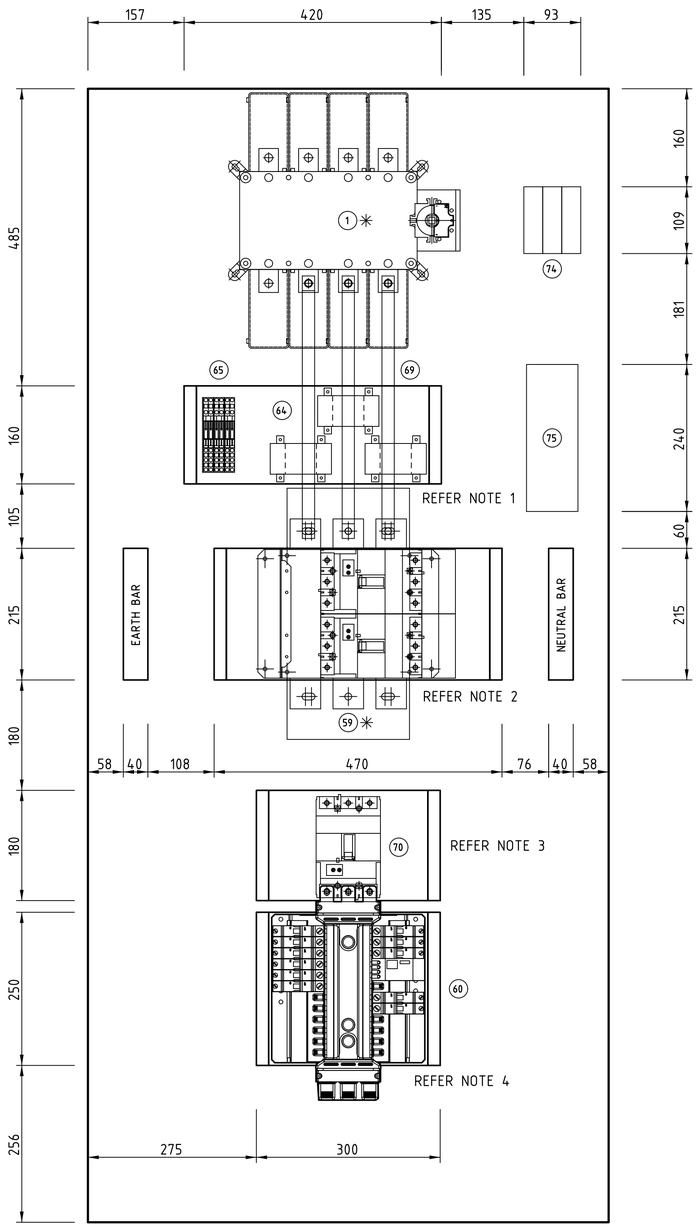

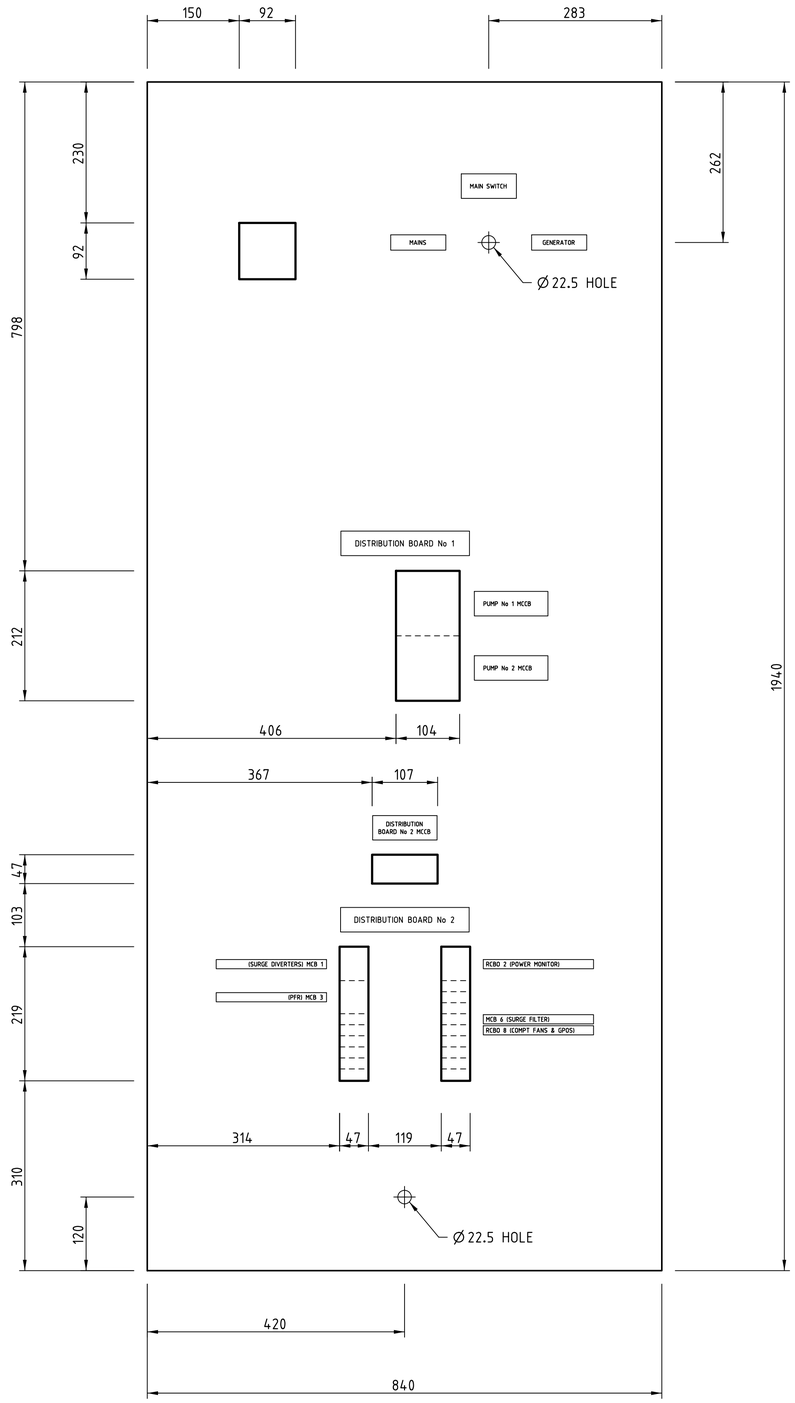

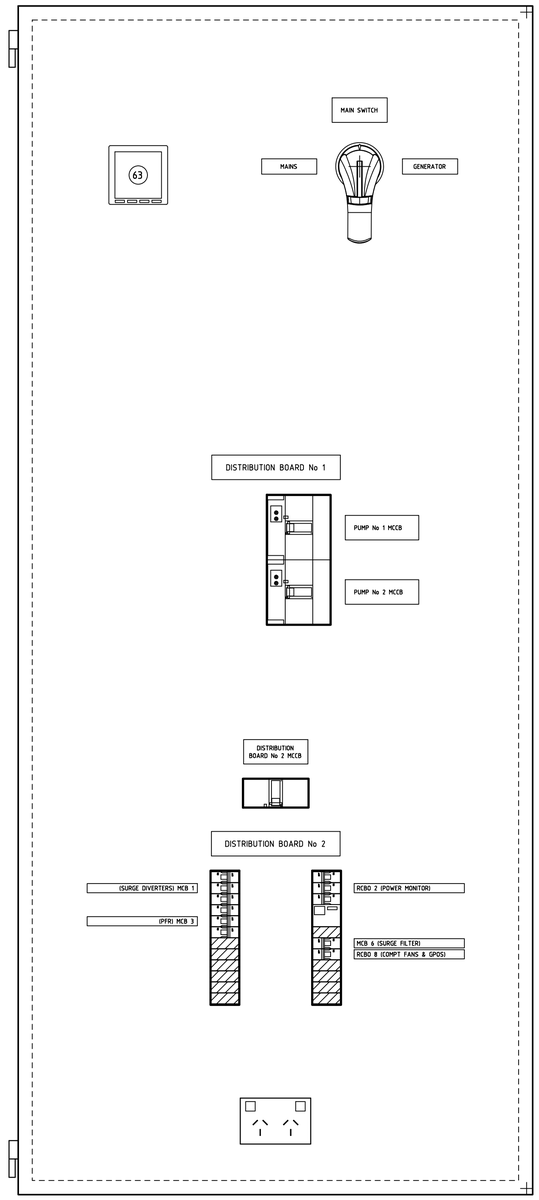

NOTES:

1. CT TOP HAT
   REFER A1-52820 FOR DETAILS
2. DISTRIBUTION BOARD 1 TOP HAT
   REFER A1-52820 FOR DETAILS
3. DISTRIBUTION BOARD 2 MAIN SWITCH TOP HAT
   REFER A1-52820 FOR DETAILS
4. DISTRIBUTION BOARD 2 TOP HAT
   REFER A1-52820 FOR DETAILS
5. BARE CONNECTIONS NOT OTHERWISE SHROUDED OR PROTECTED FROM PHYSICAL CONTACT SHALL BE COVERED WITH HEATSHRINK OR SIMILAR

REVISIONS

No.	DATE	DESCRIPTION	APP'D
5	27/9/21	REVISED GEAR TRAY NOTE NUMBERS.	P.S.
4	18/5/21	SCOMEC SWITCH CHANGED TO 4 POLE.	P.S.
3	7/9/20	UPDATED DRAWING SHEETS.	P.S.
2	9/10/13	REVISED DRAWING.	M.B.
1	18/3/13	FIXED CUT-OUT LOCATION.	P.J.
0	24/9/12	INITIAL ISSUE.	P.J.

REFERENCES

PLAN No.	TITLE
A1-52770	STD SPS - PUMP STN 30kW TO 160kW (VSD) - CT METERED - I & C - DRG INDEX

DESIGNED BY:

OPTIMUM DRAFTING PTY LTD
A.B.N. 28 065 272 942

DO NOT SCALE

CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.
DESIGNED: 25/01/2018 - STD DRG
DRAWN: 25/01/2018 - OPT/CT
CHECKED: 25/01/2018 - P STEWART

GIPPSLAND WATER DRAWING STATUS: STANDARD DRAWING

GIPPSLAND WATER FACILITY CODE: XXCPXX

GIPPSLAND WATER

DRAWING No. A1-52818 REV. 5

STANDARD SEWERAGE PUMP STATION
PUMP STATION 30kW TO 160kW (VSD) - CT METERED
SUPPLY CUBICLE - MAIN DISTRIBUTION GEAR TRAY
& ESCUTCHEON DOOR LAYOUT - 110kW TO 132kW - SHEET 1 OF 3