




SECTION "C-C"

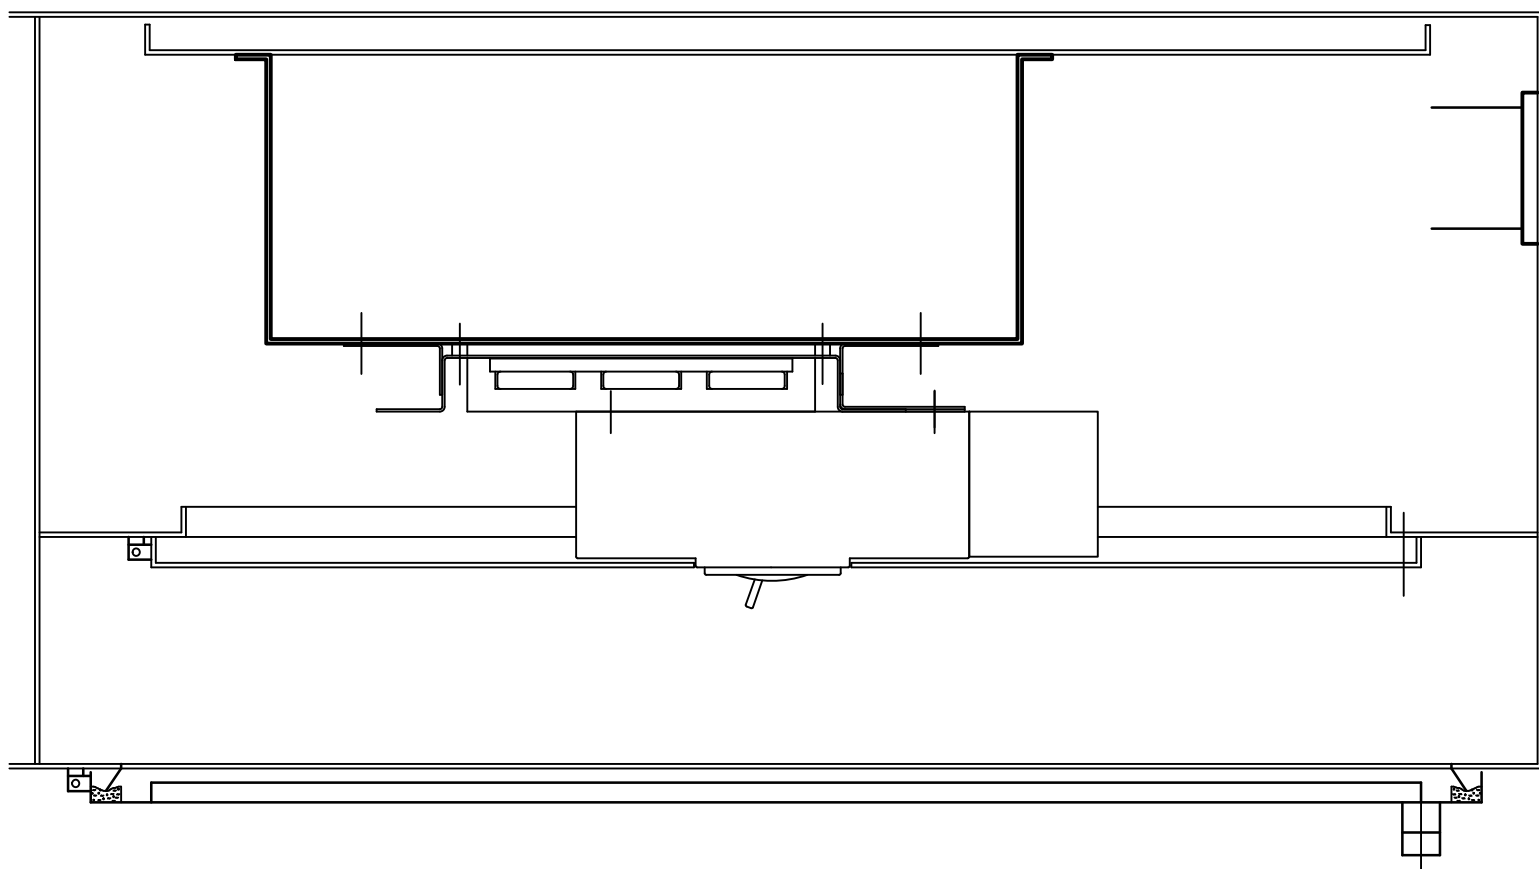


SECTION "E-E"

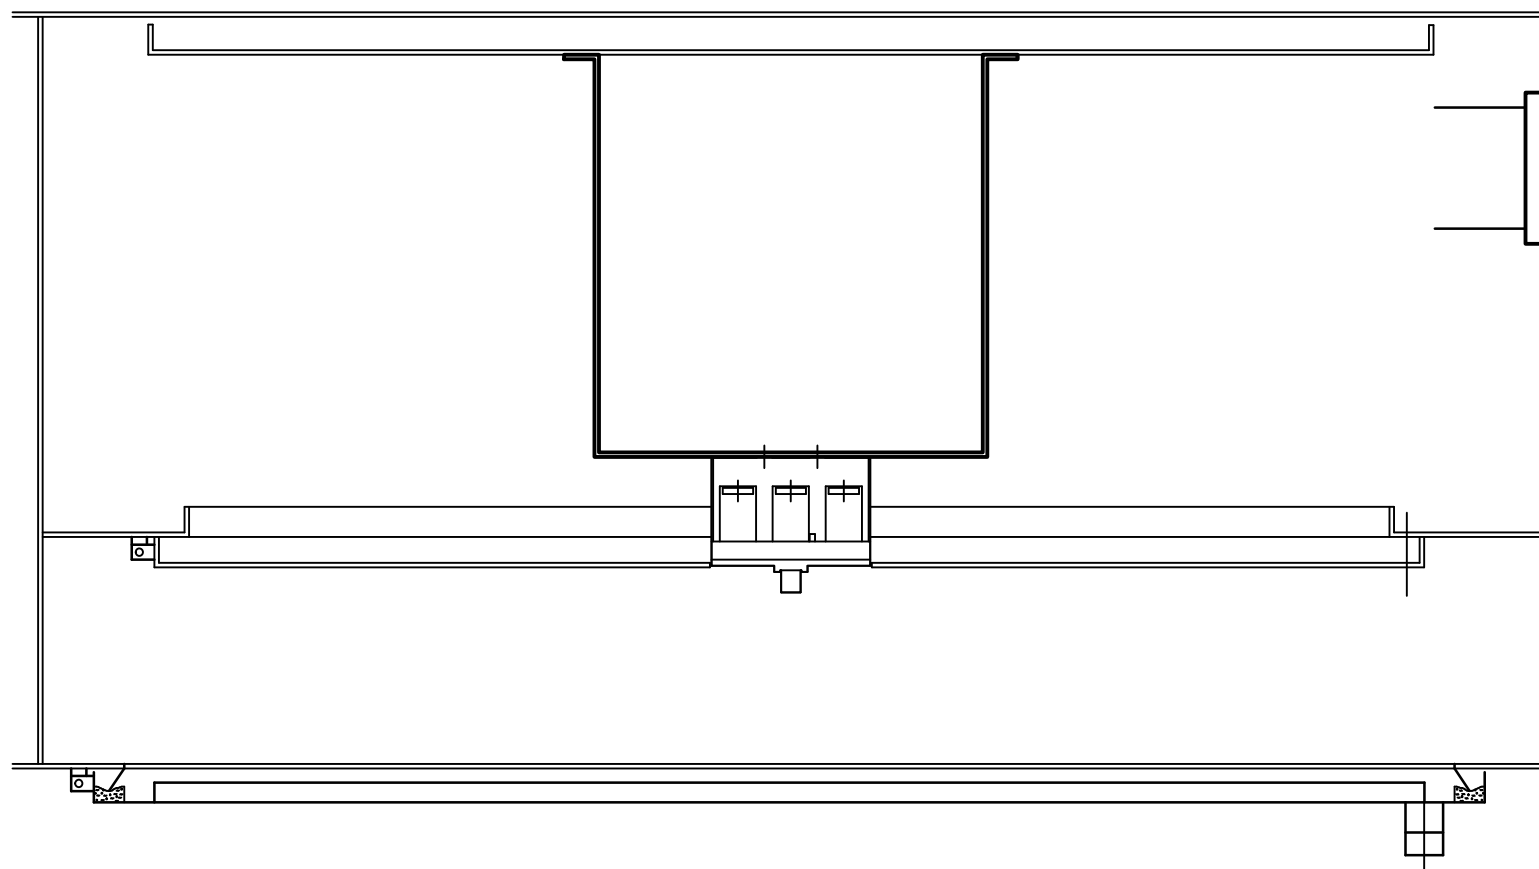


SECTION "F-F"

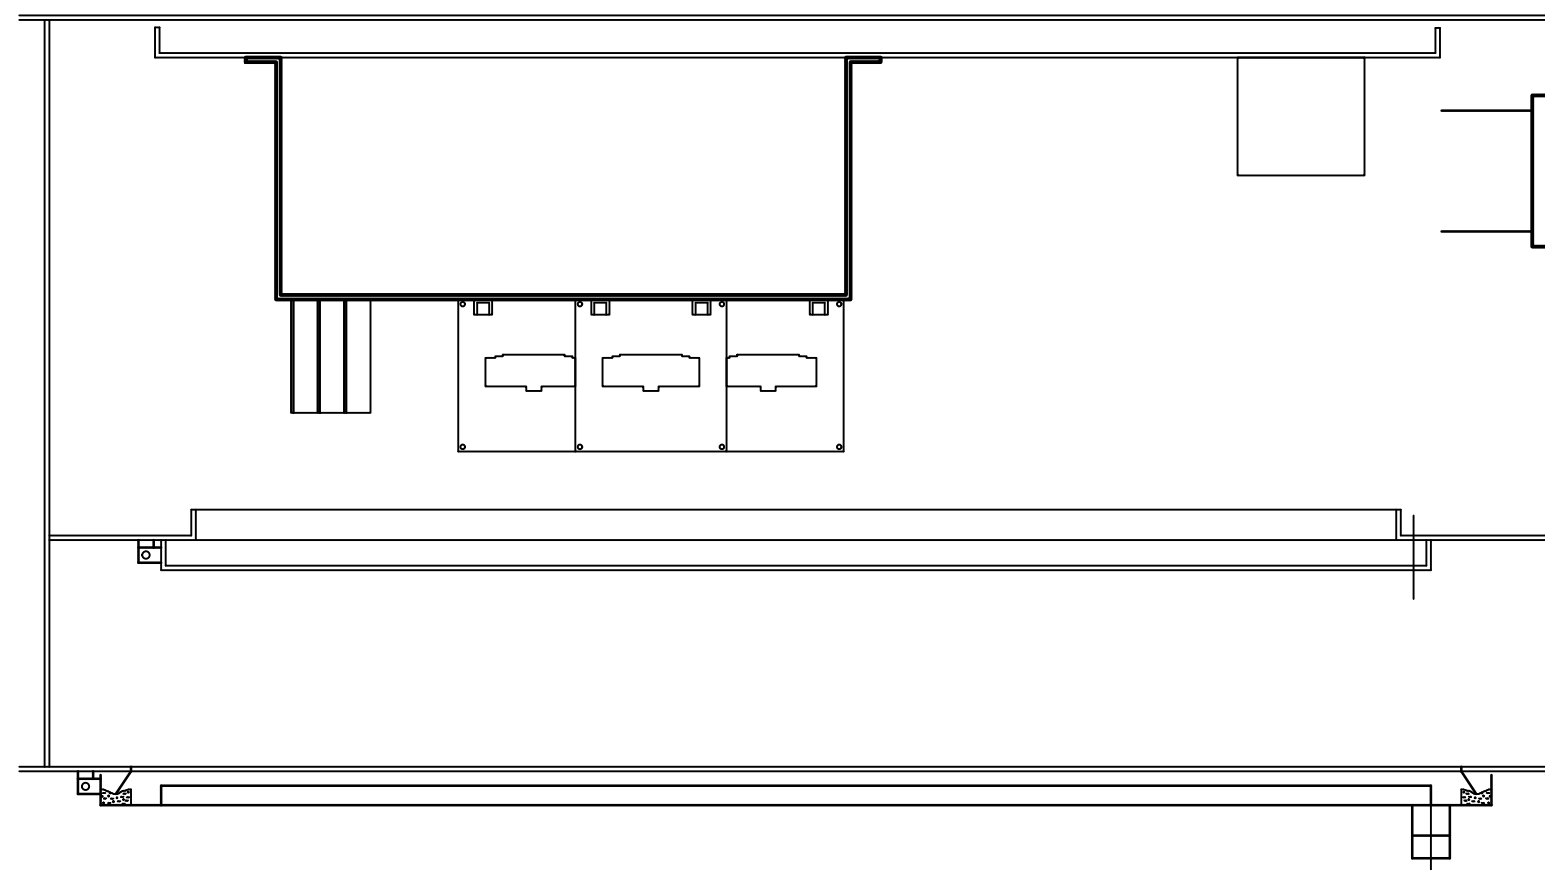


SECTION "D-D"

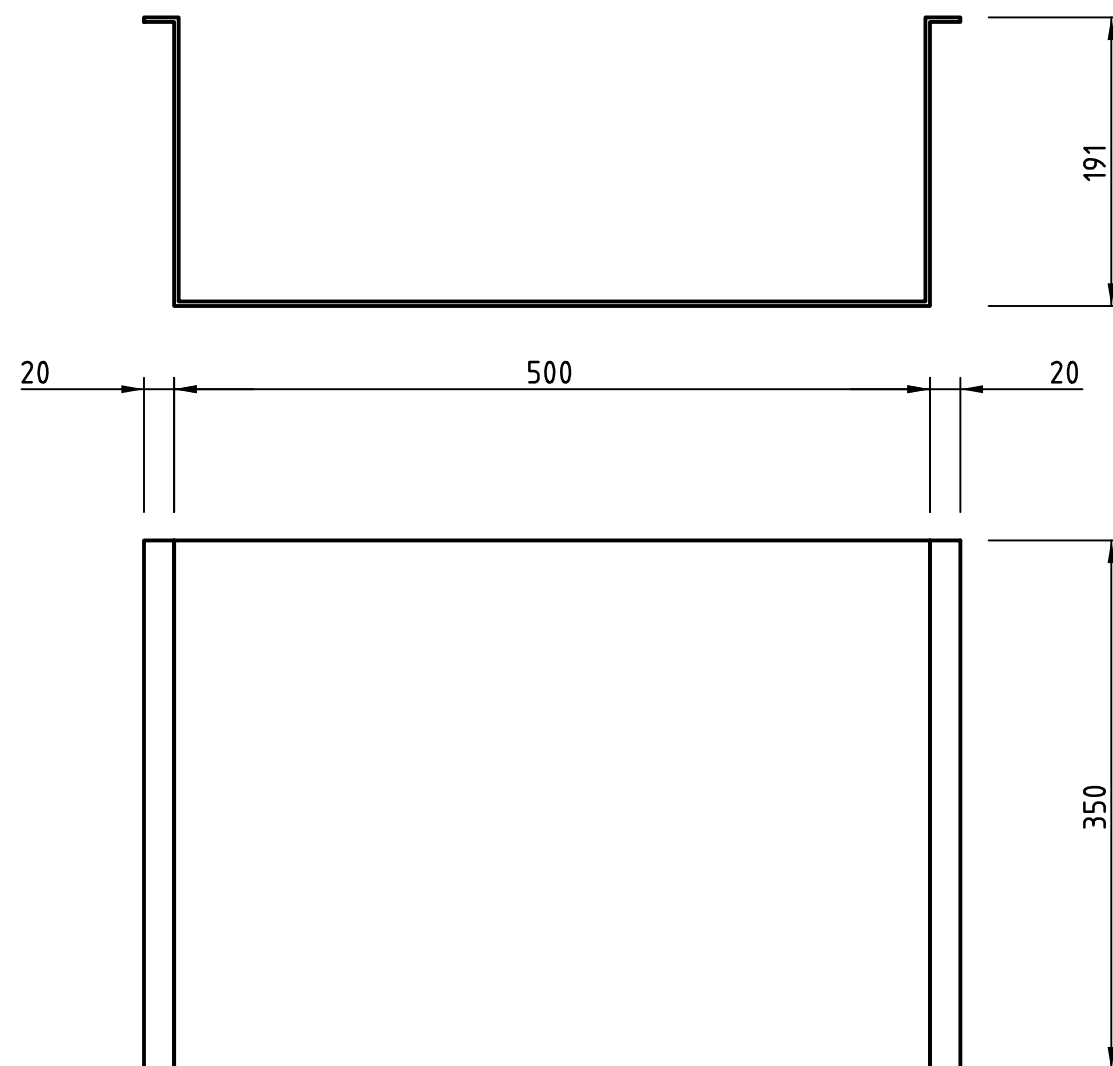


MAIN DISTRIBUTION COMPARTMENT -
DISTRIBUTION BOARD 1 TOP HAT DETAILS

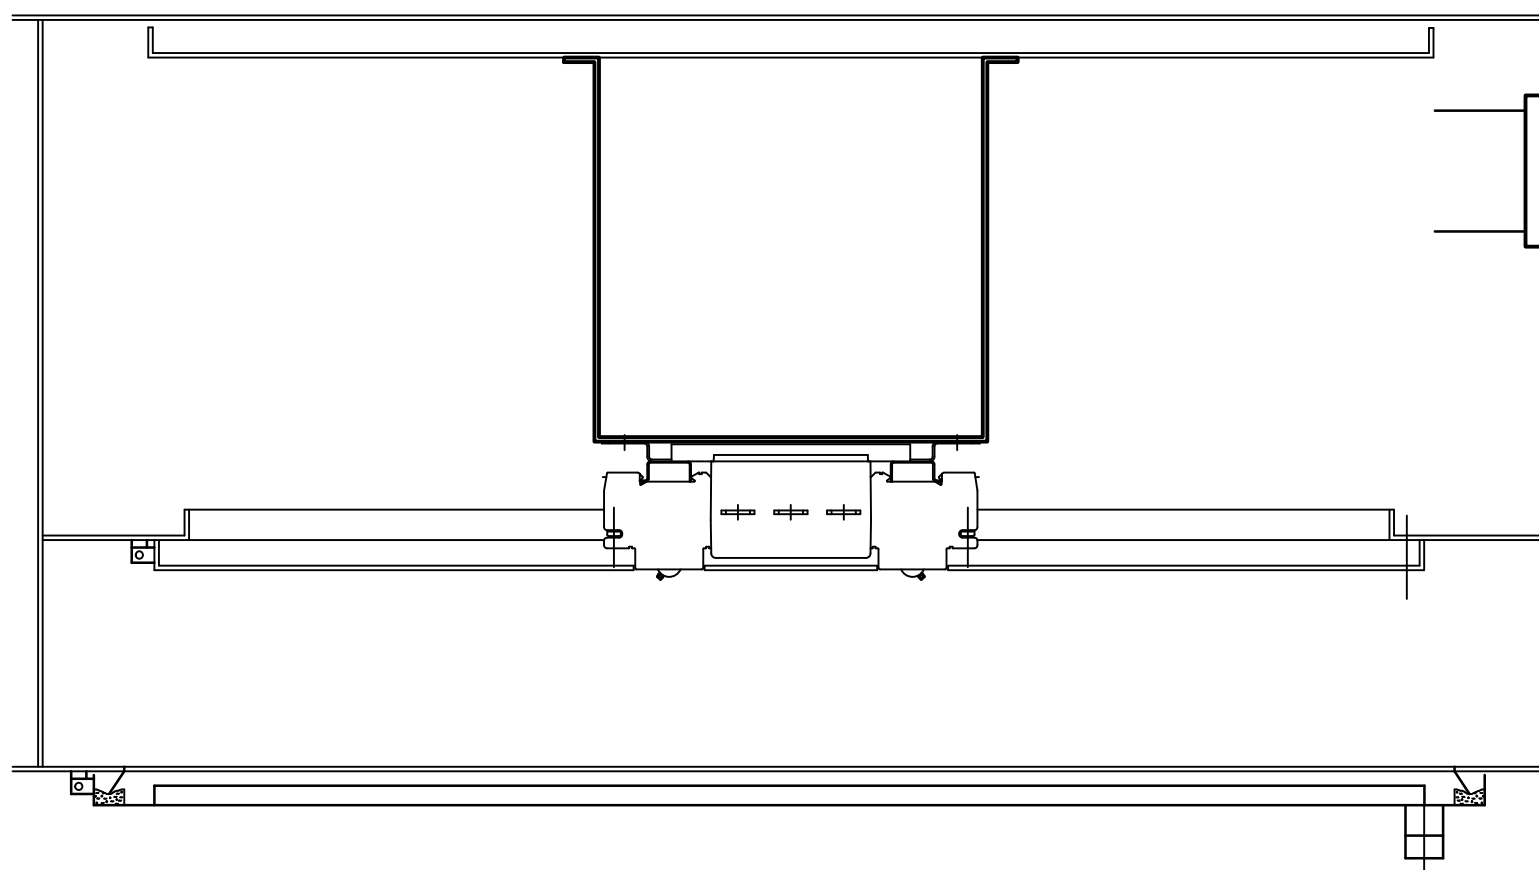


SECTION "G-G"

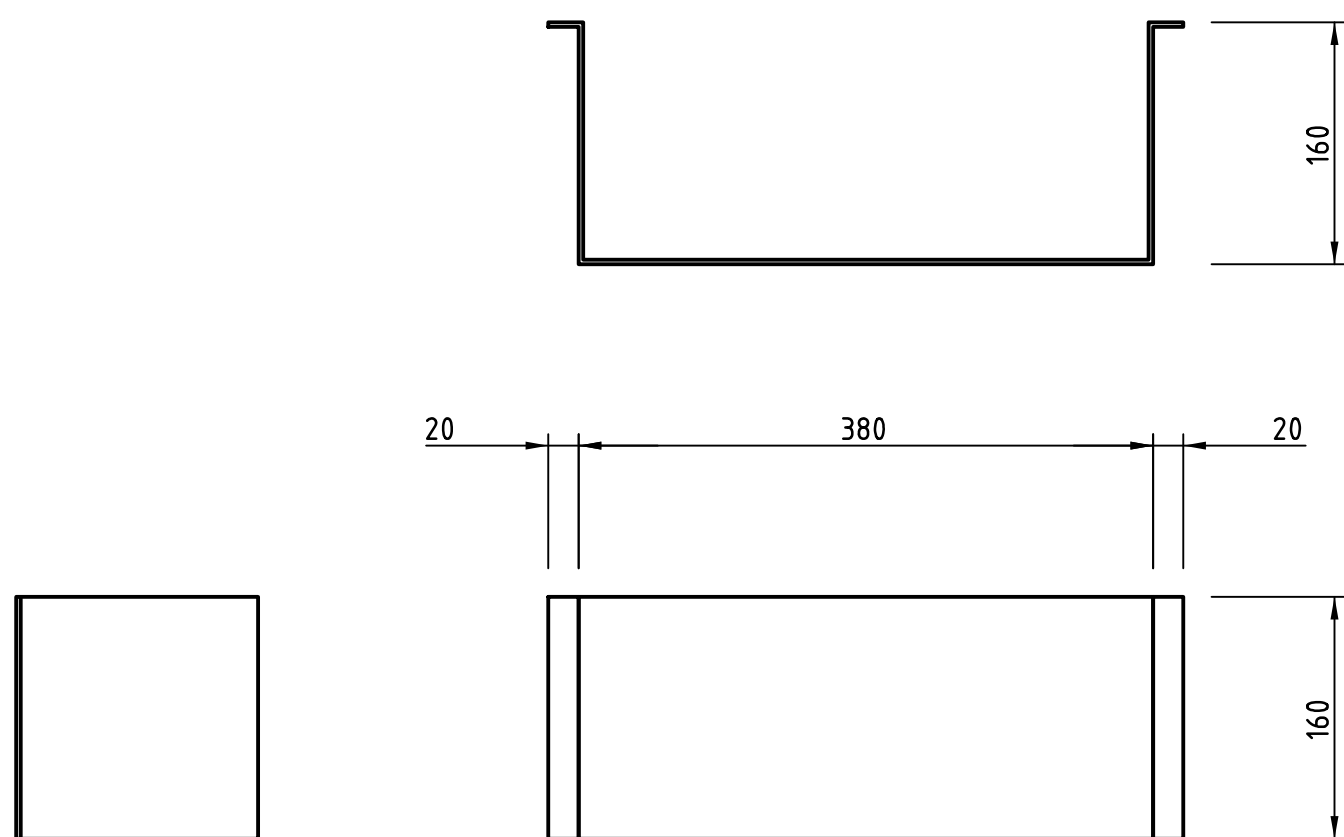

MAIN DISTRIBUTION COMPARTMENT -
CT TOP HAT DETAILS

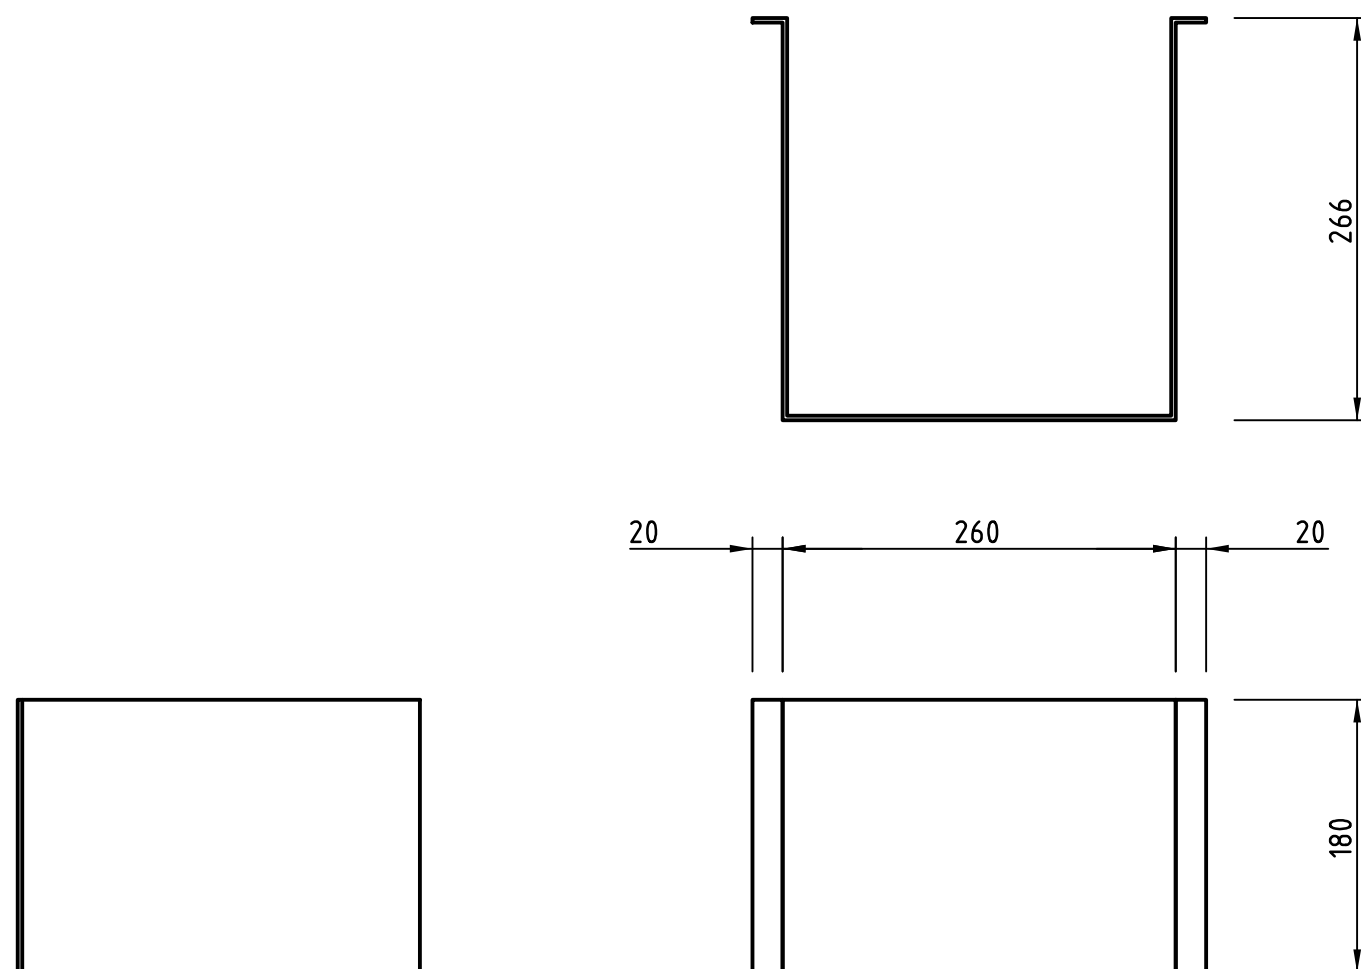

MAIN DISTRIBUTION COMPARTMENT -
DISTRIBUTION BOARD 2 MAIN SWITCH TOP HAT DETAILS

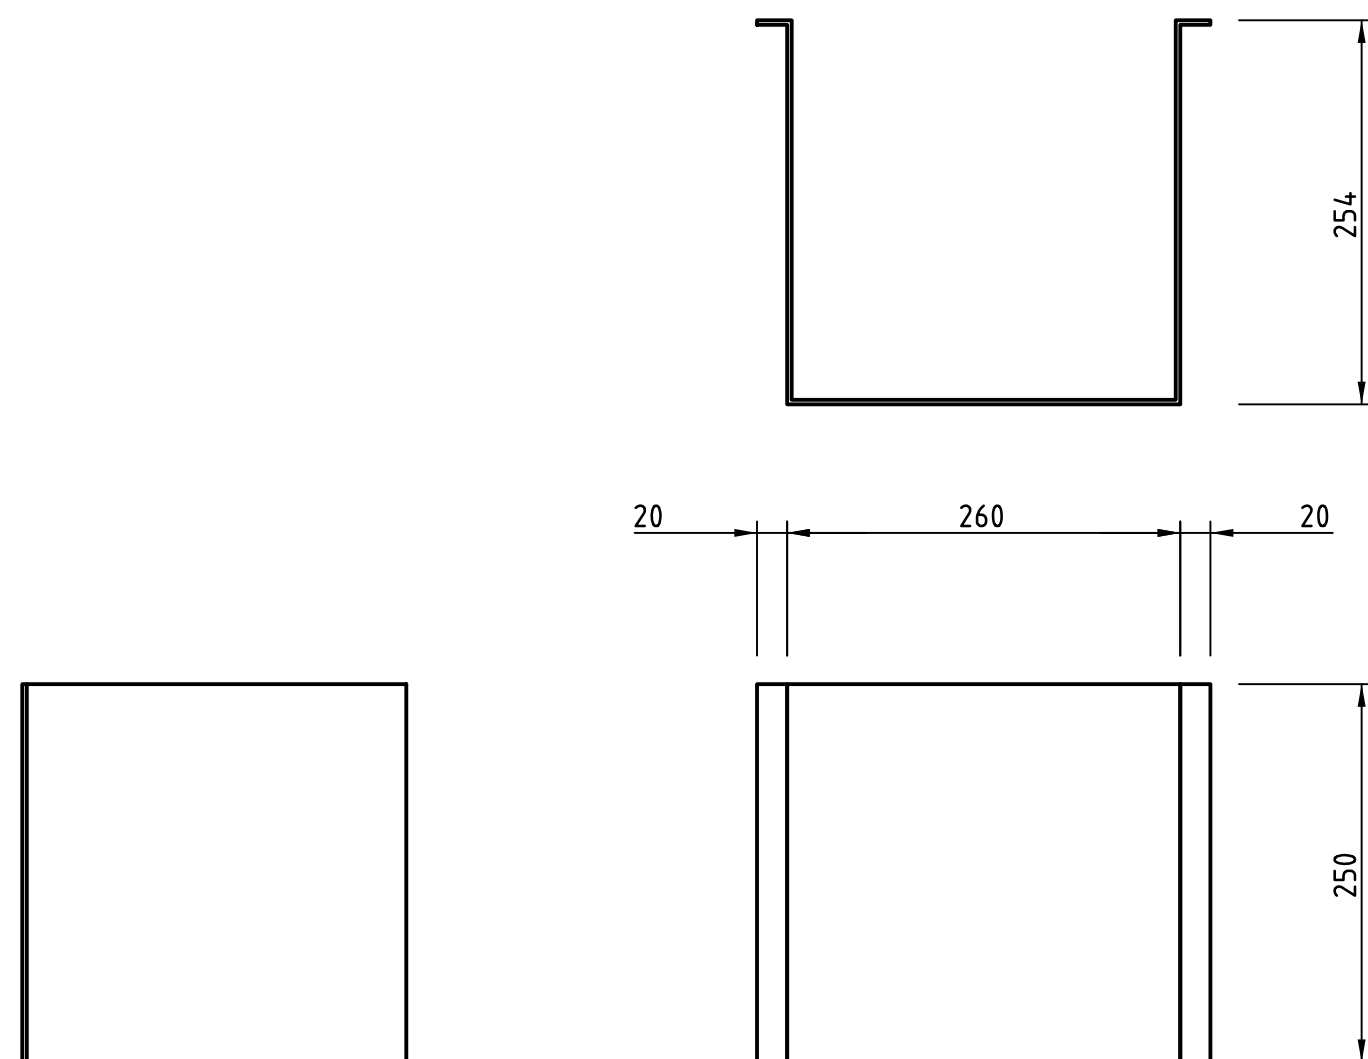



MAIN DISTRIBUTION COMPARTMENT -
DISTRIBUTION BOARD 2 TOP HAT DETAILS

REV	REVISIONS			APP'D	REFERENCES	PLAN No.	TITLE
	No.	DATE	DESCRIPTION				
	3	18/5/21	SCOMEC SWITCH CHANGED TO 4 POLE.				
	2	7/9/20	UPDATED DRAWING SHEETS.				
	1	9/10/13	REVISED DRAWING.				
			0	24/9/12	INITIAL ISSUE.	P.J.	

DESIGNED BY:



DO NOT SCALE	GIPPSLAND WATER DRAWING STATUS	STANDARD DRAWING		GIPPSLAND WATER FACILITY CODE XXCPXX	
CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.		GIPPSLAND WATER		DRAWING No.	REV.
				A1-52823	3
				STANDARD SEWERAGE PUMP STATION PUMP STATION 30kw TO 160kw (VSD) - CT METERED SUPPLY CUBICLE - MAIN DISTRIBUTION GEAR TRAY & ESCUTCHEON DOOR LAYOUT - 160kW - SHEET 3 OF 3	
DESIGNED: 25/01/2018 - STD DRG					
DRAWN: 25/01/2018 - OPT/CT					
CHECKED: 25/01/2018 - P STEWART					