




SECTION "B-B"

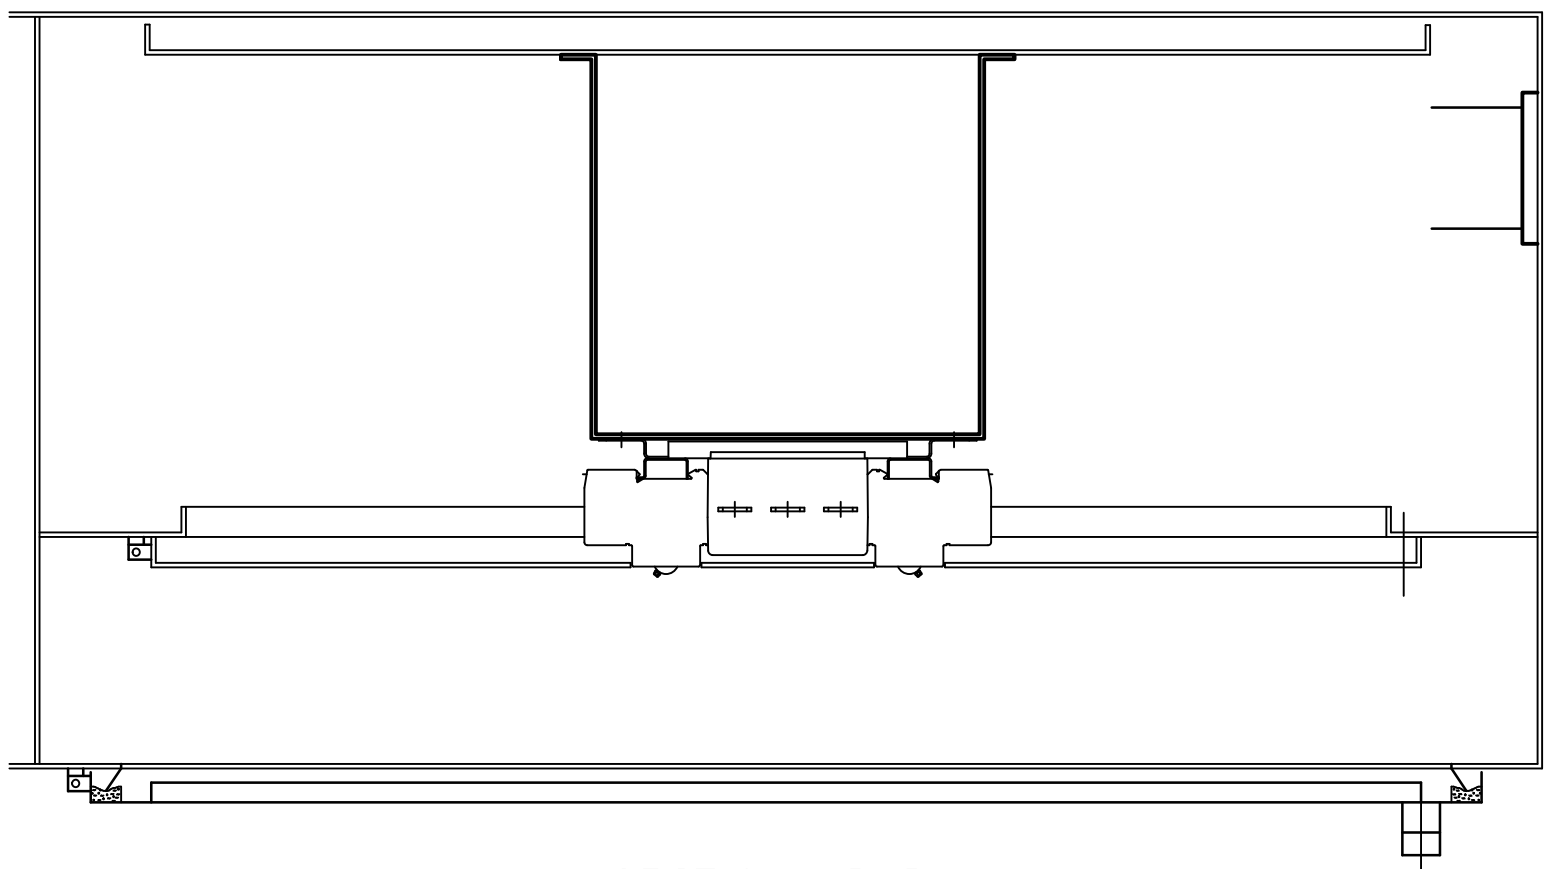


SECTION "D-D"

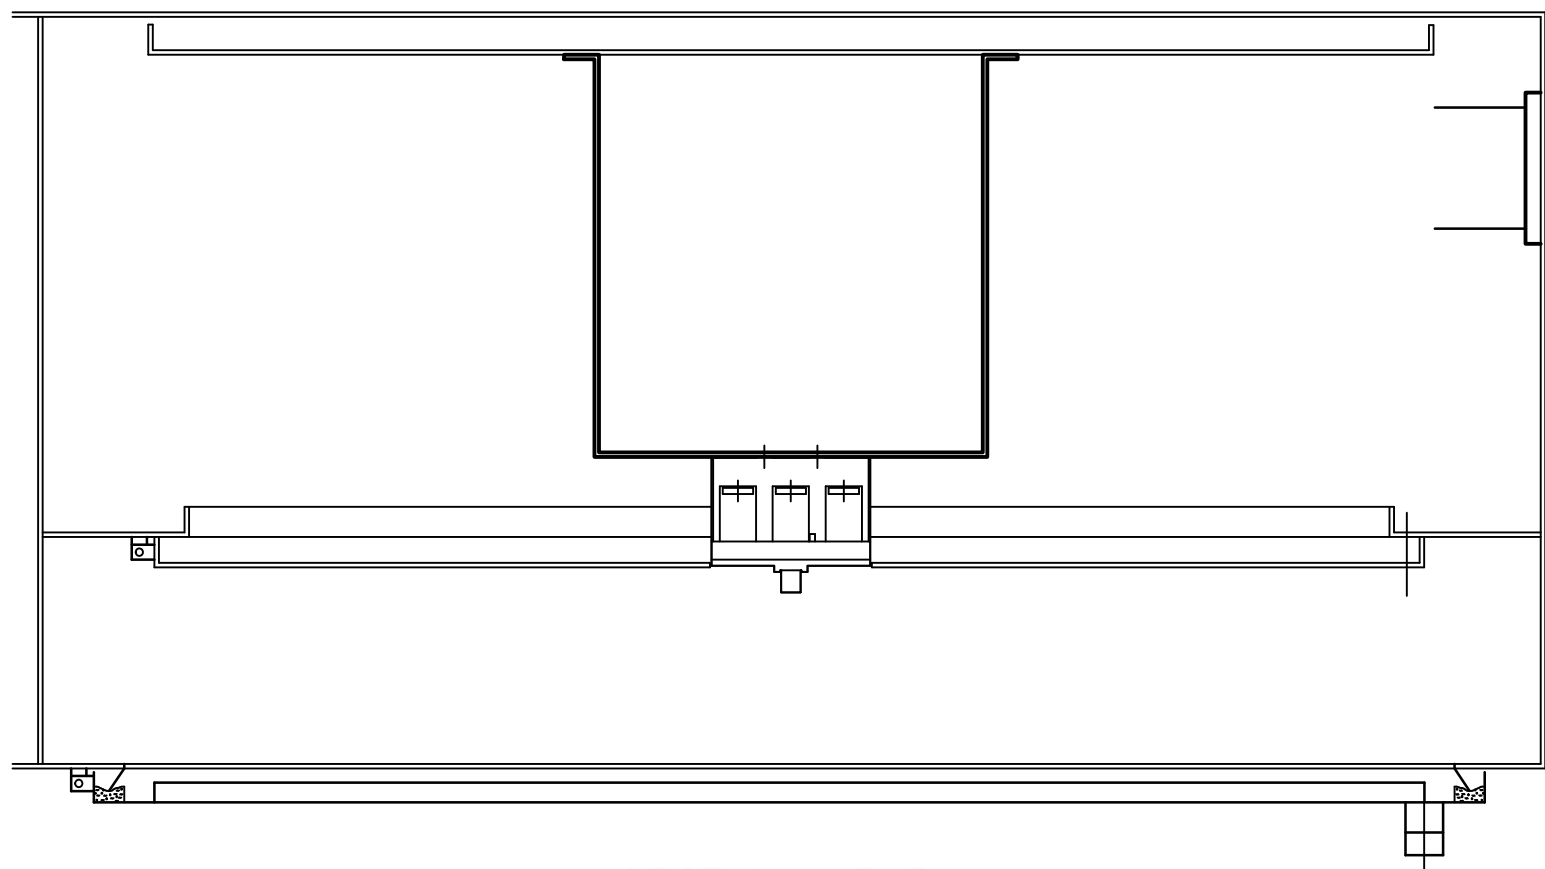


SECTION "E-E"

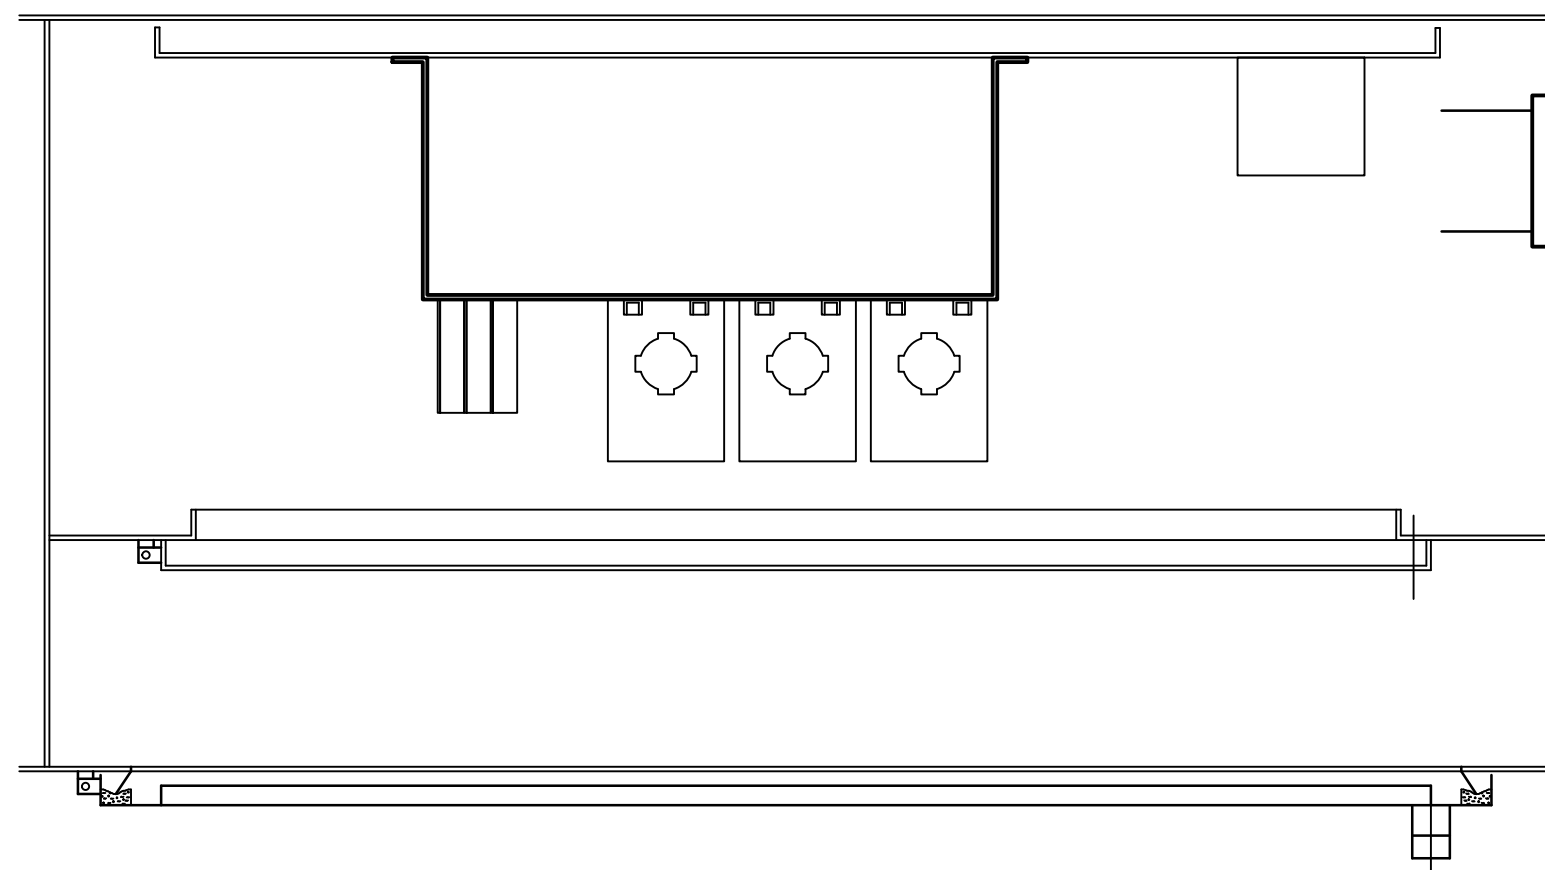


SECTION "C-C"

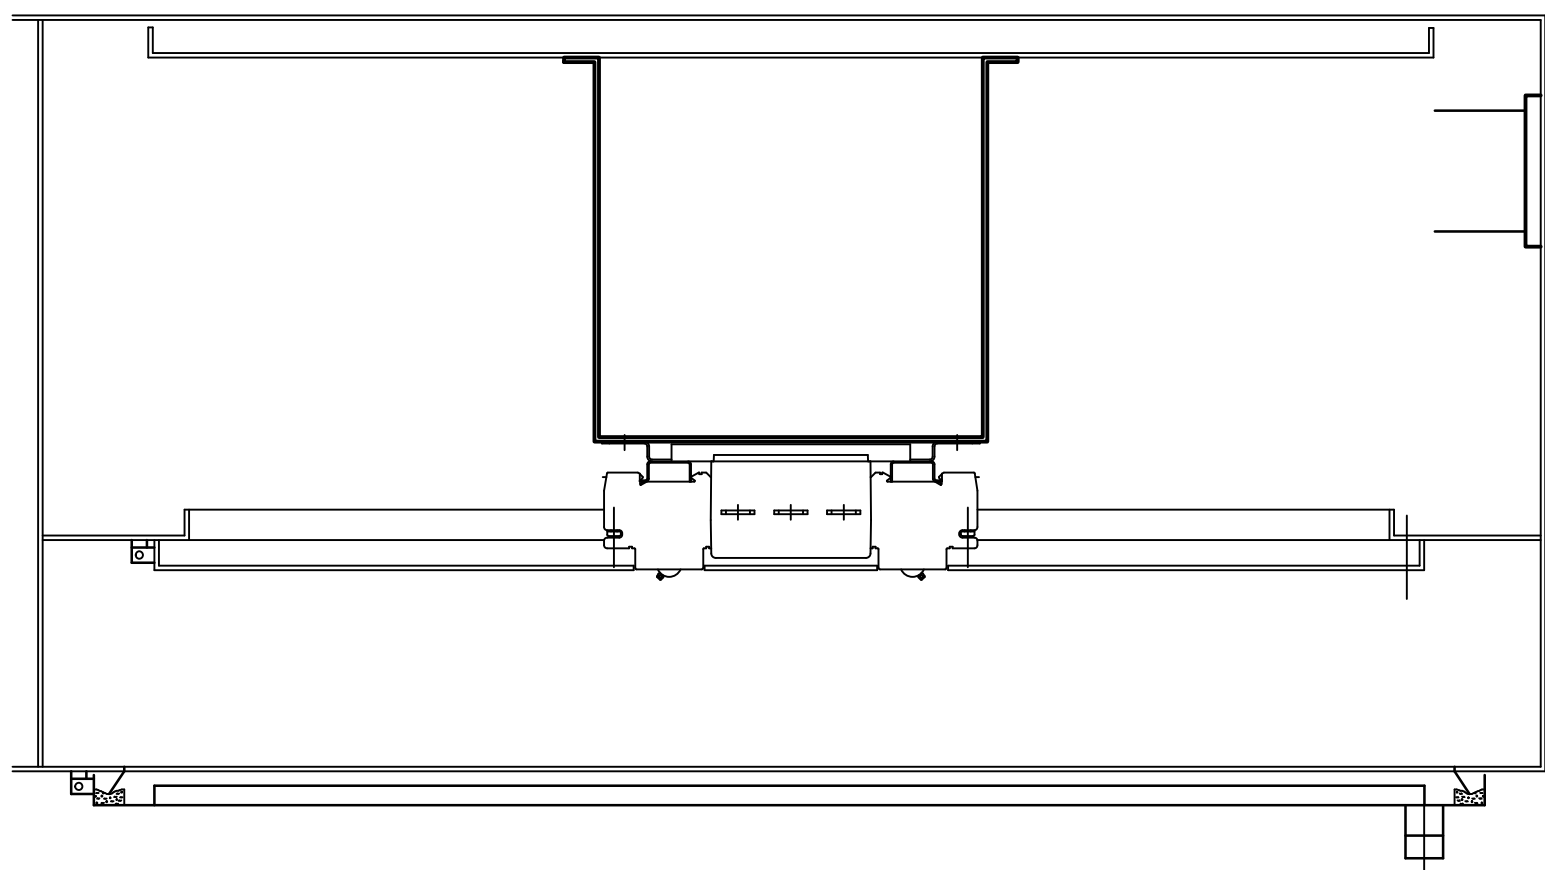


SECTION "F-F"

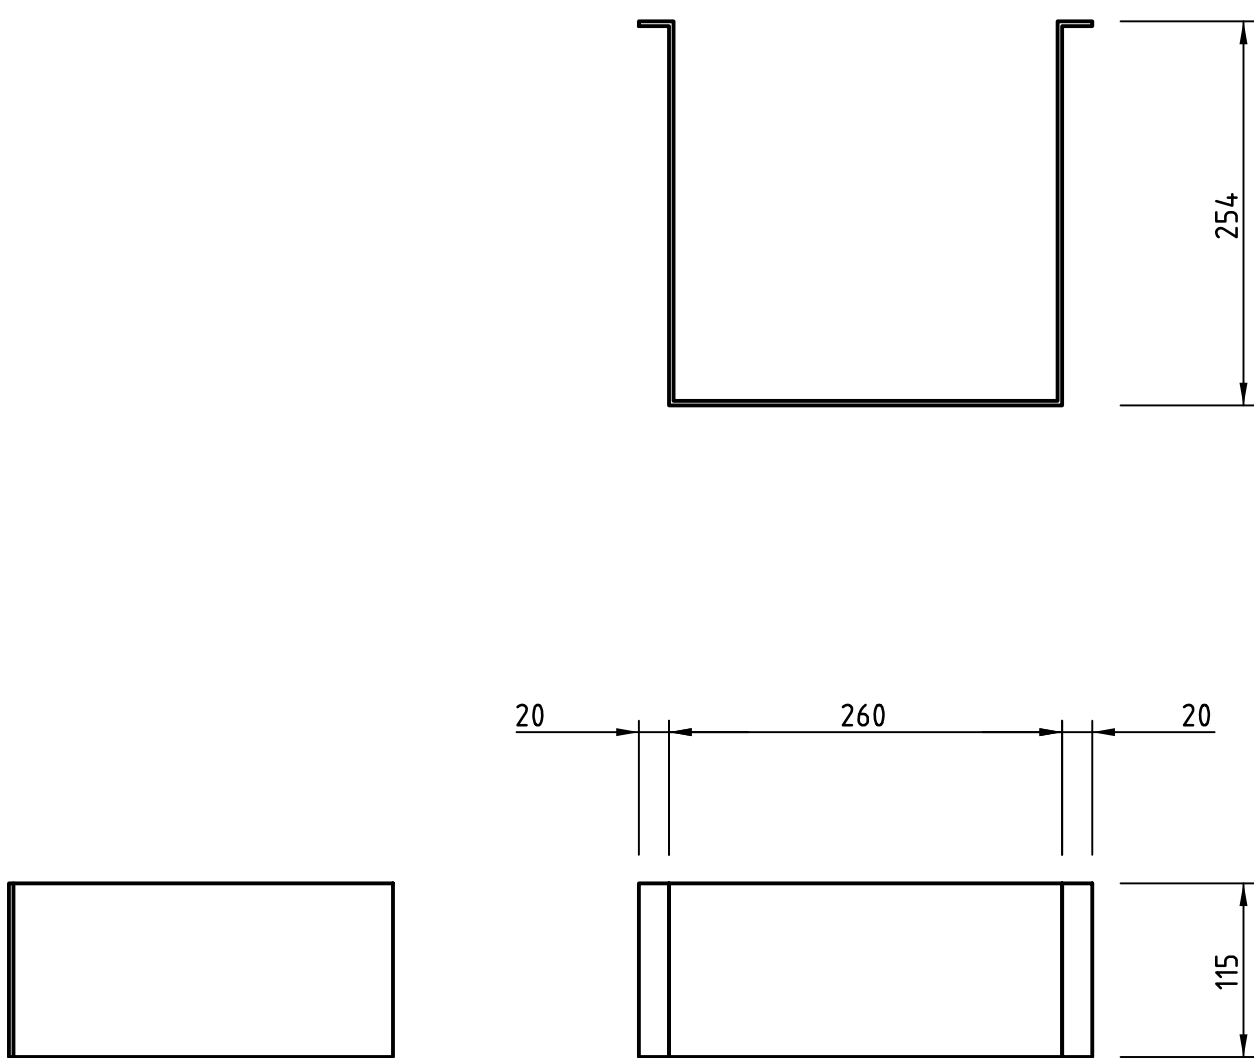


MAIN DISTRIBUTION COMPARTMENT -
DISTRIBUTION BOARD 1 TOP HAT DETAILS

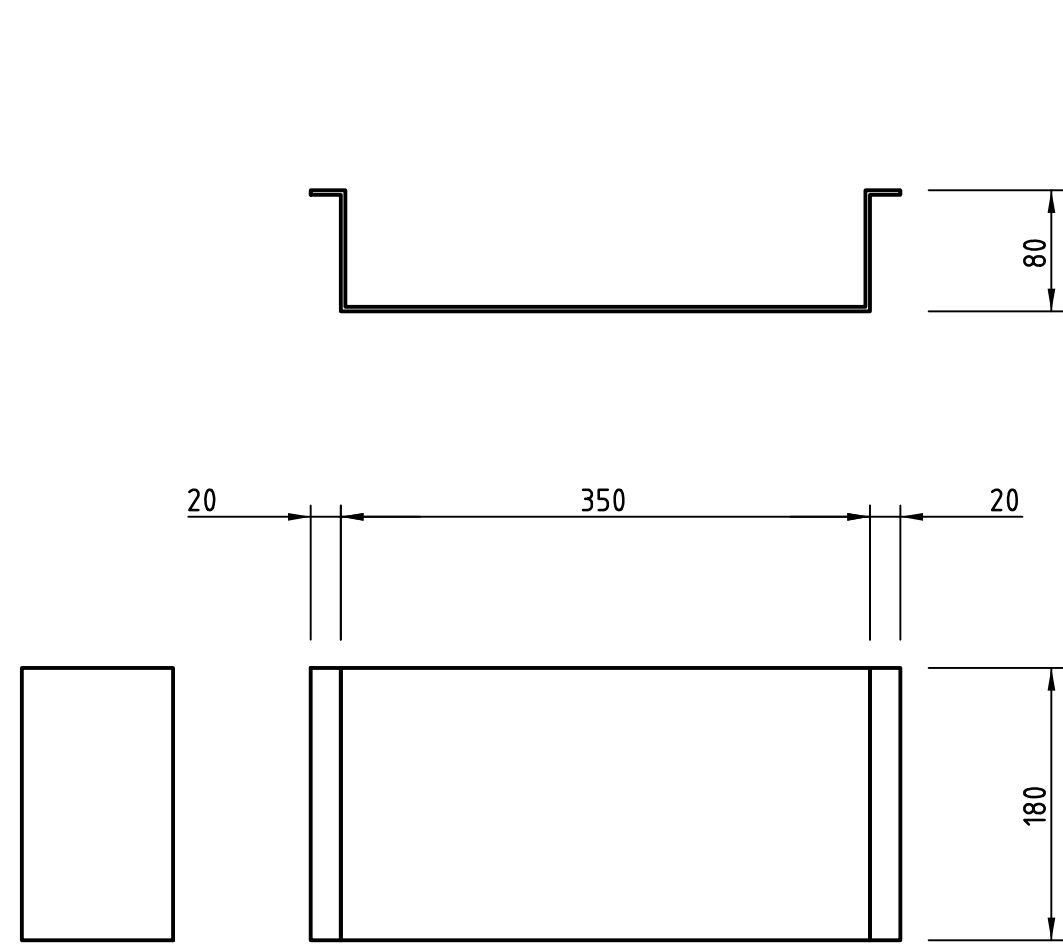


MAIN DISTRIBUTION COMPARTMENT -
CHANGEOVER SWITCH TOP HAT DETAILS

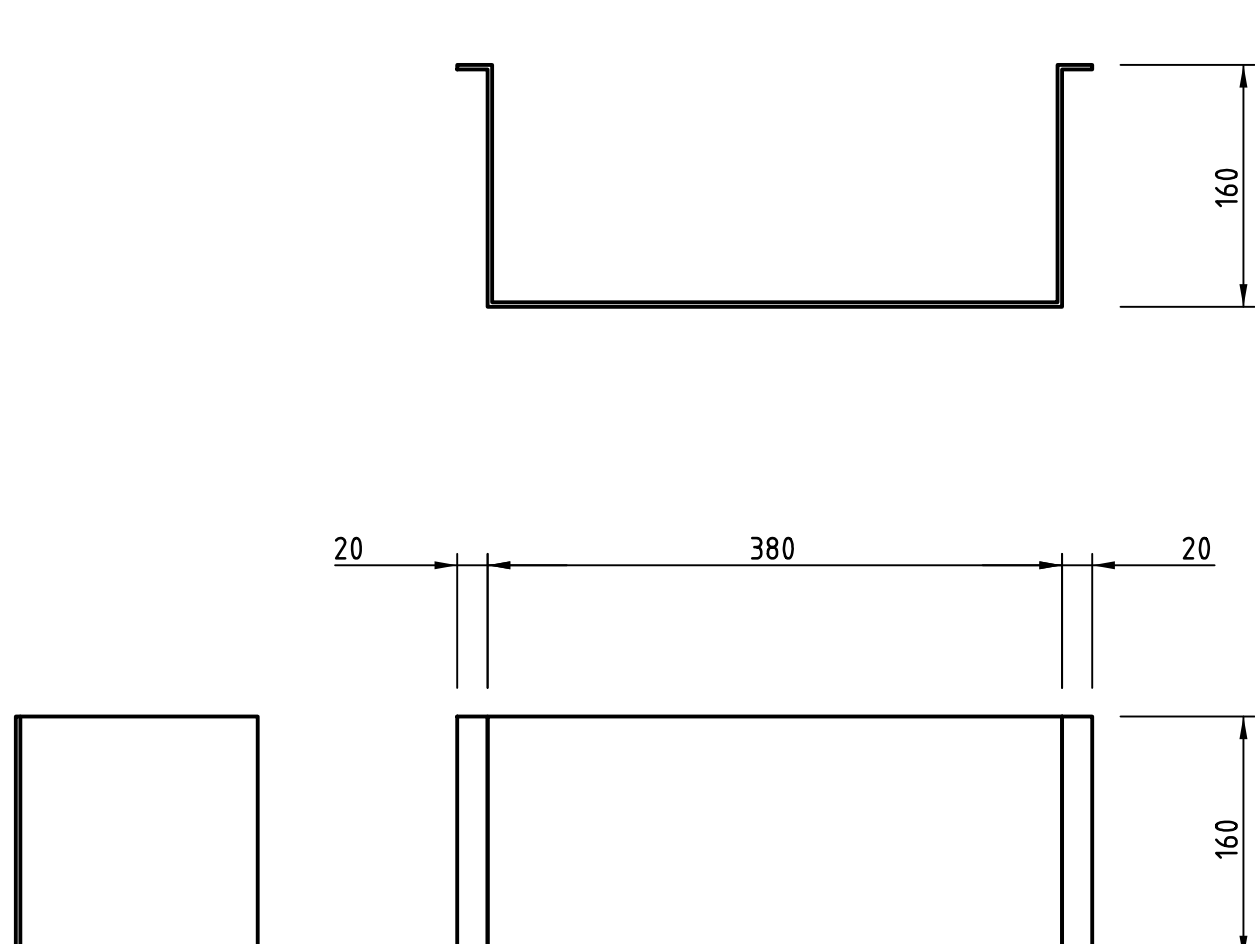

MAIN DISTRIBUTION COMPARTMENT -
CT TOP HAT DETAILS

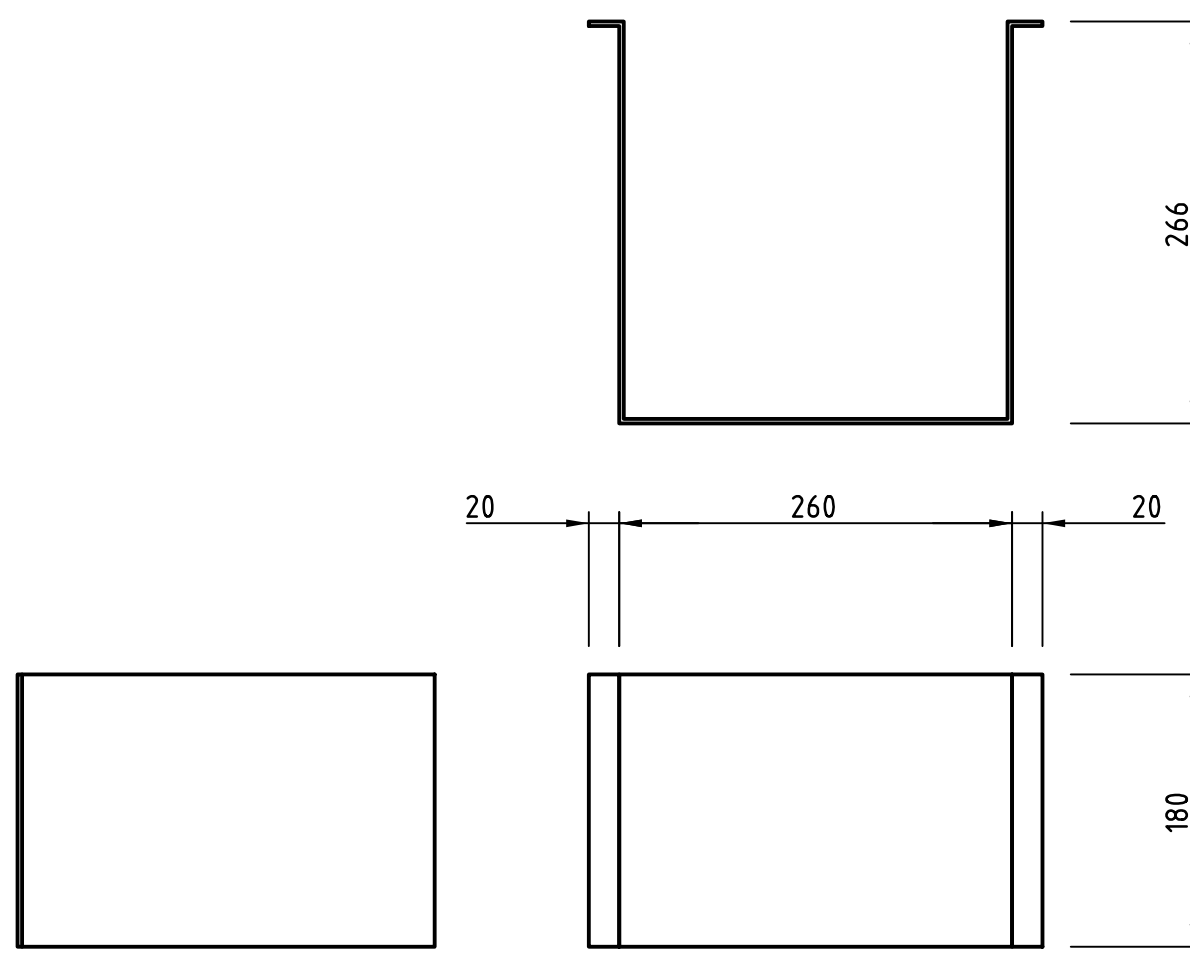

MAIN DISTRIBUTION COMPARTMENT -
DISTRIBUTION BOARD 2 MAIN SWITCH TOP HAT DETAILS

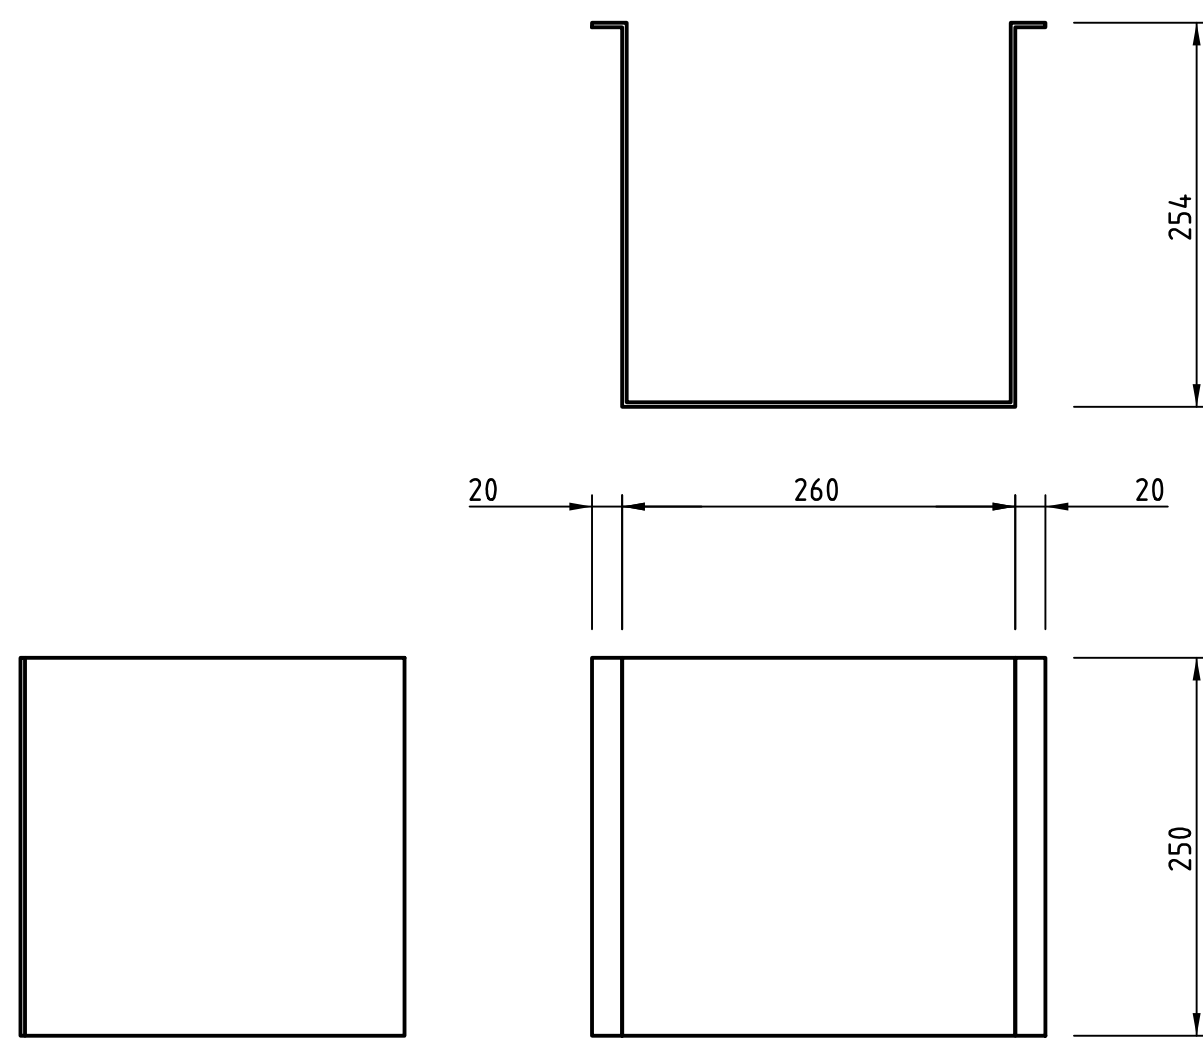

MAIN DISTRIBUTION COMPARTMENT -
DISTRIBUTION BOARD 2 TOP HAT DETAILS

REVISIONS					REFERENCES			
	3	18/5/21	SCOMEK SWITCH CHANGED TO 4 POLE.			P.S.		
	2	7/9/20	UPDATED DRAWING SHEETS.			P.S.		
	1	9/10/13	REVISED DRAWING.			M.B.		
	0	24/9/12	INITIAL ISSUE.			P.J.	A1-52770	STD SPS - PUMP STN 30kW TO 160kW (VSD) - CT METERED - I & C - DRG INDEX
No.	DATE	DESCRIPTION		APP'D	PLAN No.	TITLE		

DESIGNED BY:



OPTIMUM
DRAFTING PTY LTD
A.B.N. 28 065 272 942

DO NOT SCALE

GIPPSLAND WATER
DRAWING STATUS

STANDARD DRAWING


GIPPSLAND WATER FACILITY CODE
XXCPXX

CERTIFICATION OF
COMPLIANCE WITH
GIPPSLAND WATER'S
DESIGN & DRAFTING
REQUIREMENTS.

DESIGNED:
25/01/2018 - STD DRG

DRAWN:
25/01/2018 - OPT/CT

CHECKED:
25/01/2018 - P STEWART



GIPPSLAND WATER

DRAWING No. A1-52811

REV. 3

STANDARD SEWERAGE PUMP STATION
PUMP STATION 30kW TO 160kW (VSD) - CT METERED
SUPPLY CUBICLE - MAIN DISTRIBUTION GEAR TRAY
& ESCUTCHEON DOOR LAYOUT - 45kW - SHEET 3 OF 3