


NOTE:
DO NOT PAINT OR POWDER COAT
THE VSD/PHF GEAR TRAY

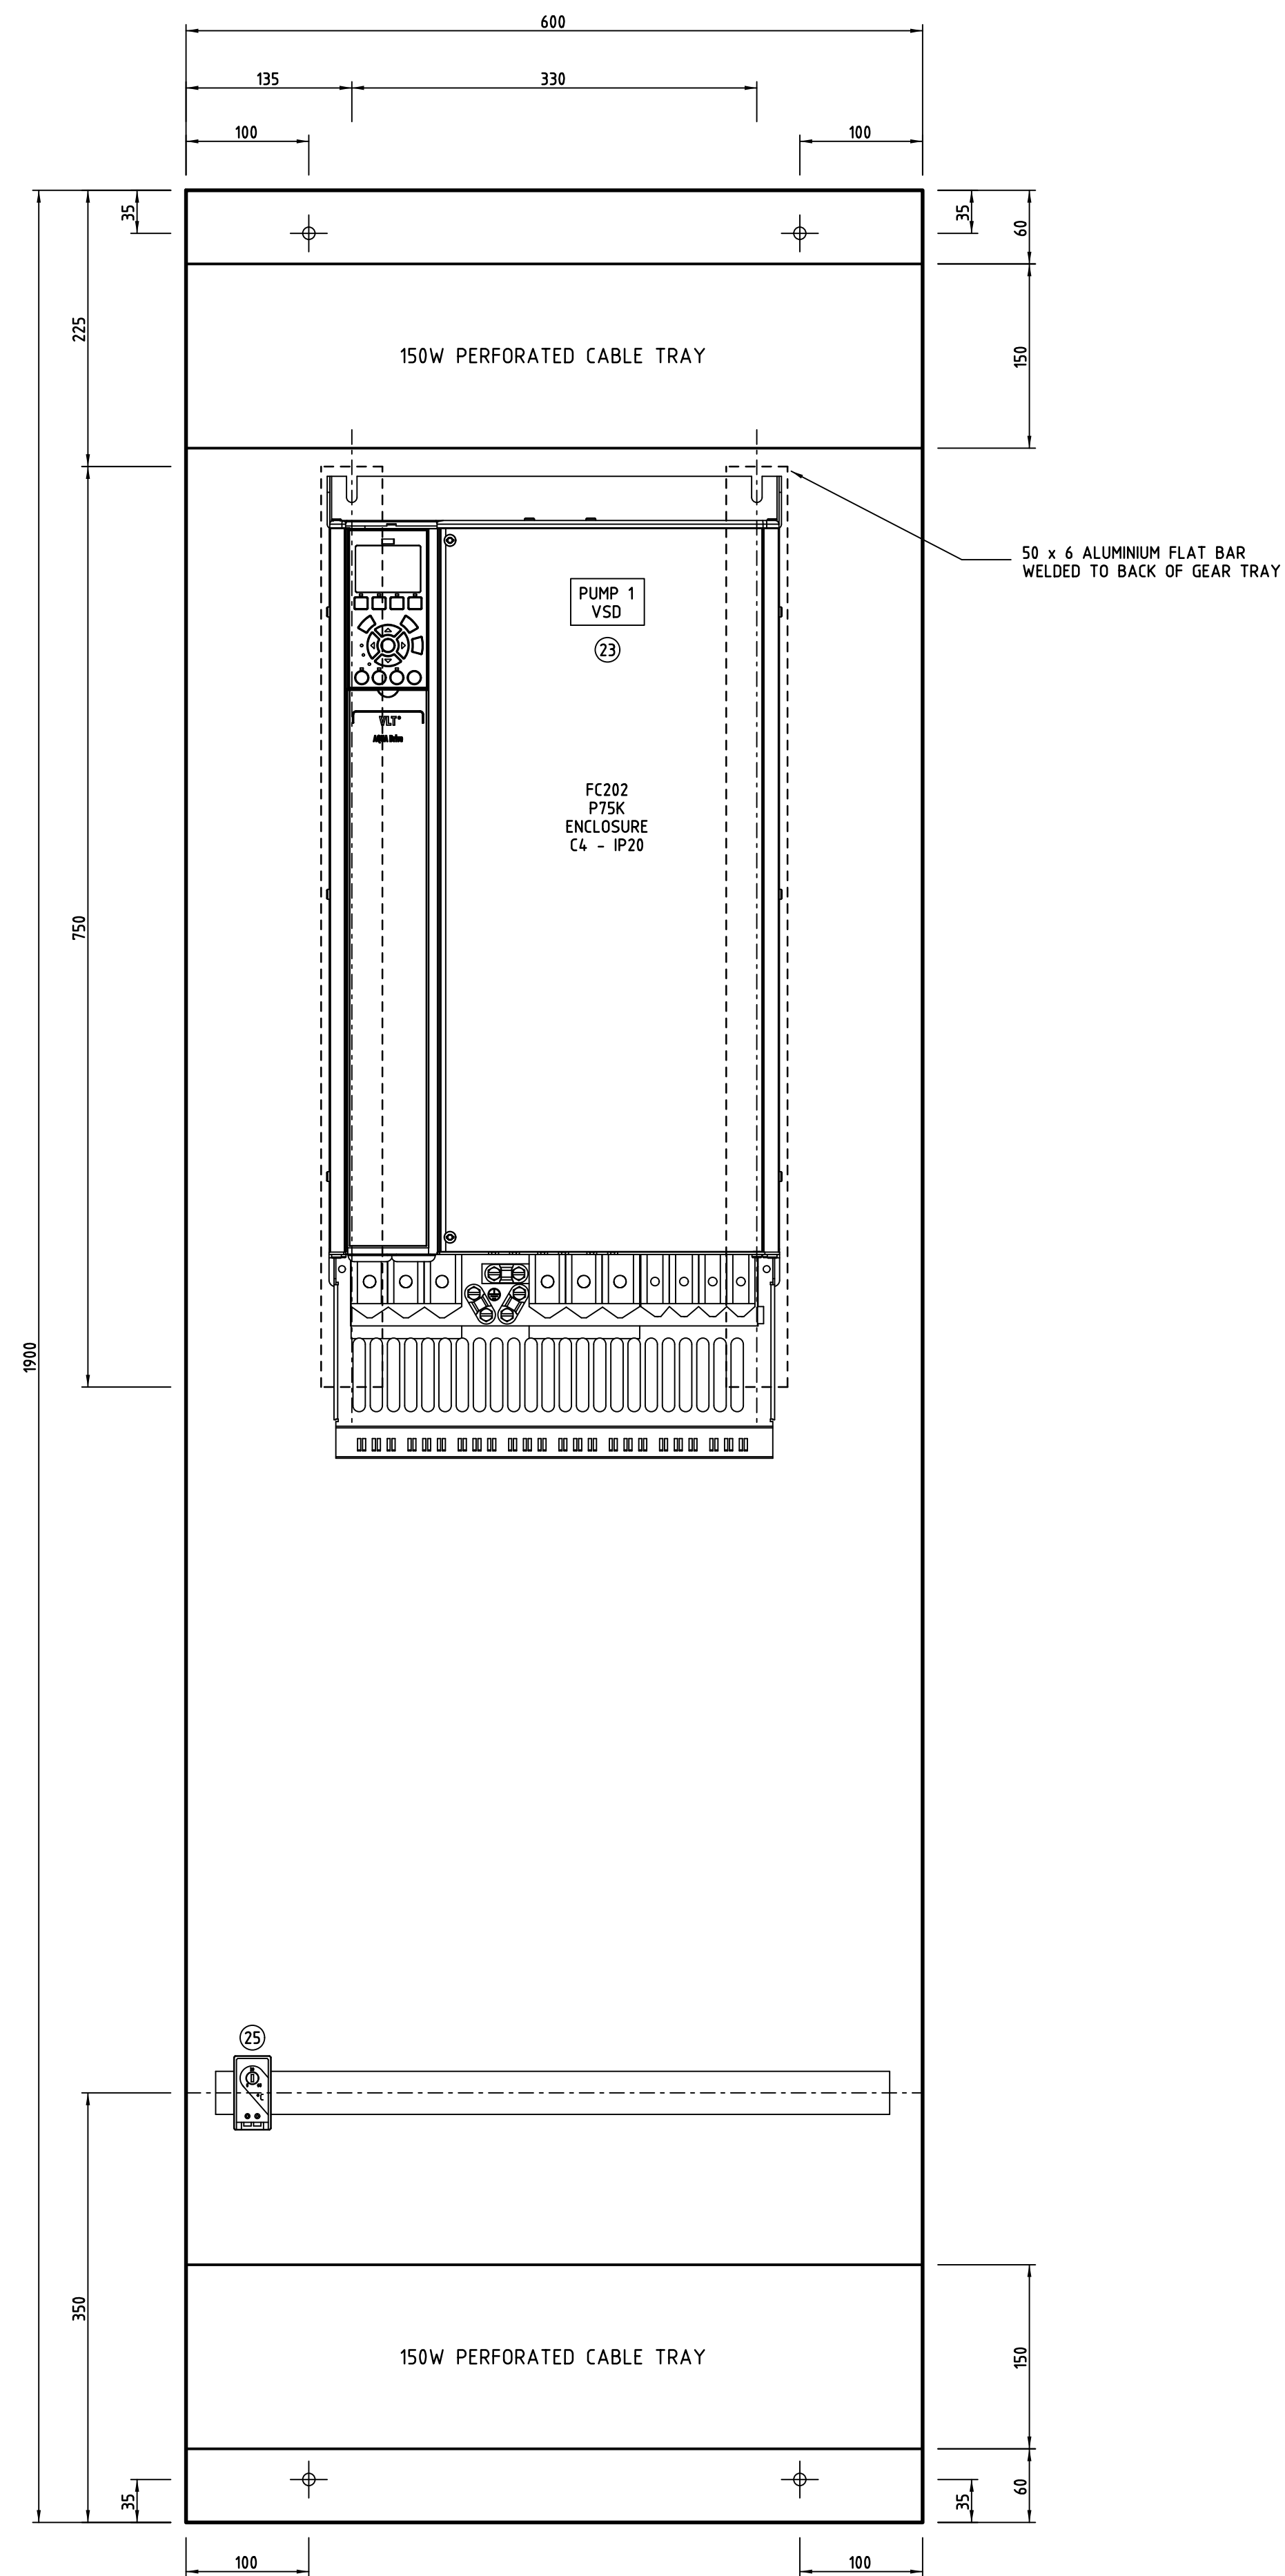

REVISIONS

No.	DATE	DESCRIPTION	APP'D
4	10/10/21	REVISED DRAWING TITLE.	P.S.
3	7/9/20	UPDATED DRAWING SHEETS.	P.S.
2	9/10/13	REVISED DRAWING.	M.B.
1	18/3/13	REVISED PUMP 1 VSD.	P.J.
0	24/9/12	INITIAL ISSUE.	P.J.

REFERENCES	PLAN No.	TITLE
A1-52770	STD SPS - PUMP STN 30kW TO 160kW (VSD) - CT METERED - I & C - DRG INDEX	

DESIGNED BY:



DO NOT SCALE	GIPPSLAND WATER DRAWING STATUS	STANDARD DRAWING	GIPPSLAND WATER FACILITY CODE XXCPXX
CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.		DRAWING No. A1-52832 REV. 4	
DESIGNED: 25/01/2018 - STD DRG		STANDARD SEWAGE PUMP STATION PUMP STATION 30kW TO 160kW (VSD) - CT METERED VSD P75K & AHF 130B1207 (133A) GEAR TRAY LAYOUT	
DRAWN: 25/01/2018 - OPT/CT			
CHECKED: 25/01/2018 - P STEWART			