


MOTOR CABLE SIZE	
MOTOR RATING	CABLE SIZE
UP TO, & 7.5kW	4mm <sup>2</sup>
11kW	4mm <sup>2</sup>
15kW	6mm <sup>2</sup>
18.5kW	10mm <sup>2</sup>
22kW	10mm <sup>2</sup>

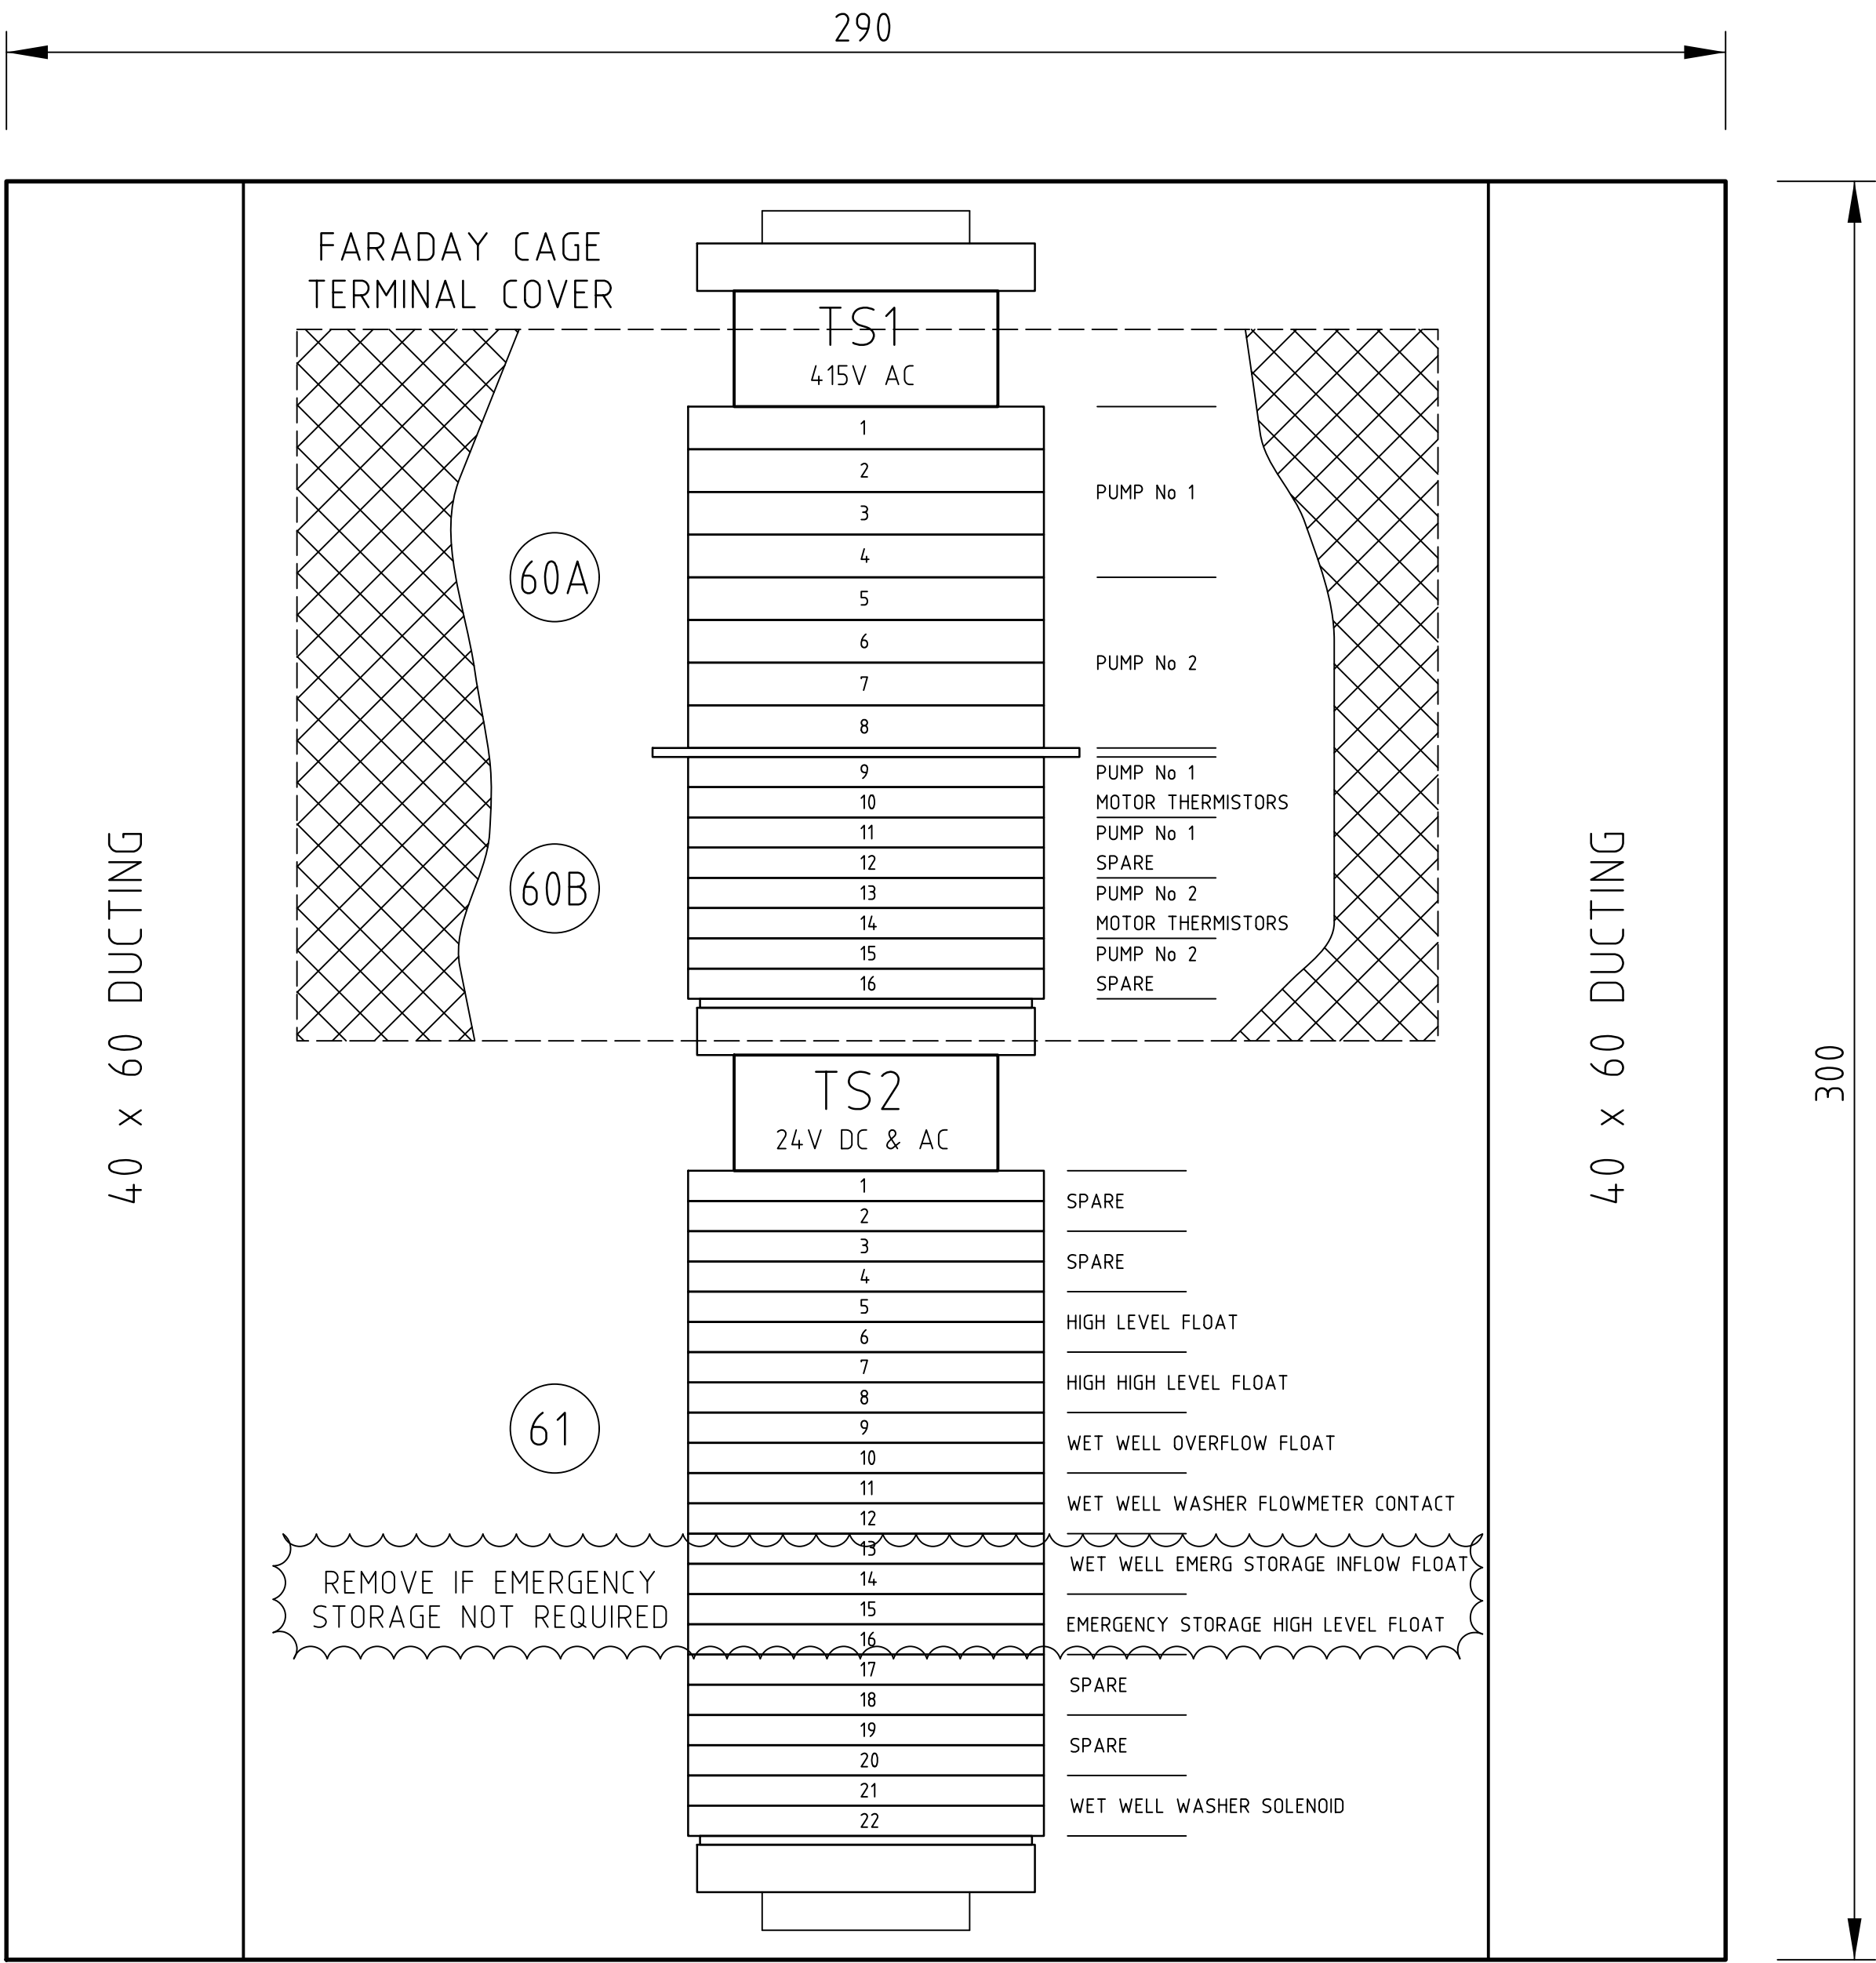

REVISIONS					REFERENCES		
	No.	DATE	DESCRIPTION	APP'D		PLAN No.	TITLE
	7	29/3/21	ADDED EMERGENCY STORAGE DETAILS & RE-DRAWN IN DGN FORMAT.	P.S.			

DESIGNED BY:

OPTIMUM  
DRAFTING PTY LTD  
A.B.N. 28 065 272 942

DO NOT SCALE

CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.  
DESIGNED: 19/04/2010 - GW/STD  
DRAWN: 29/03/2021 - OPT/RJ  
CHECKED: 31/03/2021 - P STEWART

GIPPSLAND WATER

STANDARD SEWERAGE PUMP STATION  
PUMP STATION 7.5kW TO 22kW (VSD) - DIRECT METERED  
JUNCTION BOX COMPARTMENT  
GEAR TRAY LAYOUT

GIPPSLAND WATER FACILITY CODE  
XXCPXX

DRAWING No.  
A1-47805

REV.  
7