



24V DC SUPPLY FROM 24VDC3 CB
CONTINUED ON DRG A1-47782 LINE 6

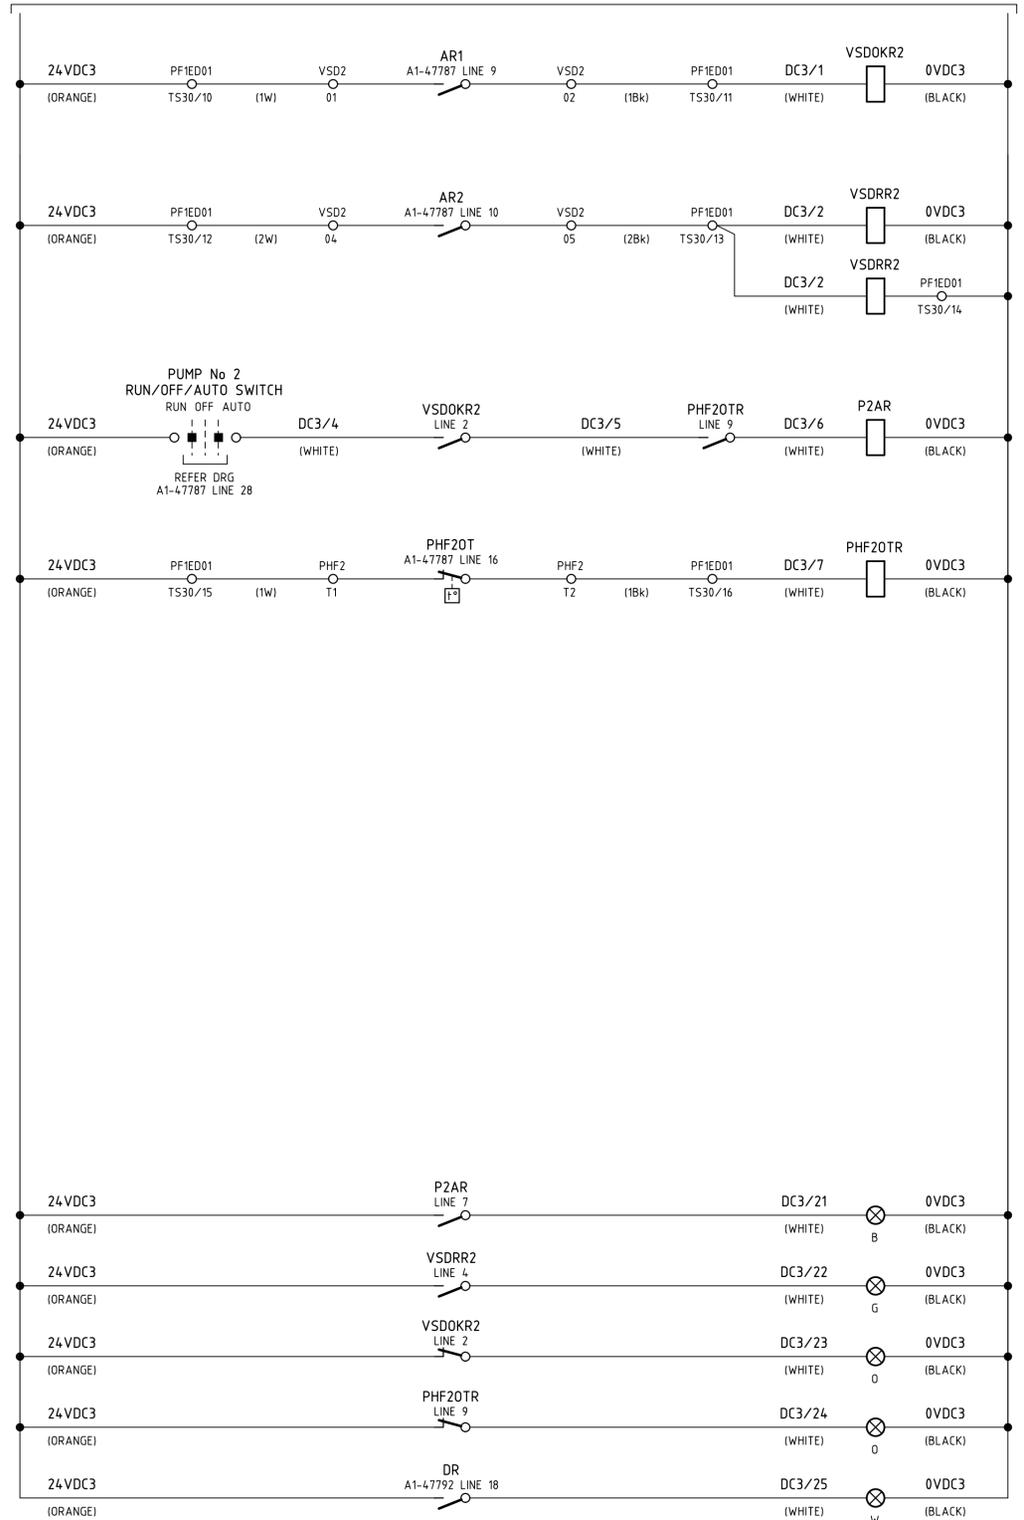

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25

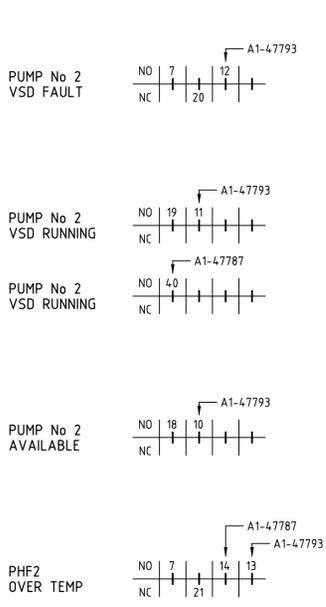

PUMP No 2
VSD FAULT

PUMP No 2
VSD RUNNING

PUMP No 2
VSD RUNNING

PUMP No 2
AVAILABLE

PHF2
OVER TEMP

26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50

REVISIONS	No.	DATE	DESCRIPTION	APP'D	REFERENCES	PLAN No.	TITLE
	9	29/3/21	RE-DRAWN IN DGN FORMAT.		P.S.	A1-47775	STD SPS - PUMP STN 7.5kW TO 22kW (VSD) - DIRECT METERED - I & C - DRG INDEX

DESIGNED BY:

DO NOT SCALE	GIPPSLAND WATER DRAWING STATUS	STANDARD DRAWING	GIPPSLAND WATER FACILITY CODE XXCPXX
CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS. DESIGNED: 19/04/2010 - GW/STD DRAWN: 29/03/2021 - OPT/RJ CHECKED: 31/03/2021 - P STEWART		GIPPSLAND WATER STANDARD SEWERAGE PUMP STATION PUMP STATION 7.5kW TO 22kW (VSD) - DIRECT METERED PUMP No 2 (QB1PP02) ELECTRICAL SCHEMATIC DIAGRAM - SHEET 2 OF 2	DRAWING No. A1-47788 REV. 9