
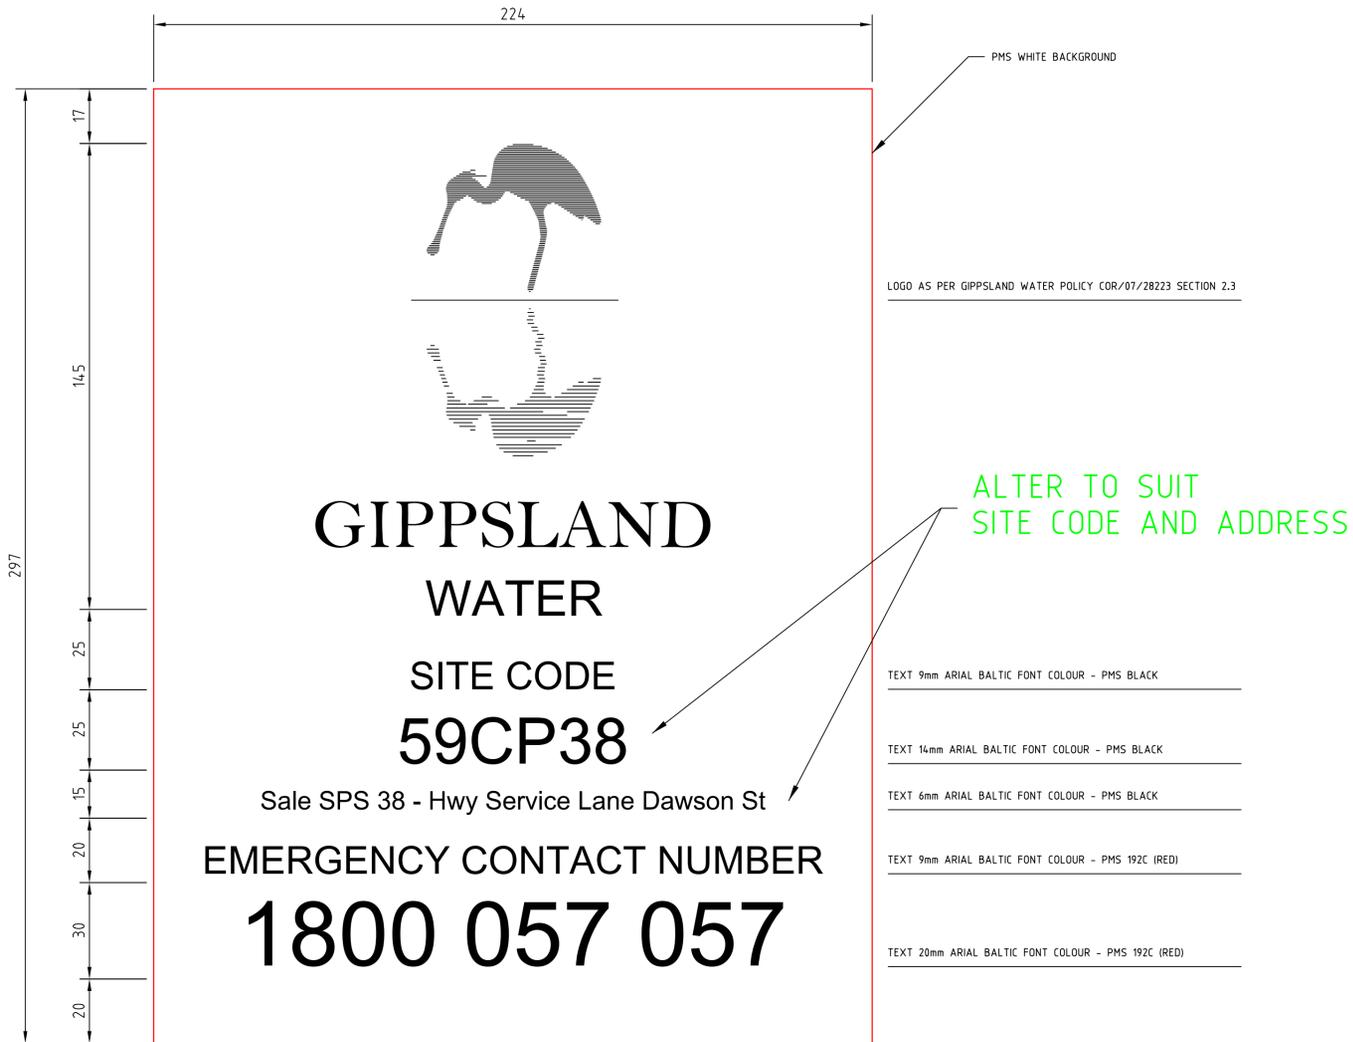


NOTES

1. BACKGROUND MATERIAL TO BE DETERMINED BY SITE ENGINEER.
2. ALL COLOURS ARE TO MATCH THE PANTONE COLOUR CHART.
3. CORPORATE LOGO AND COLOURS TAKEN FROM GIPPSLAND WATER VISUAL STANDARDS MANUAL COR/07/28223.


SAMPLE NAME PLATE LABEL

LOCATED BELOW MAIN SWITCH ON ESCUTCHEON DOOR

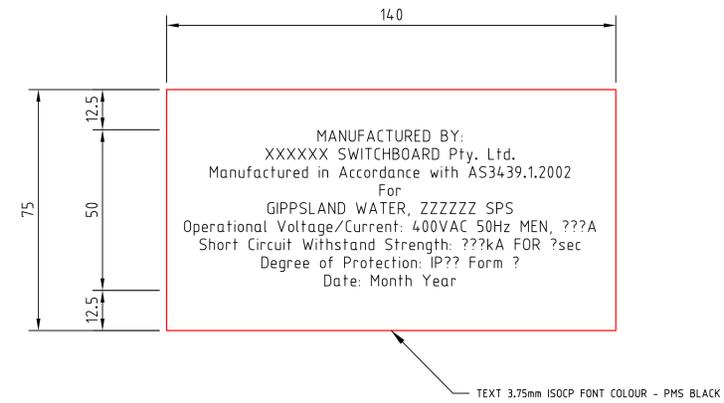

SAMPLE DOOR LABEL

LOCATED ON OUTSIDE OF INSTRUMENT DOOR

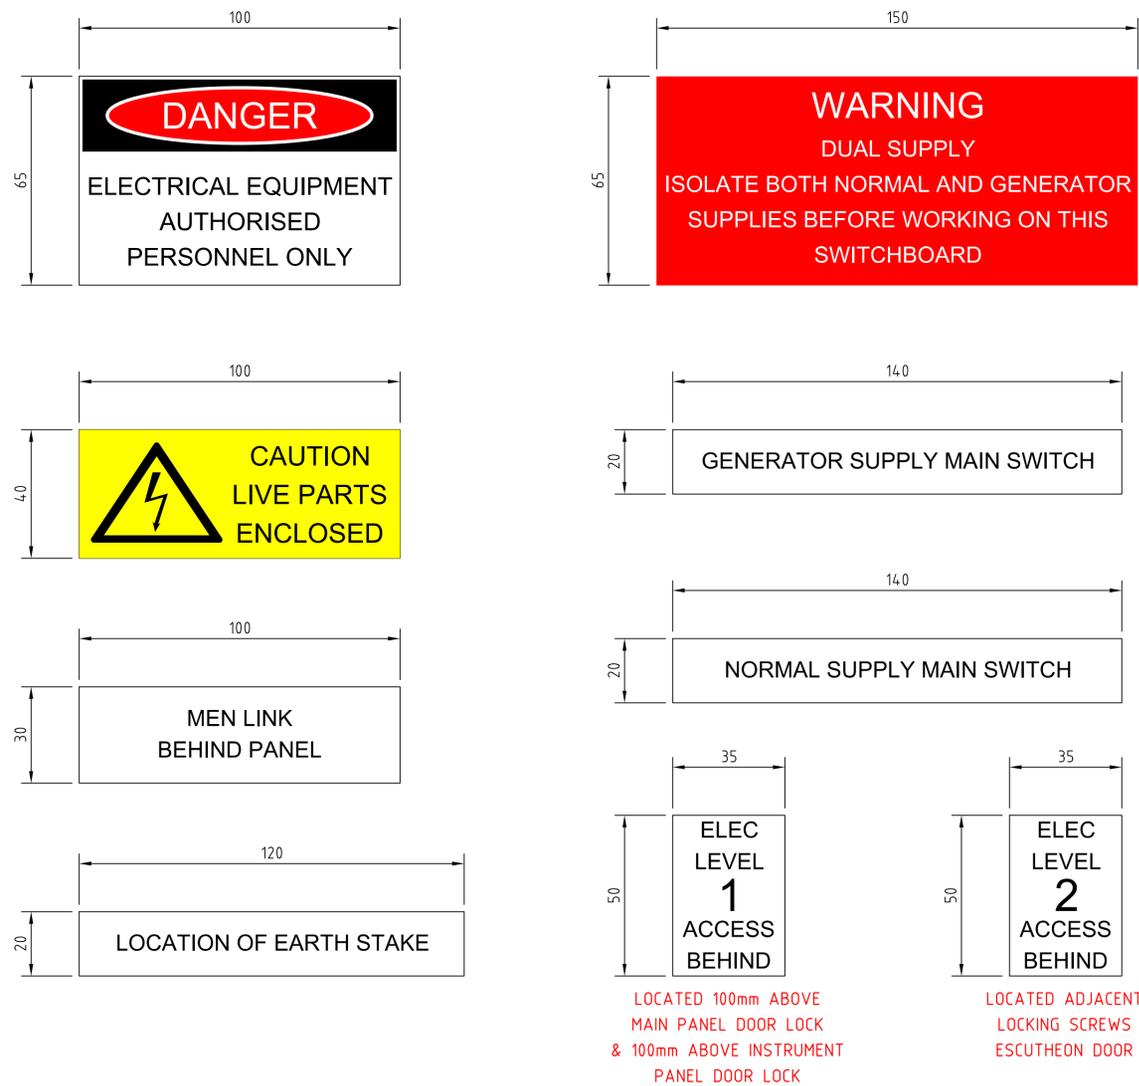

LOCATED 100mm ABOVE MAIN PANEL DOOR LOCK & 100mm ABOVE INSTRUMENT PANEL DOOR LOCK

LOCATED ADJACENT LOCKING SCREWS ESCUTHEON DOOR

REVISIONS	No.	DATE	DESCRIPTION	APP'D	REFERENCES	PLAN No.	TITLE
	6	29/3/21	ADDED LEVEL 1 / LEVEL 2 ACCESS LABELS & RE-DRAWN IN DGN FORMAT.	P.S.	A1-47775	STD SPS - PUMP STN 7.5kW TO 22kW (VSD) - DIRECT METERED - I & C - DRG INDEX	

DESIGNED BY:

A.B.N. 28 065 272 942

DO NOT SCALE	GIPPSLAND WATER DRAWING STATUS	STANDARD DRAWING	GIPPSLAND WATER FACILITY CODE XXCPXX
CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS. DESIGNED: 19/04/2010 - GW/STD DRAWN: 29/03/2021 - OPT/RJ CHECKED: 31/03/2021 - P STEWART		GIPPSLAND WATER STANDARD SEWERAGE PUMP STATION PUMP STATION 7.5kW TO 22kW (VSD) - DIRECT METERED PUMP STATION CUBICLE DOOR LABEL DETAILS	
		DRAWING No.	REV.
		A1-47808	6