



24V DC SUPPLY FROM 24VDC2 CB
CONTINUED ON DRG A1-47782 LINE 4

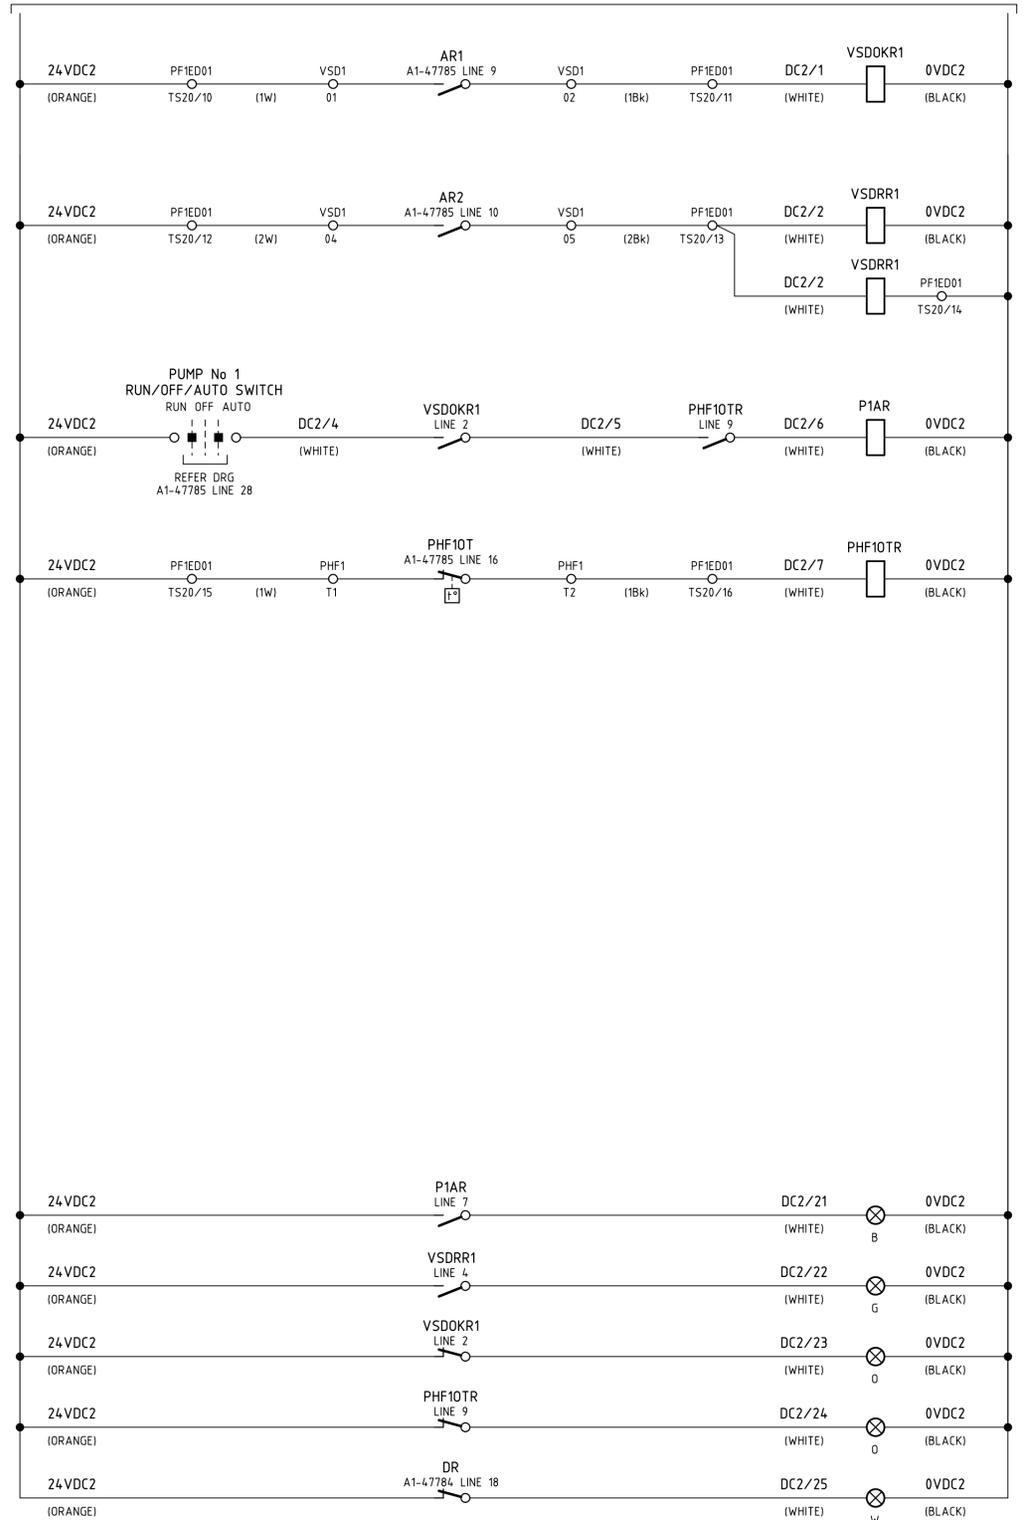

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25

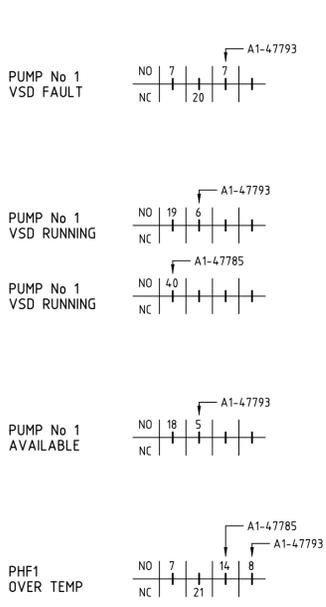

PUMP No 1 VSD FAULT
PUMP No 1 VSD RUNNING
PUMP No 1 VSD RUNNING
PUMP No 1 AVAILABLE
PHF1 OVER TEMP
PUMP No 1 AVAILABLE INDICATION
PUMP No 1 RUNNING INDICATION
PUMP No 1 VSD FAULT INDICATION
PUMP No 1 PHF OVER TEMP INDICATION
PUMP No 1 DUTY INDICATION

26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50

No.	DATE	DESCRIPTION	APP'D	REFERENCES	
				PLAN No.	TITLE
9	29/3/21	RE-DRAWN IN DGN FORMAT.	P.S.	A1-47775	STD SPS - PUMP STN 7.5kW TO 22kW (VSD) - DIRECT METERED - I & C - DRG INDEX

DESIGNED BY:

A.B.N. 28 065 272 942

DO NOT SCALE	GIPPSLAND WATER DRAWING STATUS	STANDARD DRAWING	GIPPSLAND WATER FACILITY CODE XXCPXX
CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS. DESIGNED: 19/04/2010 - GW/STD DRAWN: 29/03/2021 - OPT/RJ CHECKED: 31/03/2021 - P STEWART		GIPPSLAND WATER STANDARD SEWERAGE PUMP STATION PUMP STATION 7.5kW TO 22kW (VSD) - DIRECT METERED PUMP No 1 (QB1PP01) ELECTRICAL SCHEMATIC DIAGRAM - SHEET 2 OF 2	DRAWING No. A1-47786 REV. 9