


**ACE3600 RTU
SLOT 1/I/O-ID1** ERR

MOTOROLA ACE3600 RTU
MIXED I/O
(16 DIGITAL IN; 4 EE DIGITAL OUT;
4 ANALOG IN: 4-20mA)
FLN 3572

ACE3600 RTU SLOT 1/I/O-ID1
MIXED I/O
INTERNAL 24VDC
POWER SUPPLY
FPN 5976

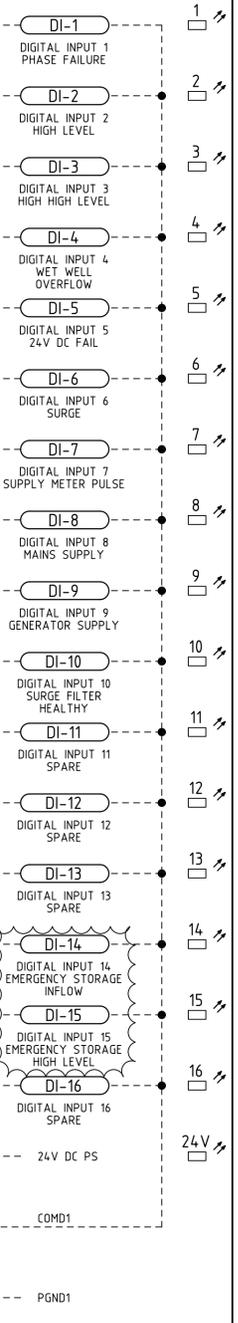

CONTINUED ON DRG A1-47792

| REVISIONS | DATE | DESCRIPTION | APP'D | REFERENCES | PLAN No. | TITLE |
|-----------|---------|--|-------|------------|---|-------|
| 10 | 29/3/21 | ADDED CIRCUITRY TO DI-8/DI-9/DI-10/DI-14/DI-15 & RE-DRAWN IN DGN FORMAT. | P.S. | A1-47775 | STD SPS - PUMP STN 7.5kW TO 22kW (VSD) - DIRECT METERED - I & C - DRG INDEX | |

DESIGNED BY:

OPTIMUM DRAFTING PTY LTD
A.B.N. 28 065 272 942

DO NOT SCALE GIPPSLAND WATER DRAWING STATUS **STANDARD DRAWING** GIPPSLAND WATER FACILITY CODE **XXCPXX**

CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.

DESIGNED: 19/04/2010 - GW/STD
DRAWN: 29/03/2021 - OPT/RJ
CHECKED: 31/03/2021 - P STEWART

GIPPSLAND WATER
DRAWING No. **A1-47791** REV. **10**

STANDARD SEWERAGE PUMP STATION
PUMP STATION 7.5kW TO 22kW (VSD) - DIRECT METERED
'ACE3600' TELEMETRY SLOT 1 - MIXED I/O CARD
ELECTRICAL SCHEMATIC DIAGRAM - SHEET 1 OF 2