


39
40
41
42
43
44
45

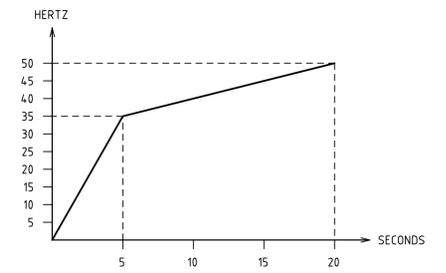

NOTE 2
RTU EMERGENCY STARTS INITIATES RUN AT JOG FREQUENCY.
SET JOG FREQUENCY TO MAXIMUM ALLOWABLE FREQUENCY.

NOTE 3
VSD LOCKED OUT WHEN PHF OVERTEMP OPFIED01URS.

1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30 31 32 33 34 35 36 37 38

REVISIONS No. DATE DESCRIPTION APP'D	11 29/3/21 ADDED LEVEL SENSOR INHIBIT RELAY CONTACT & RE-DRAWN IN DGN FORMAT. P.S.	REFERENCES A1-47775 STD SPS - PUMP STN 7.5kW TO 22kW (VSD) - DIRECT METERED - I & C - DRG INDEX	DESIGNED BY:		DO NOT SCALE	GIPPSLAND WATER DRAWING STATUS	STANDARD DRAWING	GIPPSLAND WATER FACILITY CODE XXCPXX
	DRAWN: 29/03/2021 - OPT/RJ CHECKED: 31/03/2021 - P STEWART						DRAWING No. A1-47787 REV. 11	
				STANDARD SEWERAGE PUMP STATION PUMP STATION 7.5kW TO 22kW (VSD) - DIRECT METERED PUMP No 2 (QB1PP02)		ELECTRICAL SCHEMATIC DIAGRAM - SHEET 1 OF 2		