

FIELD DEVICE









INSTRUMENT COMPARTMENT

SEWERAGE PUMP STATION
CONTROL & DISTRIBUTION COMPT ESCUTCHEON DOOR


TELEMETRY COMPARTMENT

CONTROL & DISTRIBUTION COMPT

1
2
3 WET WELL LEVEL
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23 DISCHARGE FLOW
24
25

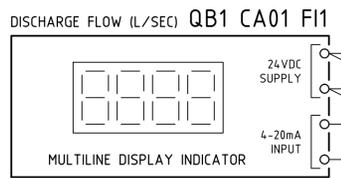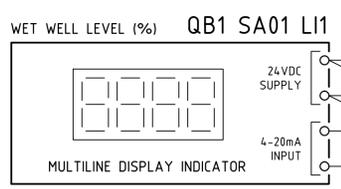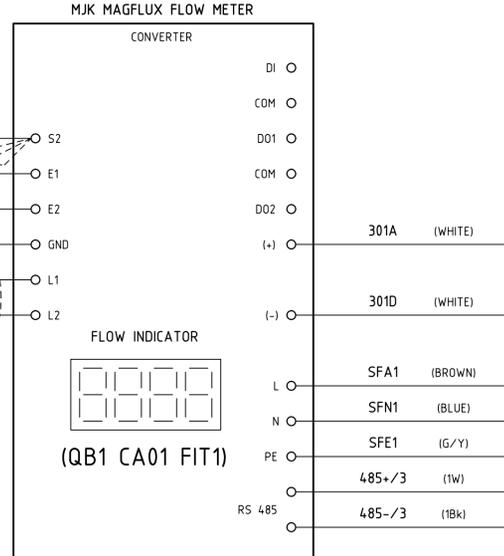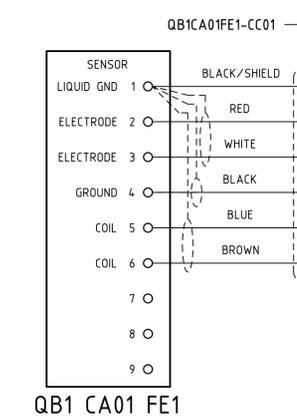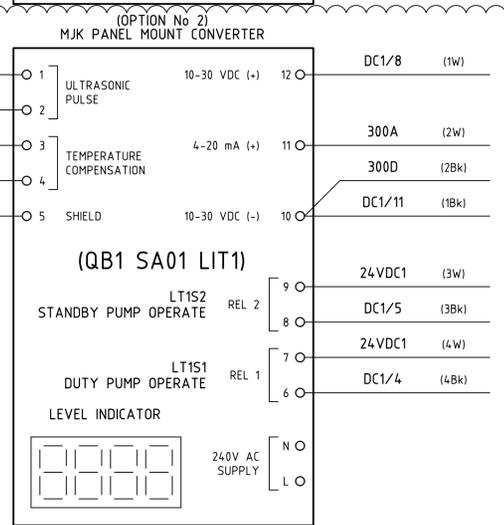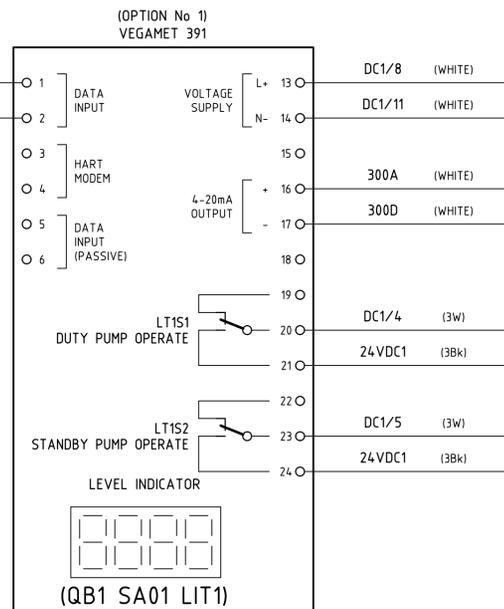

REMOVE IF EMERGENCY STORAGE NOT REQUIRED
24V DC SUPPLY CONTINUED ON DRG A1-72832 LINE 9

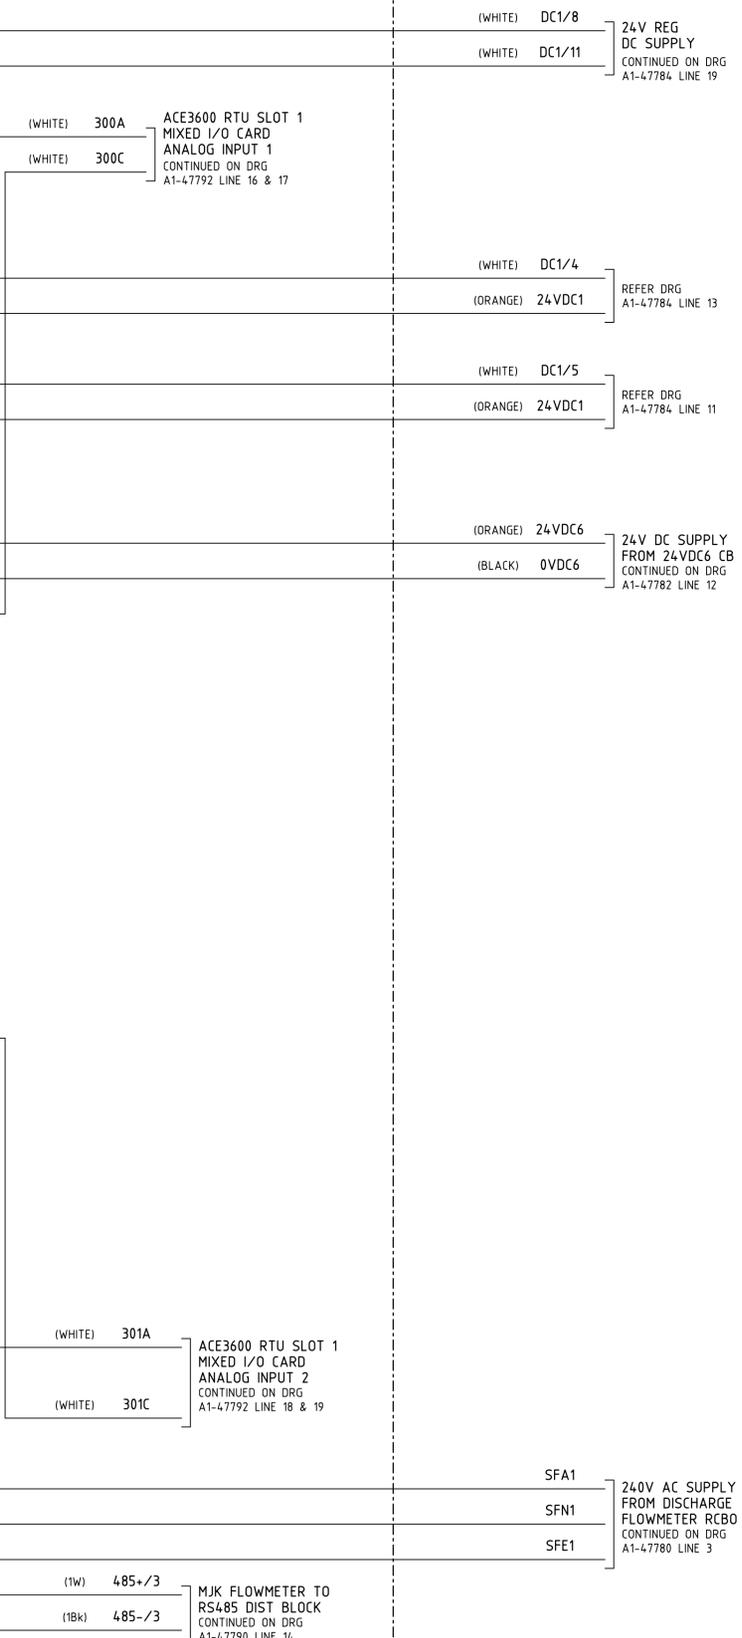

REVISIONS	No.	DATE	DESCRIPTION	APP'D
	12	29/3/21	REVISED OPTION No 1 & No 2 SET UP & RE-DRAWN IN DGN FORMAT.	P.S.

REFERENCES	PLAN No.	DESCRIPTION	TITLE
	A1-47775	STD SPS - PUMP STN 7.5kW TO 22kW (VSD) - DIRECT METERED - I & C - DRG INDEX	

DESIGNED BY:

A.B.N. 28 065 272 942

DO NOT SCALE

GIPPSLAND WATER DRAWING STATUS: STANDARD DRAWING

GIPPSLAND WATER FACILITY CODE: XXCPXX

DRAWING No. A1-47796

REV. 12

CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.

DESIGNED: 19/04/2010 - GW/STD

DRAWN: 29/03/2021 - OPT/RJ

CHECKED: 31/03/2021 - P STEWART

STANDARD SEWERAGE PUMP STATION
PUMP STATION 7.5kW TO 22kW (VSD) - DIRECT METERED
INSTRUMENT LOOPS
ELECTRICAL SCHEMATIC DIAGRAM