


(OPTION No 1)
VEGAMET 391 LEVEL
TRANSMITTER

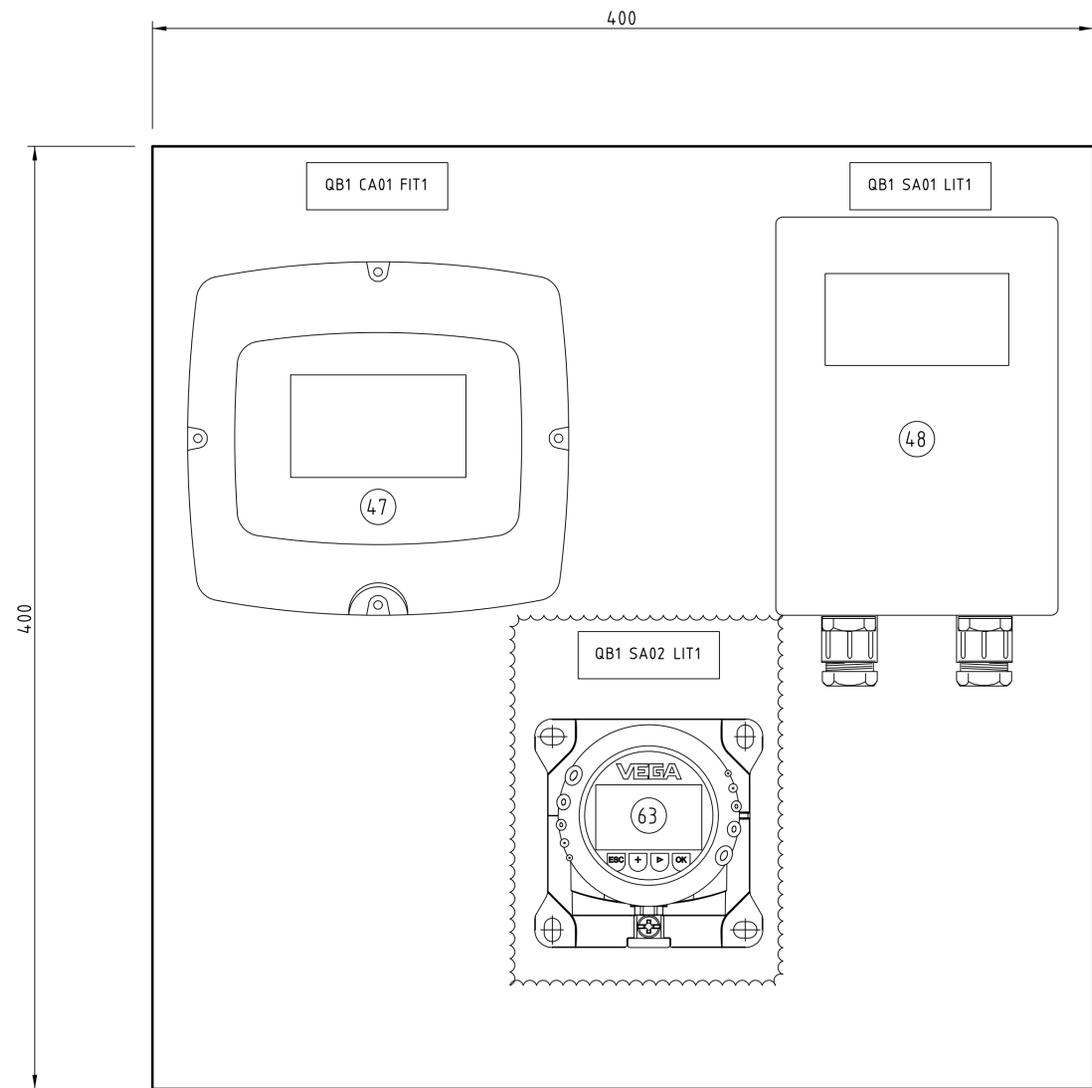

(OPTION No 2)
MJK SHUTTLE LEVEL
TRANSMITTER

NOTE:
VEGA RADAR LEVEL TRANSMITTER TO BE USED WHERE
THE WET WELL IS GREATER THAN 8m DEEP, OR THE
WET WELL IS LESS THAN 2m DIAMETER, OR THE
PUMPS ARE 22kW OR LARGER.

REVISIONS

No.	DATE	DESCRIPTION	APP'D
7	29/3/21	REVISED OPTION No 1 & No 2 SET UP / ADDED ITEM 61 & RE-DRAWN IN DGN FORMAT.	P.S.

REFERENCES

PLAN No.	TITLE
A1-47775	STD SPS - PUMP STN 7.5kw TO 22kw (VSD) - DIRECT METERED - I & C - DRG INDEX

DESIGNED BY:



DO NOT SCALE	GIPPSLAND WATER DRAWING STATUS	STANDARD DRAWING	GIPPSLAND WATER FACILITY CODE XXCPXX
CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS. DESIGNED: 19/04/2010 - GW/STD DRAWN: 29/03/2021 - OPT/RJ CHECKED: 31/03/2021 - P STEWART		GIPPSLAND WATER STANDARD SEWERAGE PUMP STATION PUMP STATION 7.5kw TO 22kw (VSD) - DIRECT METERED INSTRUMENT COMPARTMENT GEAR TRAY LAYOUT	
			DRAWING No. A1-47807 REV. 7