


NOTES:  
 1. RATINGS CHANGE WITH THE SIZE OF THE PUMP STATION REFER TO DRAWING A1-48319 FOR THESE FUSE & CIRCUIT BREAKER RATINGS.

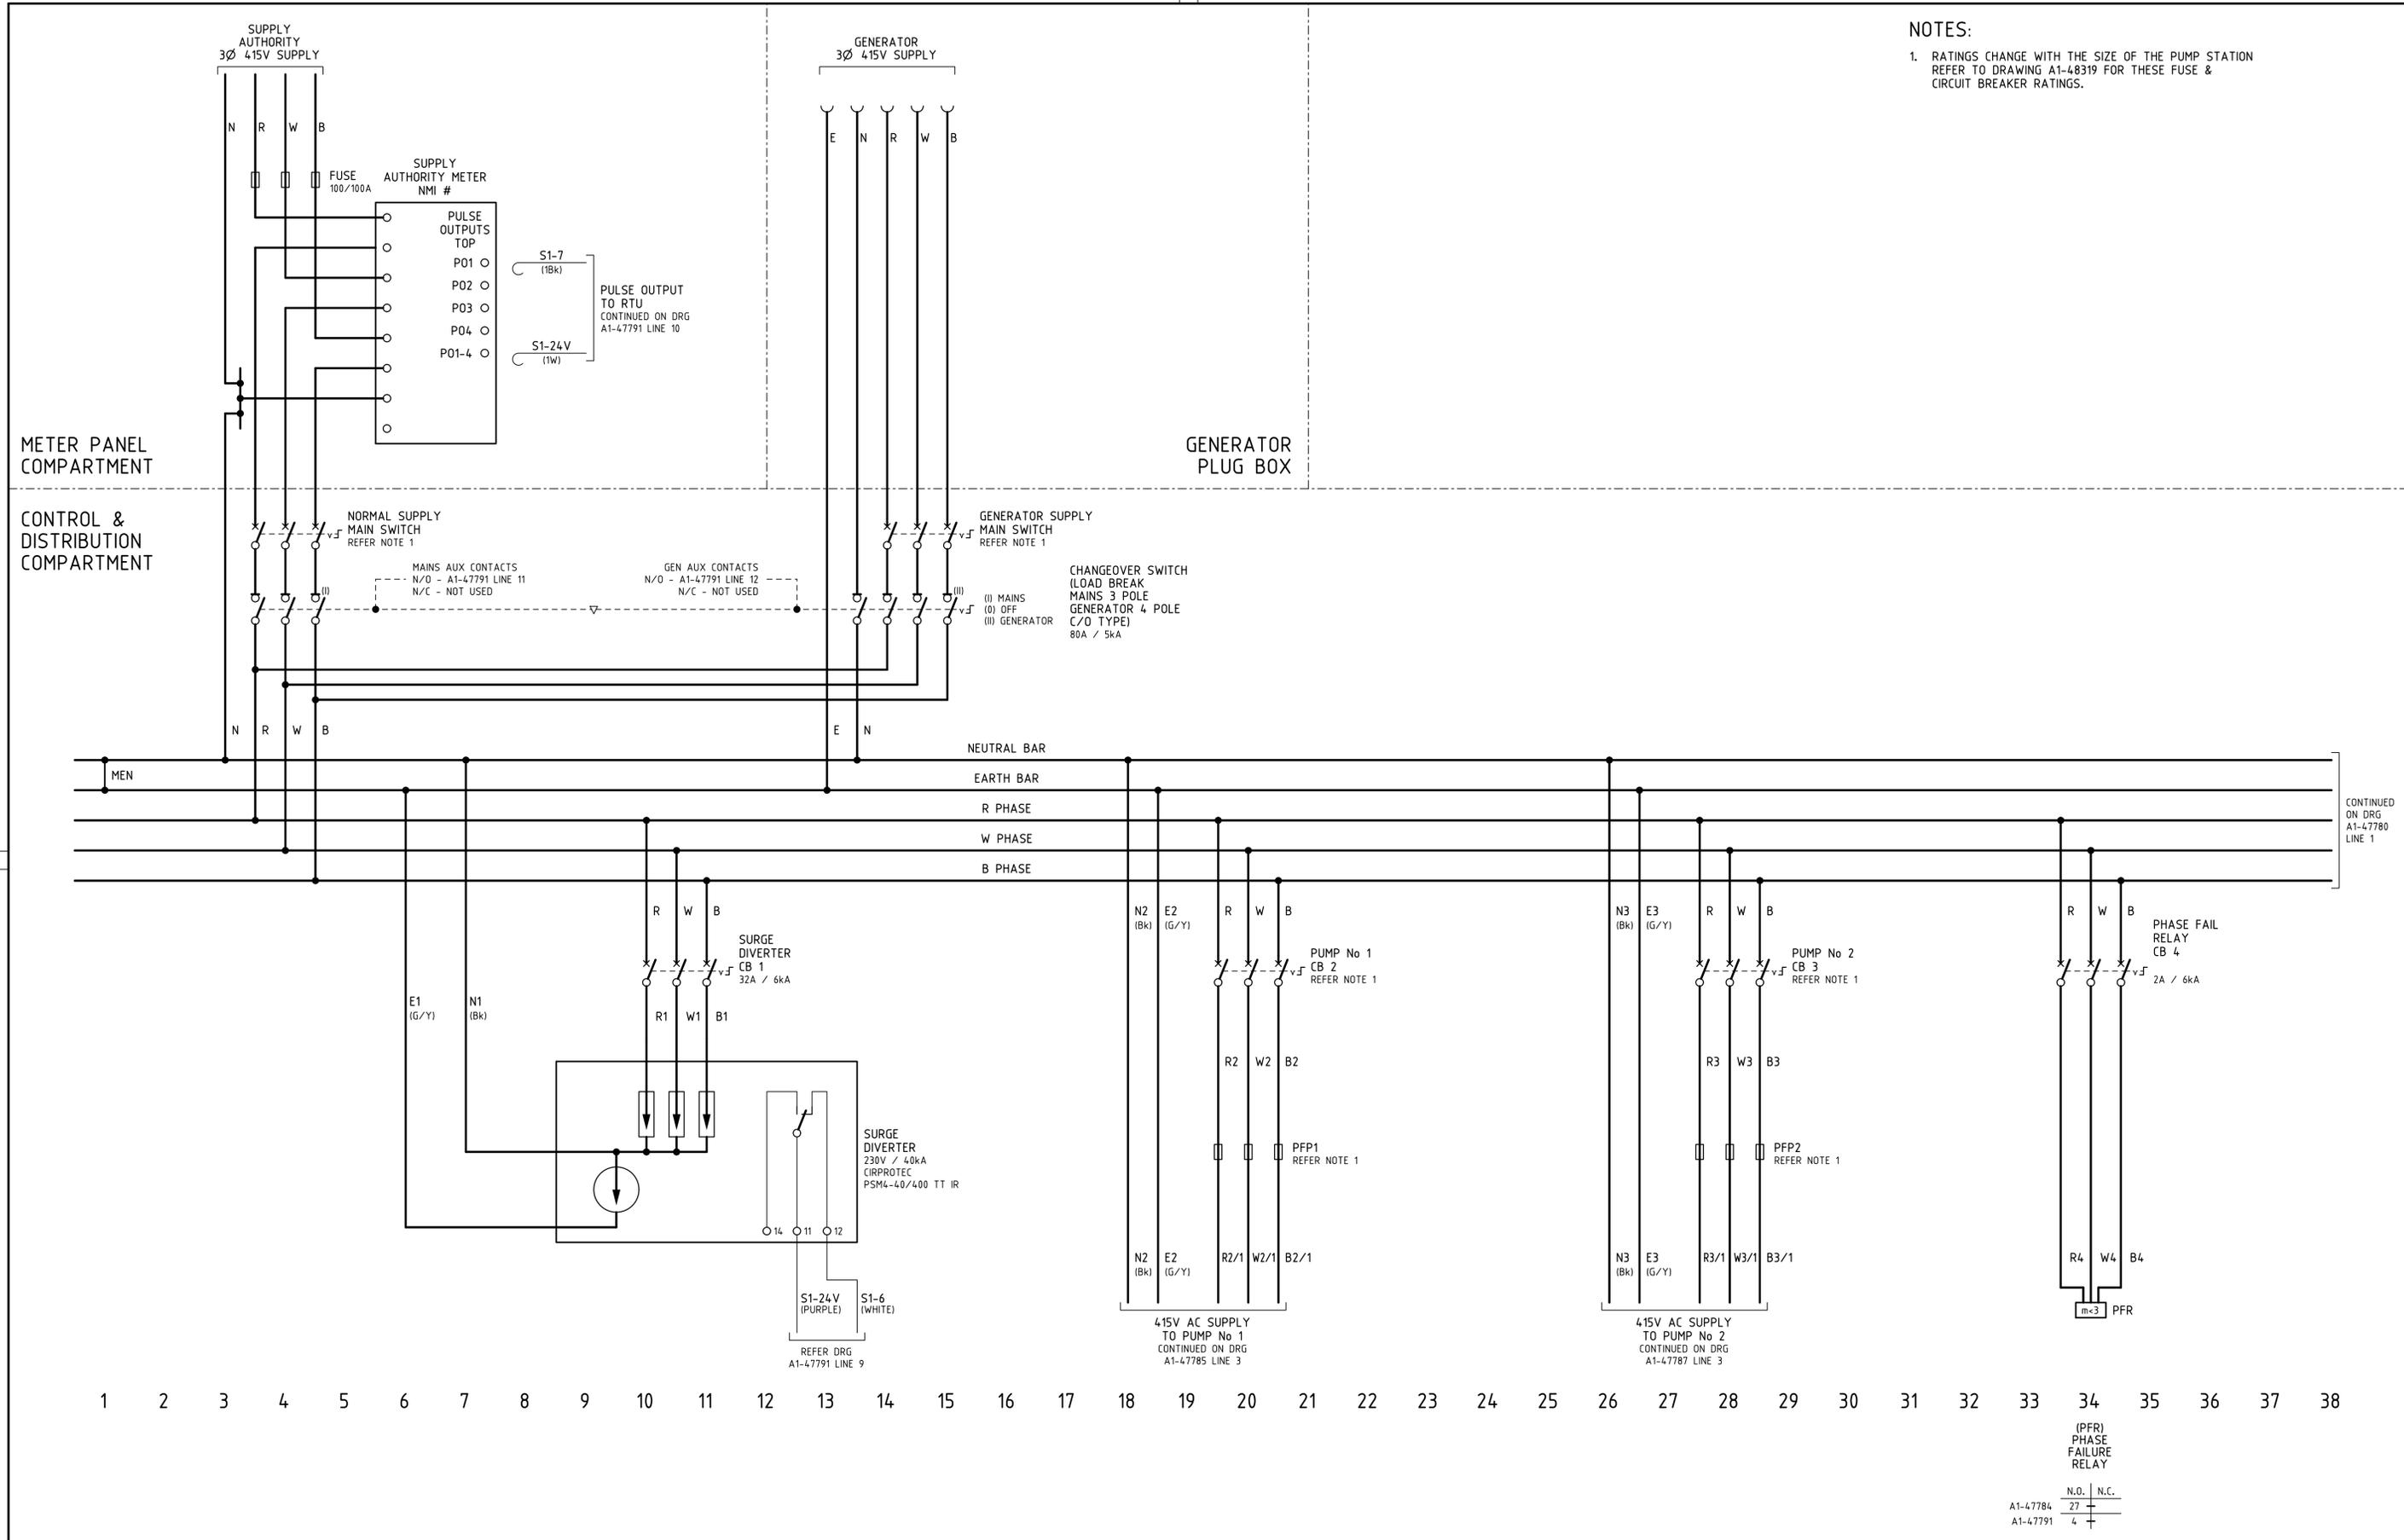

1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30 31 32 33 34 35 36 37 38

(PFR) PHASE FAILURE RELAY  
 A1-47784 27  
 A1-47791 4

REVISIONS	No.	DATE	DESCRIPTION	APP'D
	12	29/3/21	REVISED SURGE DIVERTER TYPE/ADDED AUX CONTS FOR C/O SW & RE-DRAWN IN DGN FORMAT.	P.S.

REFERENCES	PLAN No.	DESCRIPTION	TITLE
A1-47775	STD SPS - PUMP STN 7.5kW TO 22kW (VSD) - DIRECT METERED - I & C - DRG INDEX		

DESIGNED BY:

A.B.N. 28 065 272 942

DO NOT SCALE

GIPPSLAND WATER DRAWING STATUS: STANDARD DRAWING

GIPPSLAND WATER FACILITY CODE: XXCPXX

DRAWING No. A1-47779

REV. 12

CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.

DESIGNED: 19/04/2010 - GW/STD

DRAWN: 29/03/2021 - OPT/RJ

CHECKED: 31/03/2021 - P STEWART

STANDARD SEWERAGE PUMP STATION  
 PUMP STATION 7.5kW TO 22kW (VSD) - DIRECT METERED  
 POWER & CONTROL SUPPLIES  
 ELECTRICAL SCHEMATIC DIAGRAM - SHEET 1 OF 2