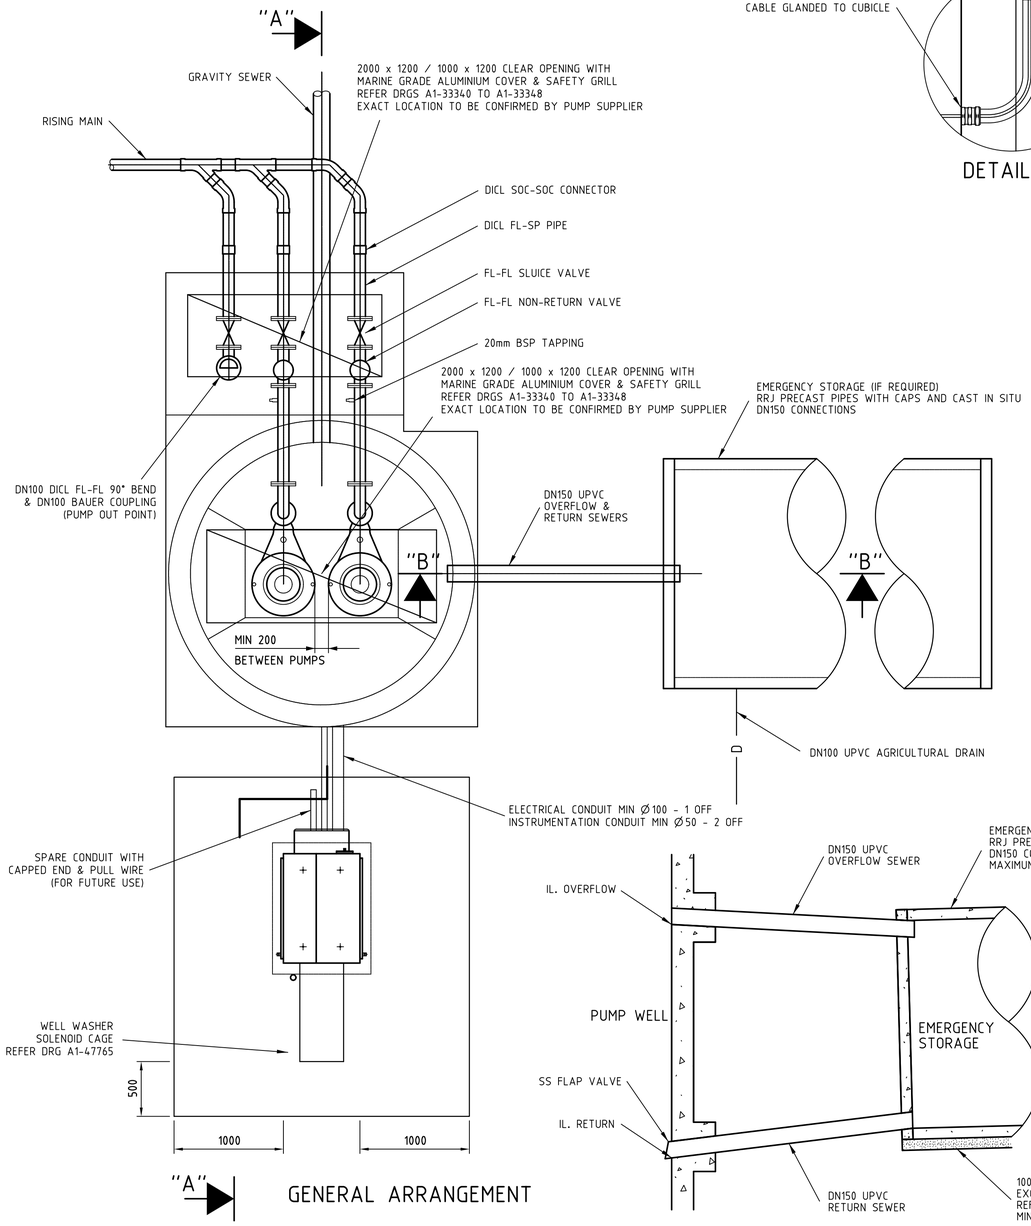

GENERAL ARRANGEMENT

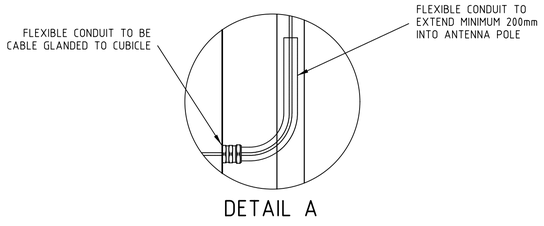

DETAIL A

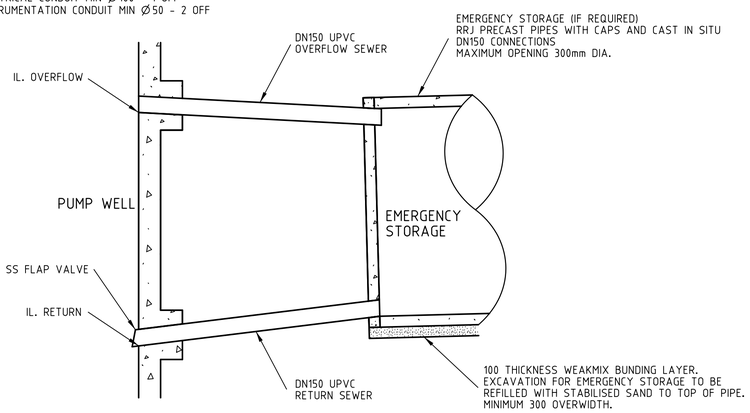

SECTION "B-B"

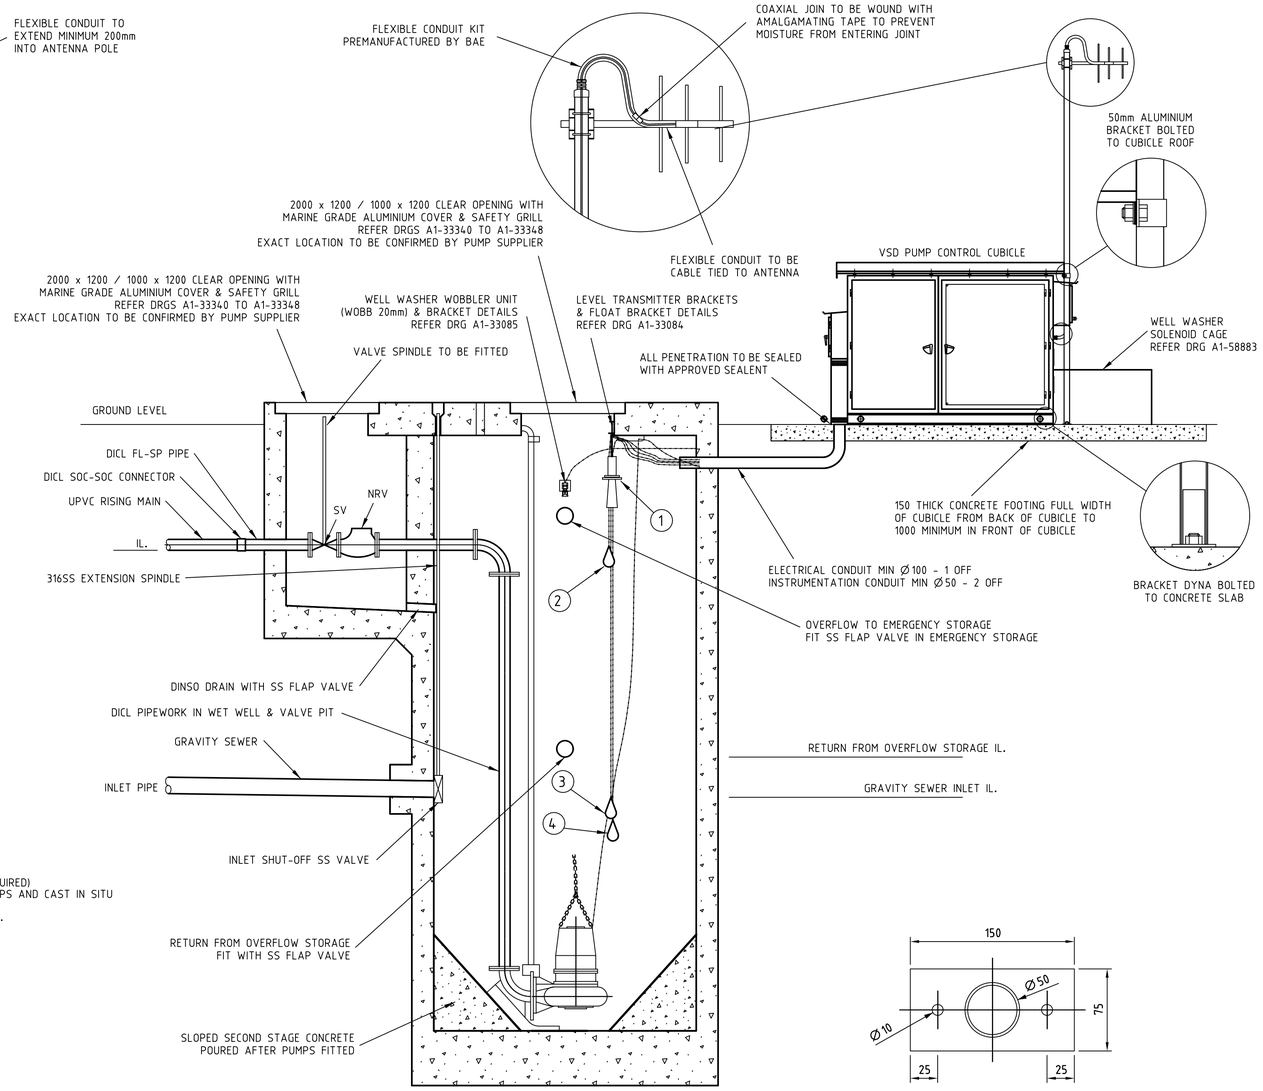

SECTION "A-A"

(1) MJK ULTRASONIC

(2)(3)(4) FLOAT SWITCHES x 3



ANTENNA POLE BASE BRACKET

NOTES FOR LOCATION OF PUMP CONTROL CUBICLE

1. DOORS TO HINGE AWAY FROM WELL.
2. CUBICLE TO BE LOCATED TO ALLOW ACCESS TO CONTROLS SAFELY WHEN WELL COVERS ARE OPEN.
3. WELL COVERS TO BE HINGED SO COVERS CAN BE OPENED FULLY WITHOUT COMING INTO CONTACT ELECTRICAL CUBICLE.

REVISIONS

No.	DATE	DESCRIPTION	APP'D
9	29/3/21	RE-DRAWN IN DGN FORMAT.	P.S.

REFERENCES

PLAN No.	TITLE
A1-47775	STD SPS - PUMP STN 7.5kW TO 22kW (VSD) - DIRECT METERED - I & C - DRG INDEX

DESIGNED BY:

OPTIMUM DRAFTING PTY LTD
A.B.N. 28 065 272 942

DO NOT SCALE

CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.
DESIGNED: 19/04/2010 - GW/STD
DRAWN: 29/03/2021 - OPT/RJ
CHECKED: 31/03/2021 - P STEWART

GIPPSLAND WATER DRAWING STATUS: STANDARD DRAWING

GIPPSLAND WATER FACILITY CODE: XXCPXX

GIPPSLAND WATER

DRAWING No. A1-47818 REV. 9

STANDARD SEWERAGE PUMP STATION
PUMP STATION 7.5kW TO 22kW (VSD) - DIRECT METERED
BACK TO BACK CUBICLE
PUMP WELL DETAILS