

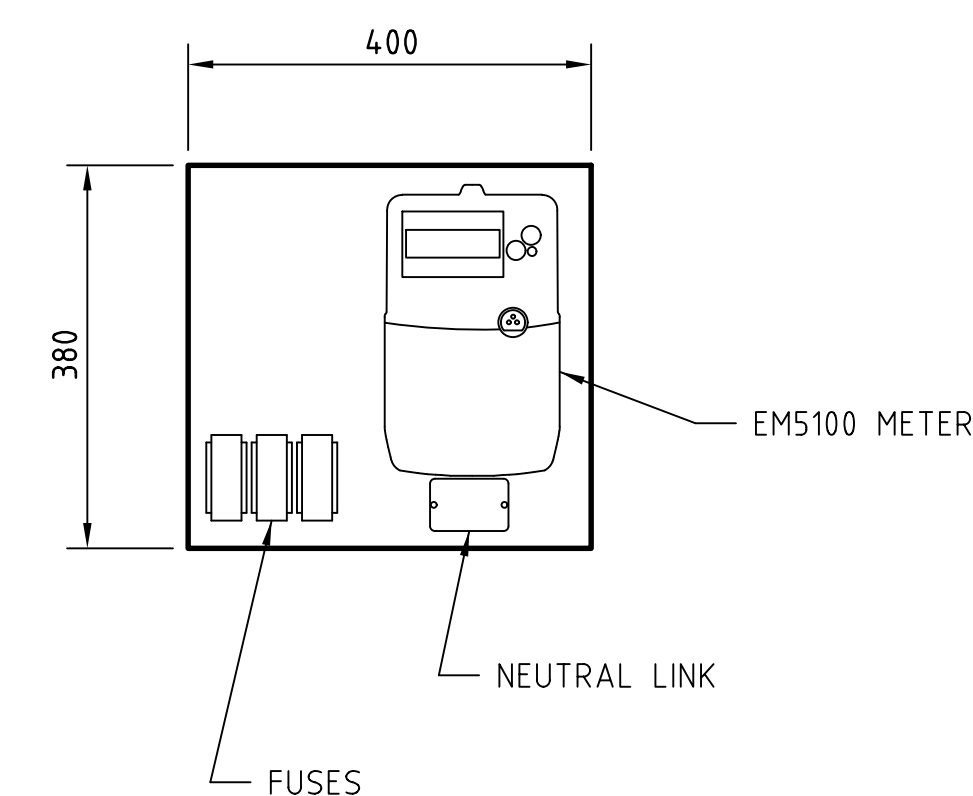


SECTIONS SHOWN WITH METERING DOOR AND HINGE ASSEMBLY REMOVED.
CUBICLE IP RATING: IP55
VENTILATION REQUIREMENTS FOR METERING COMPARTMENT:
PRESSED LOUVERS WITH MESH BACKING TO A MINIMUM DEGREE OF
PROTECTION OF IP23.

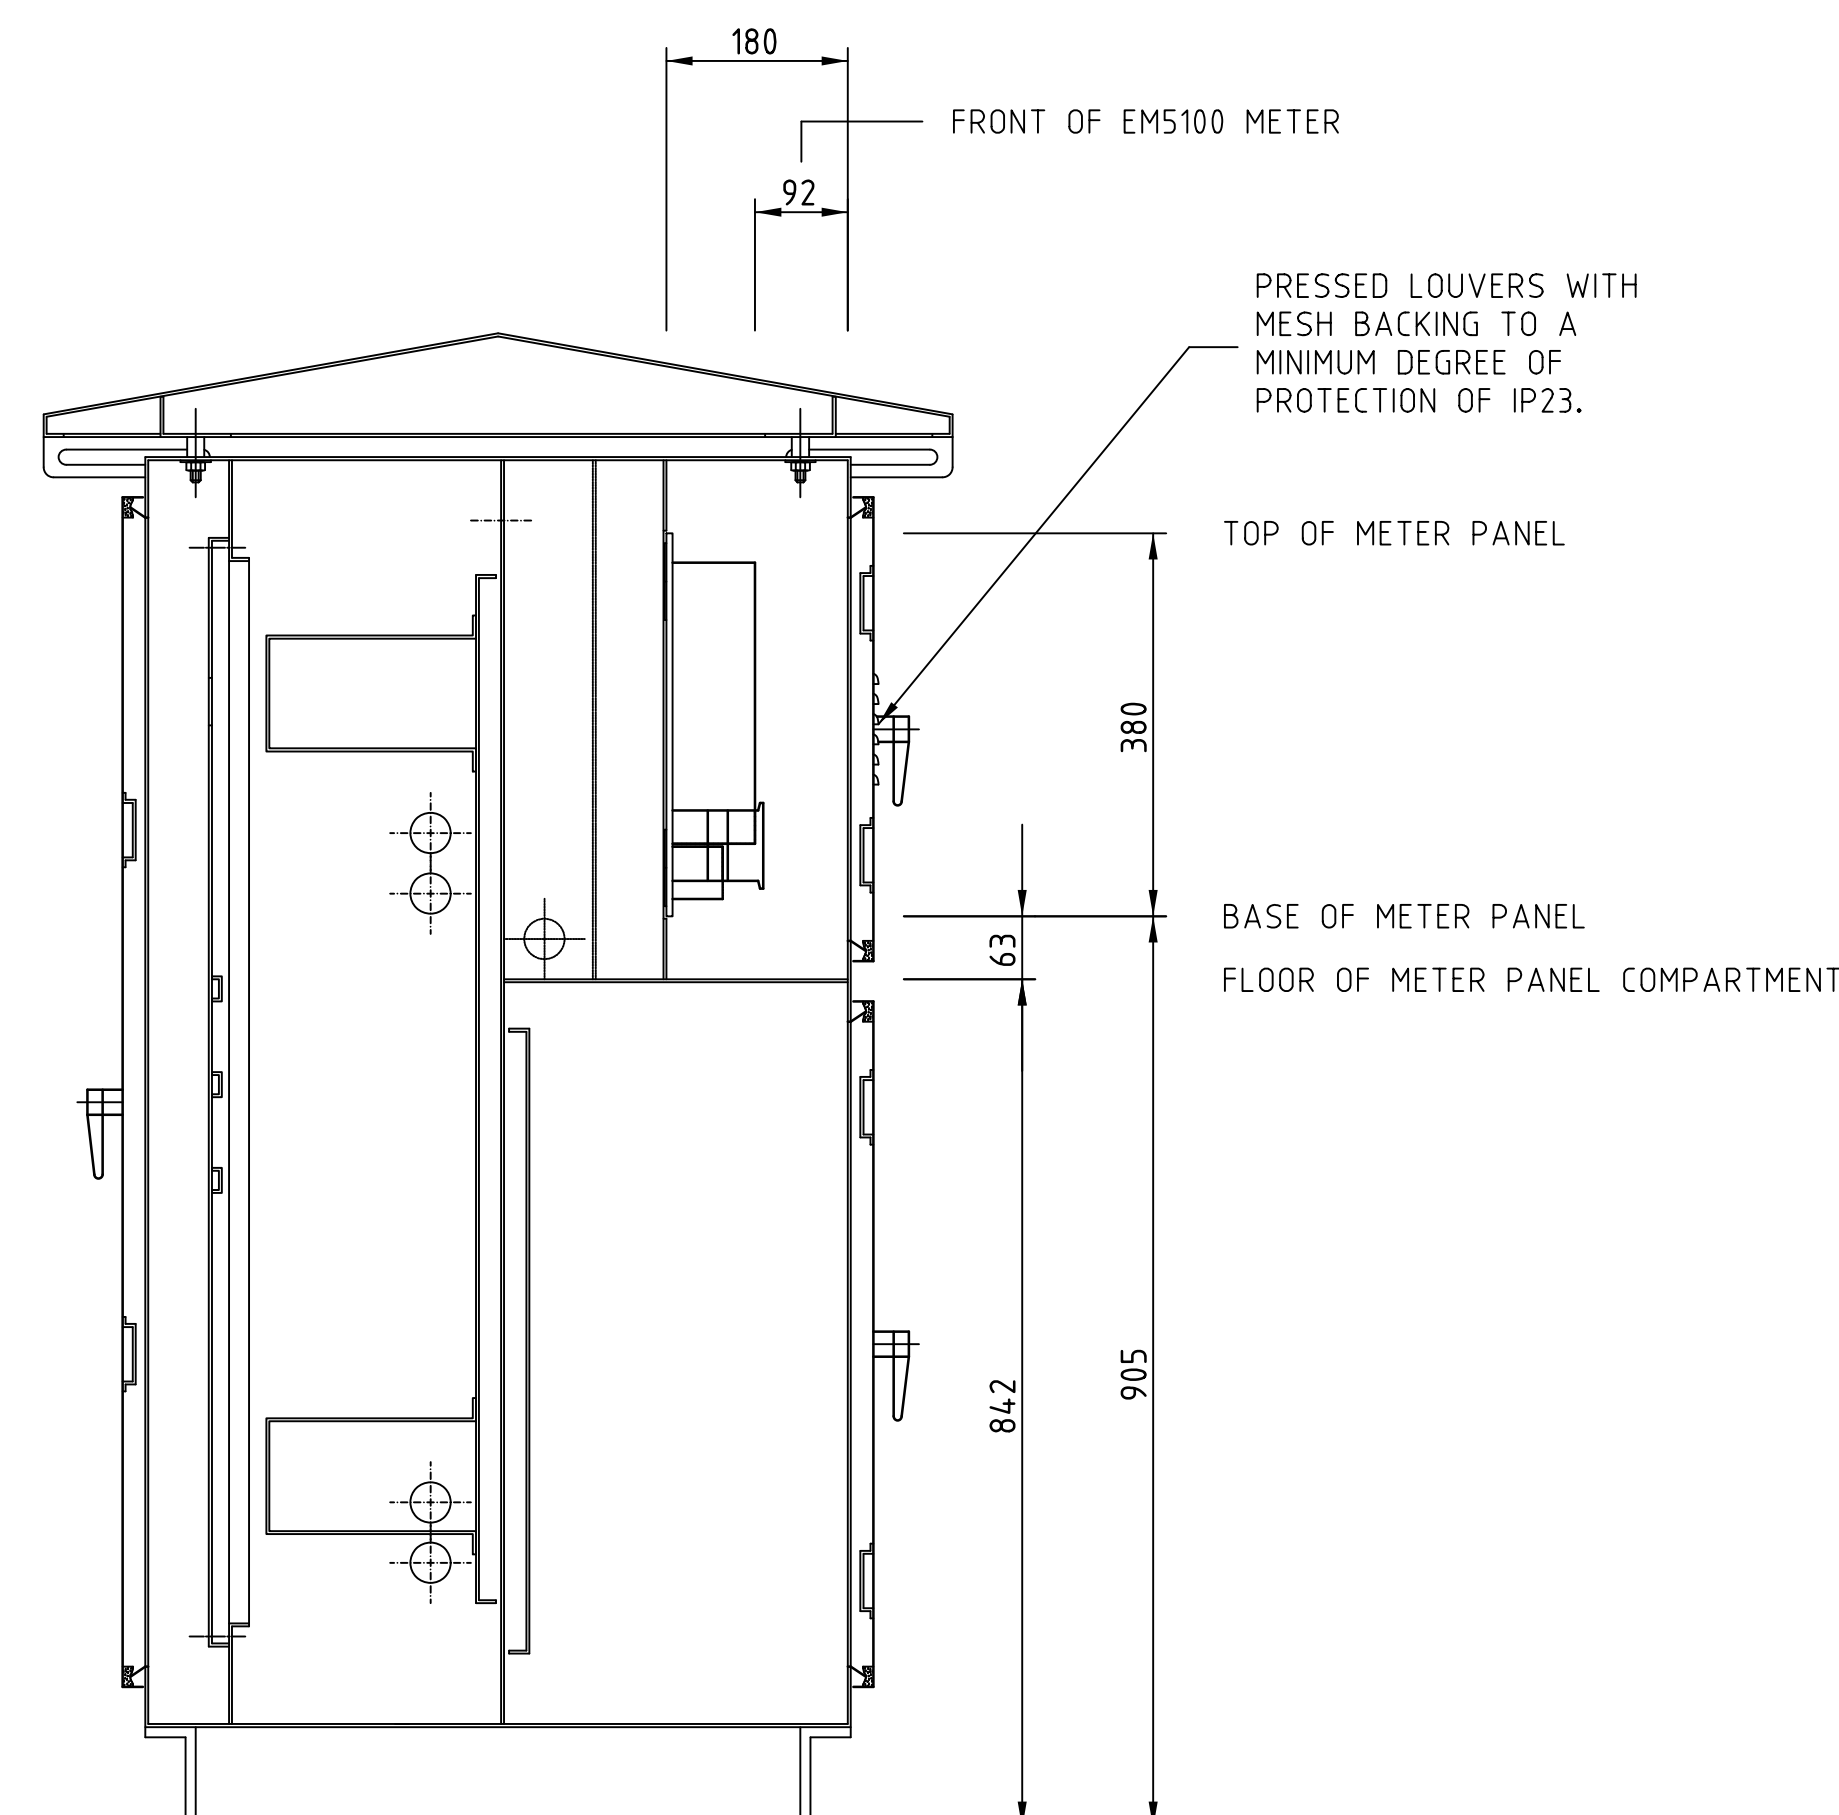

REVISIONS					REFERENCES		
	6	29/3/21	ADDED TOP HAT FOR DC CBS & RE-DRAWN IN DGN FORMAT.			P.S.	A1-47775
No.	DATE	DESCRIPTION		APP'D	PLAN No.	TITLE	

DESIGNED BY:

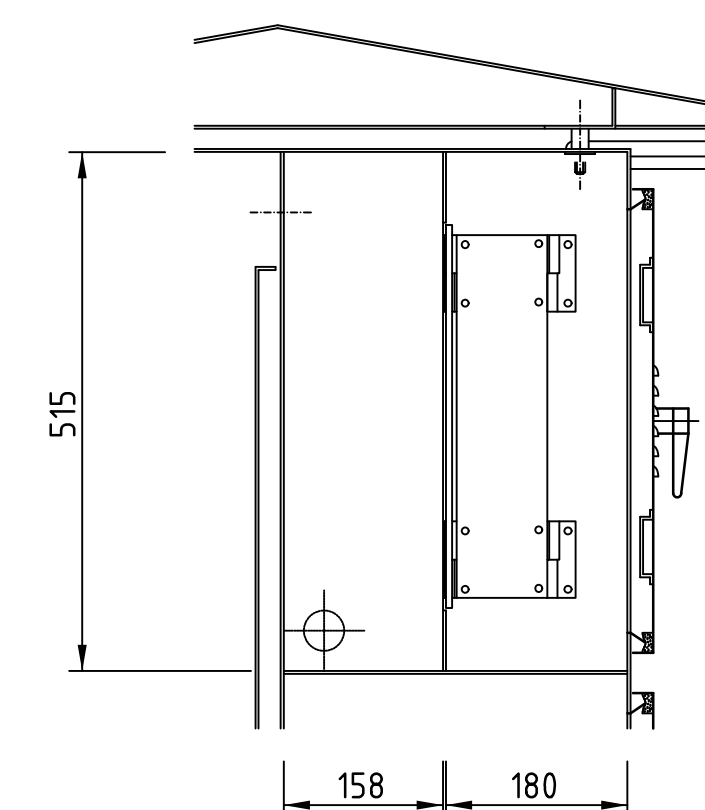

DO NOT SCALE		GIPPSLAND WATER DRAWING STATUS	STANDARD DRAWING	GIPPSLAND WATER FACILITY CODE XXCPXX
CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS. DESIGNED: 19/04/2010 - GW/STD DRAWN: 29/03/2021 - OPT/RJ CHECKED: 31/03/2021 - P STEWART			STANDARD SEWERAGE PUMP STATION PUMP STATION 7.5kw TO 22kw (VSD) - DIRECT METERED BACK TO BACK - PUMP STATION CUBICLE METERING COMPARTMENT DETAILS	
			DRAWING No. A1-49212	