

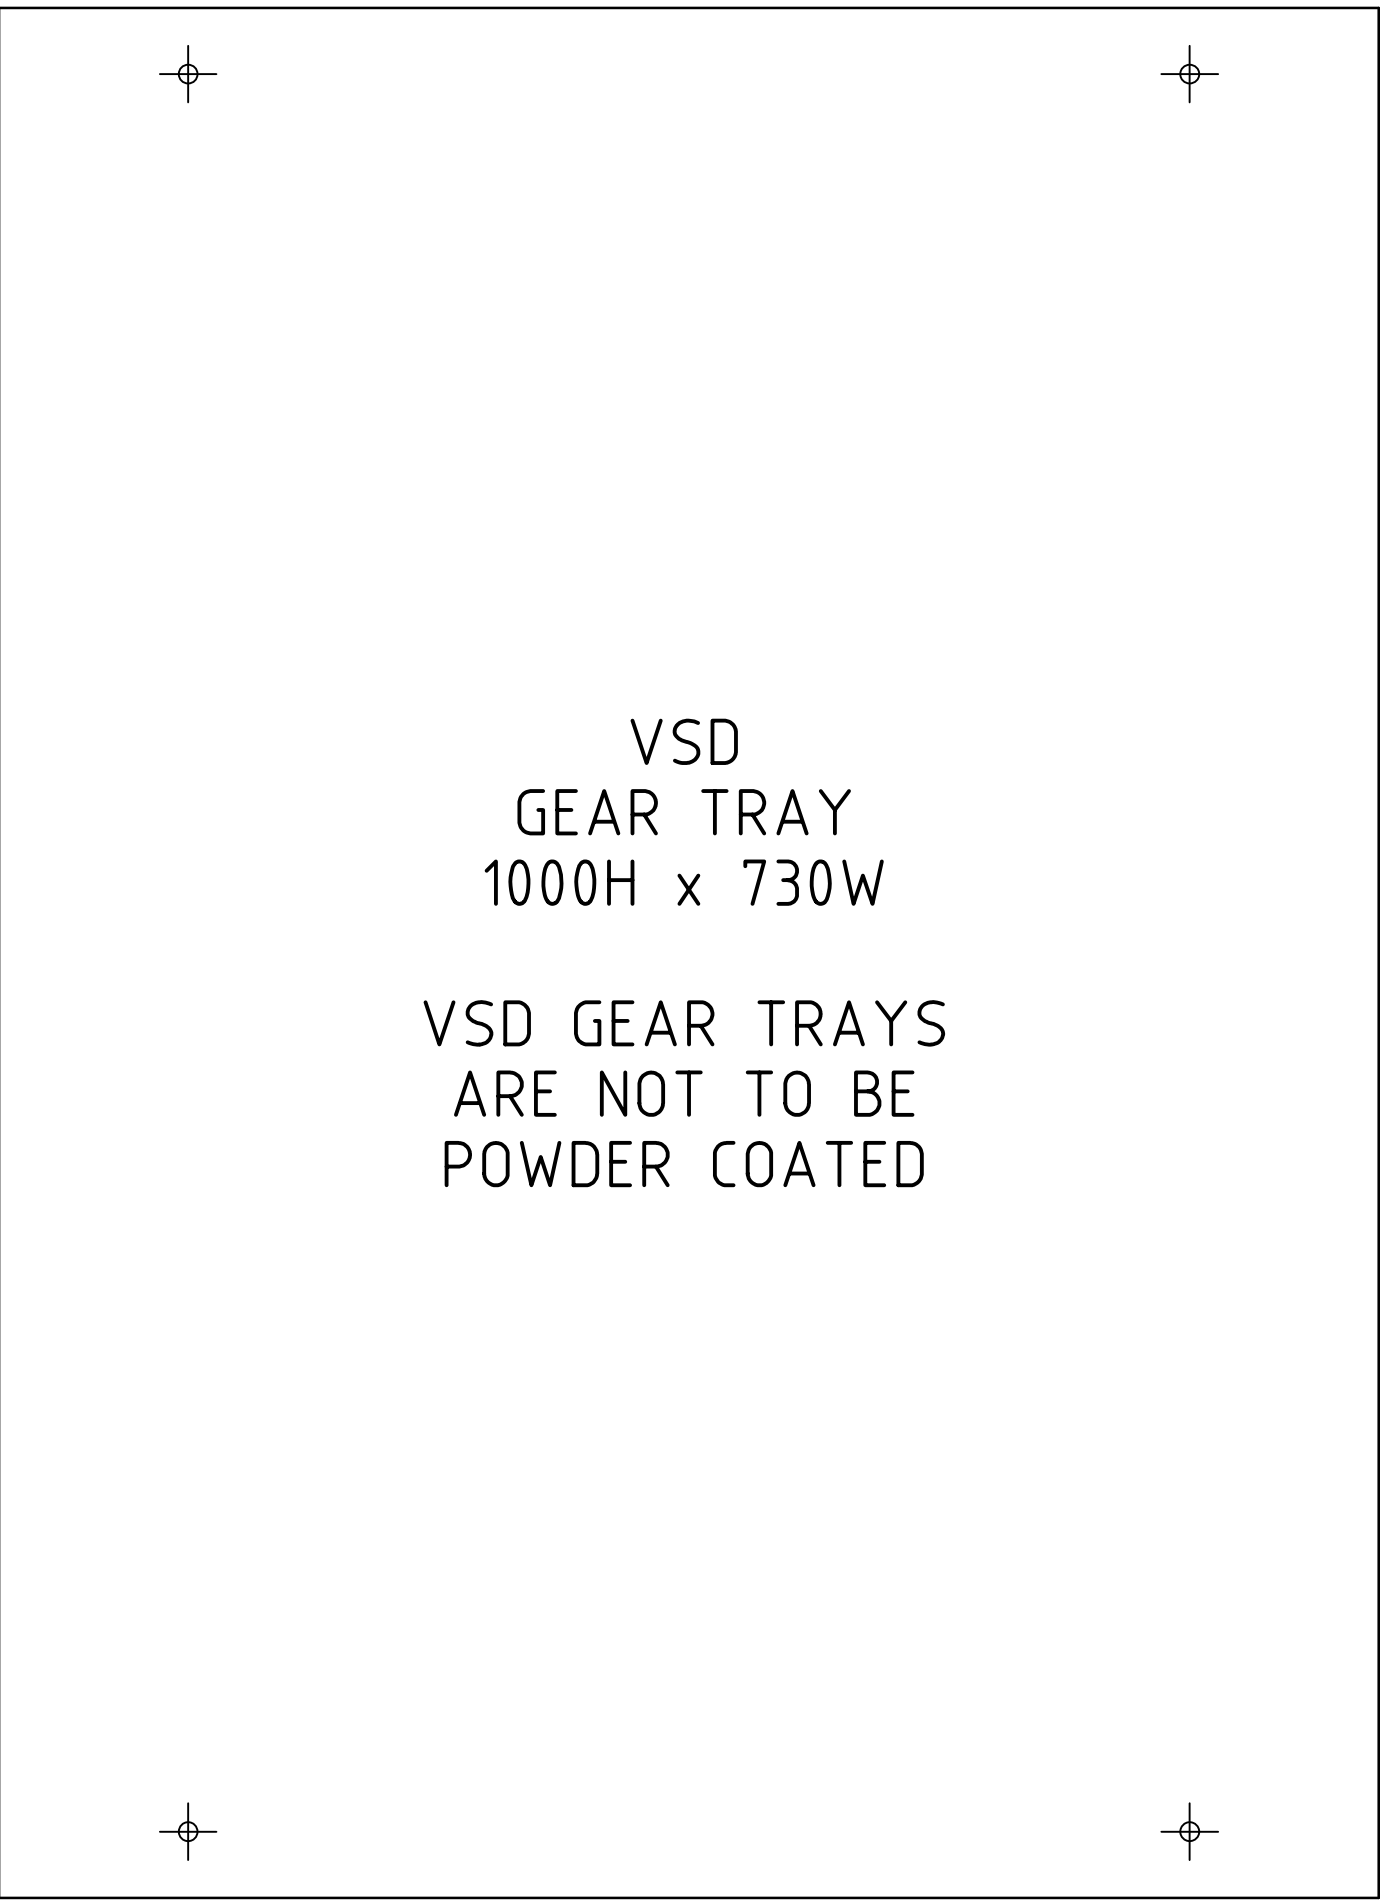


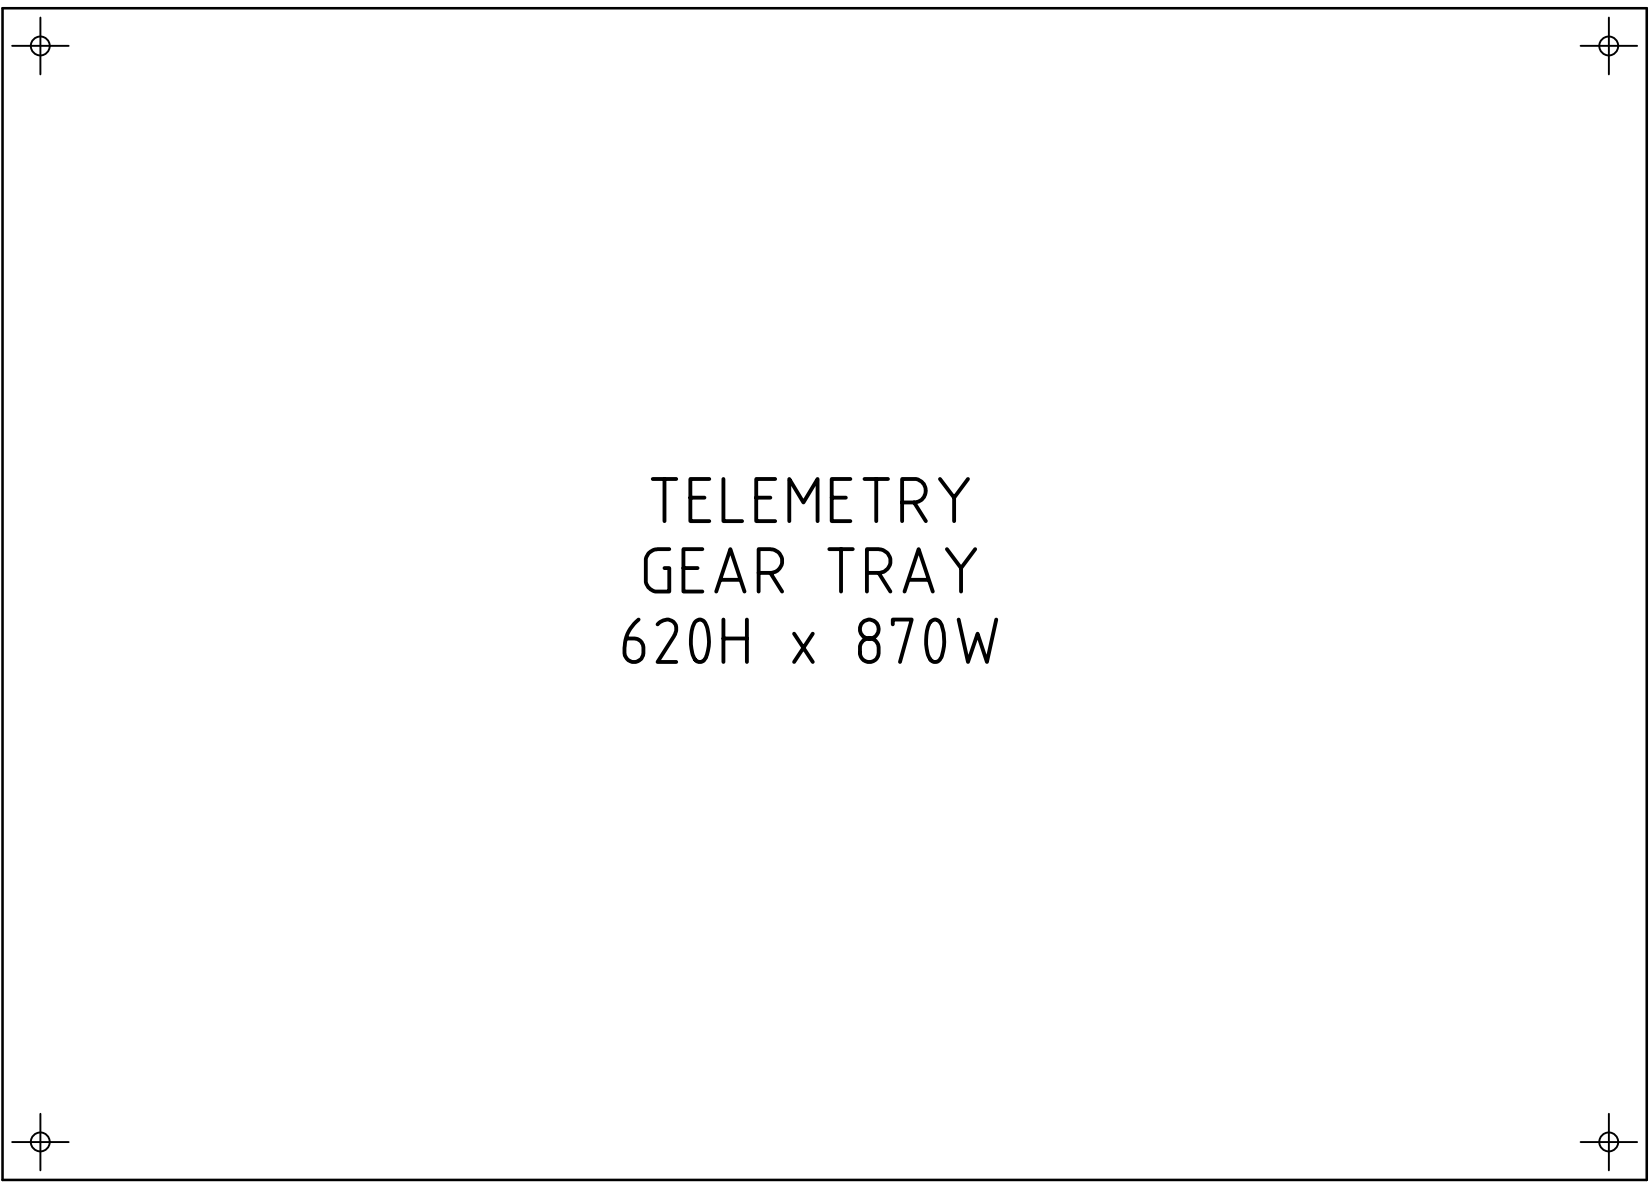

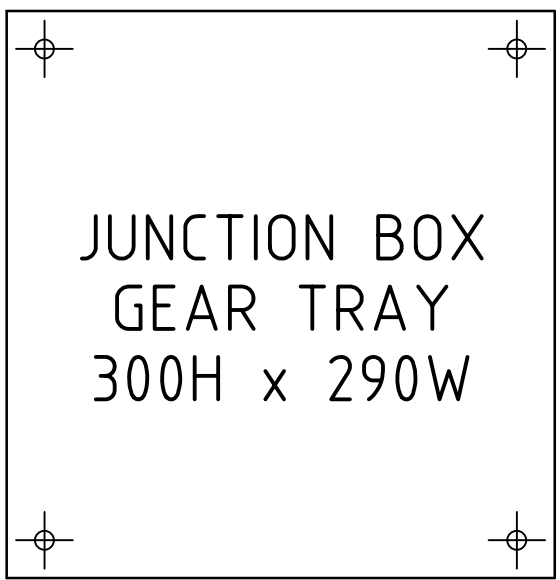

NOTE:
VSD GEAR TRAYS ARE NOT TO
BE POWDER COATED.

ALL OTHER GEAR TRAYS AND
TOP HAT TO BE POWDER COATED.

[illegible]

DESIGNED BY:



DO NOT SCALE	GIPPSLAND WATER DRAWING STATUS:	STANDARD DRAWING	GIPPSLAND WATER FACILITY CODE XXCPXX
CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.		GIPPSLAND WATER	DRAWING No. A1-48321 REV. 4
DESIGNED: 19/01/2010 - GW/STD		STANDARD SEWERAGE PUMP STATION PUMP STATION 7.5kw TO 22kw (VSD) - DIRECT METERED BACK TO BACK / SIDE BY SIDE - PUMP STATION CUBICLE GEAR TRAY DRILLING DETAILS	
DRAWN: 29/03/2021 - OPT/RJ			
CHECKED: 31/03/2021 - P STEWART			