

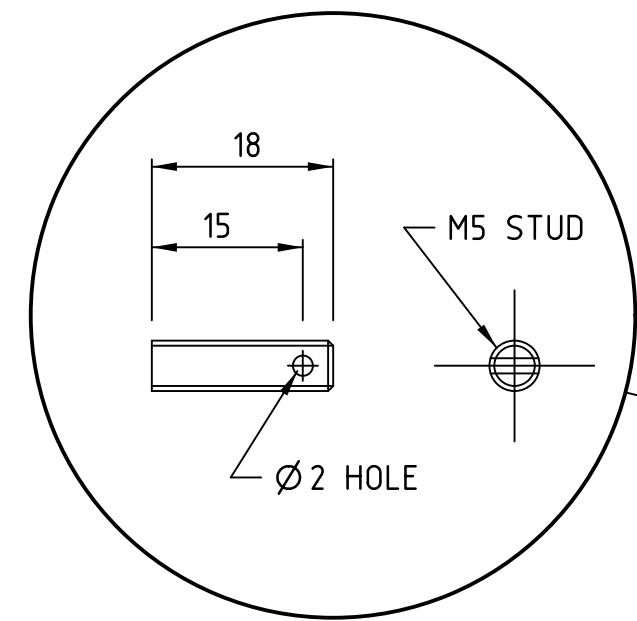
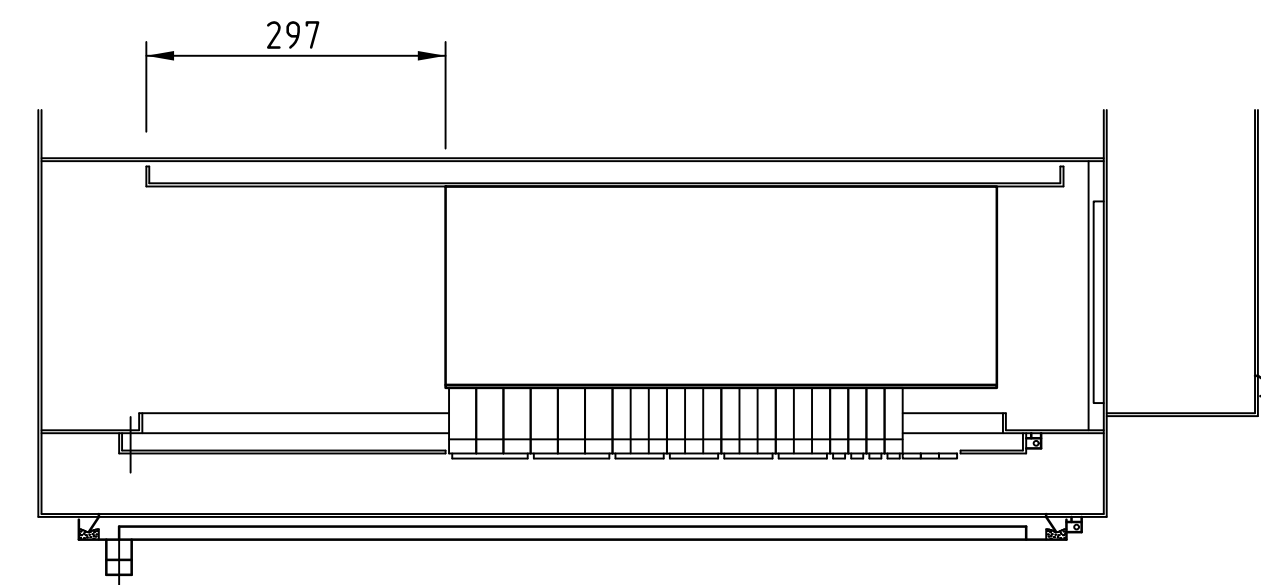


# METERING COMPARTMENT DETAILS


SECTIONS SHOWN WITH METERING DOOR AND HINGE ASSEMBLY REMOVED.  
CUBICLE IP RATING: IP55  
VENTILATION REQUIREMENTS FOR METERING COMPARTMENT:  
PRESSED LOUVERS WITH MESH BACKING TO A MINIMUM DEGREE OF  
PROTECTION OF IP23.

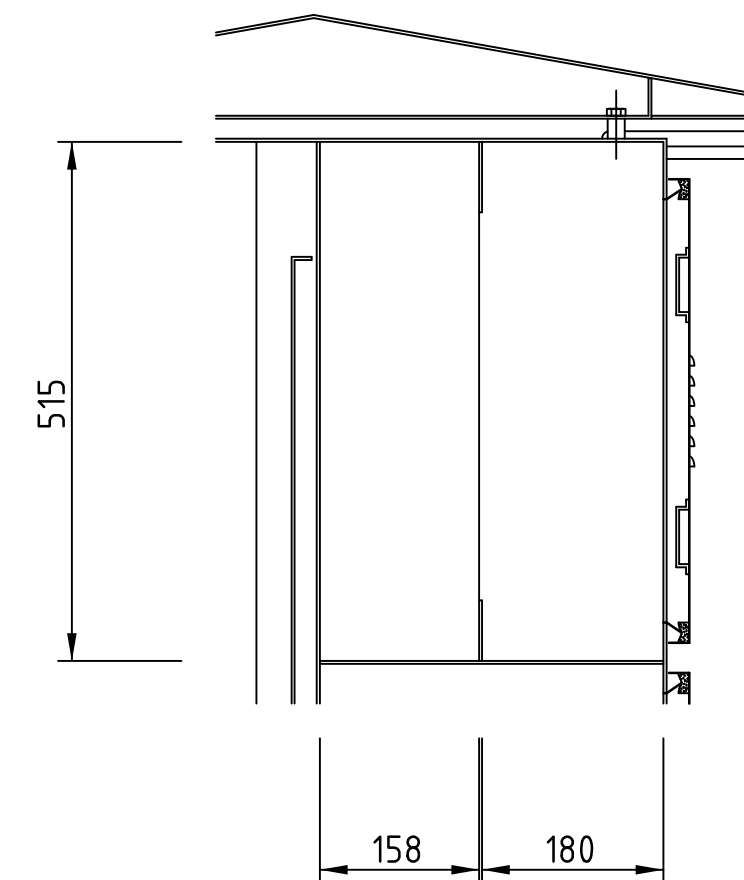


PROVISION FOR  
METER PANEL  
SEALING STUD

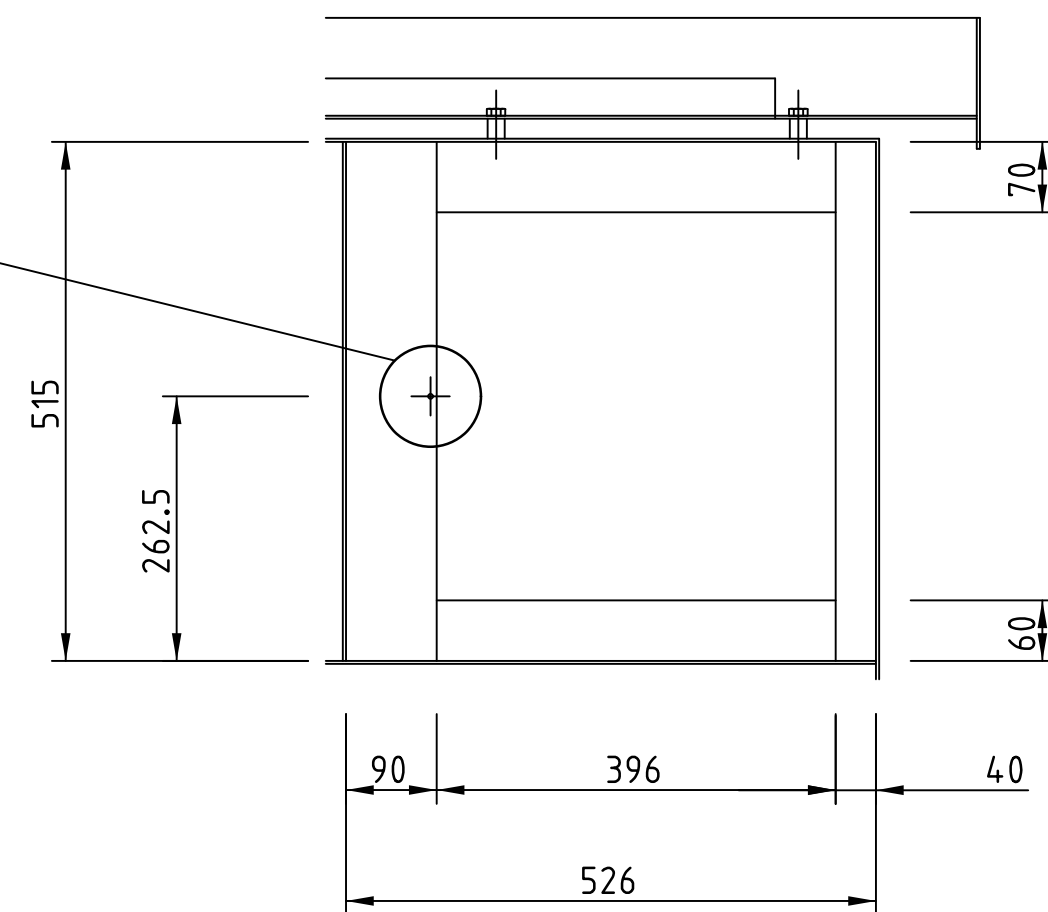


CIRCUIT BREAKERS TOP VIEW

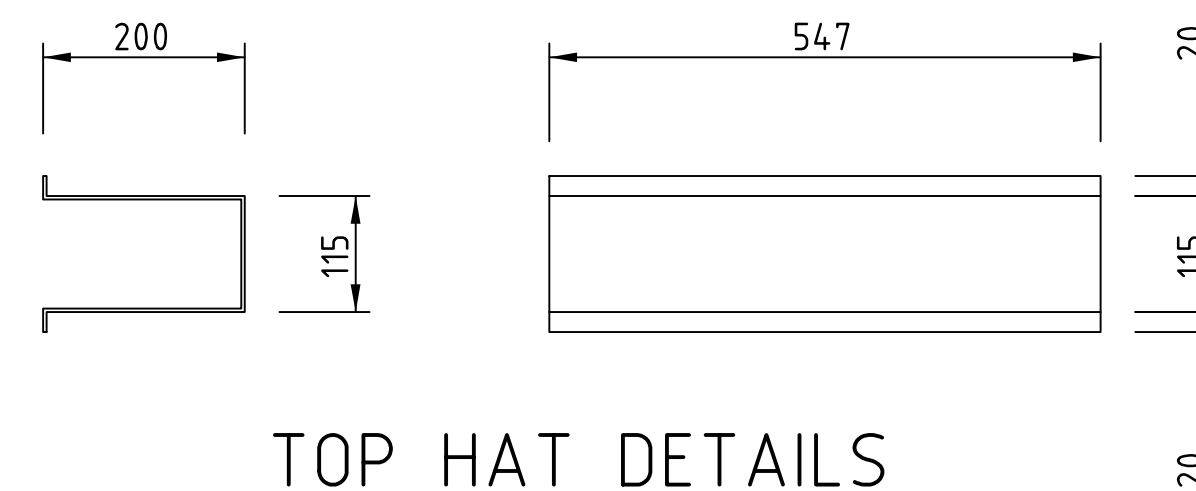



TOP HAT DETAILS

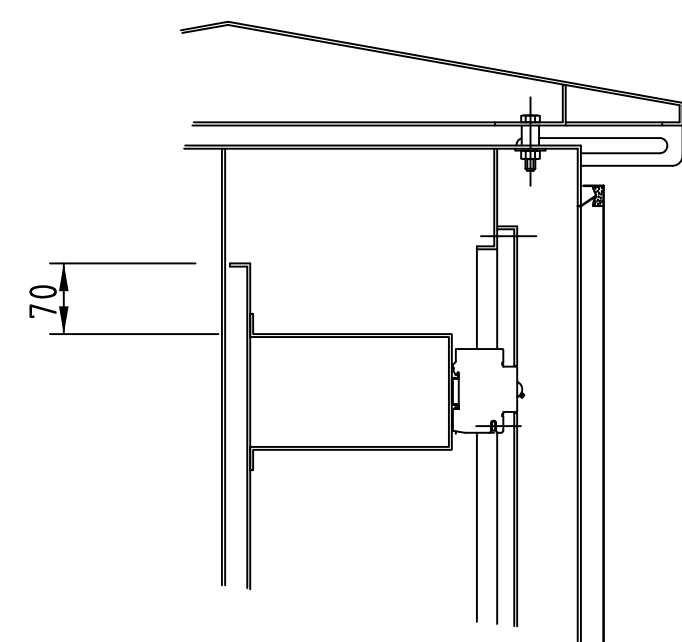


DIN-T CB VIEW

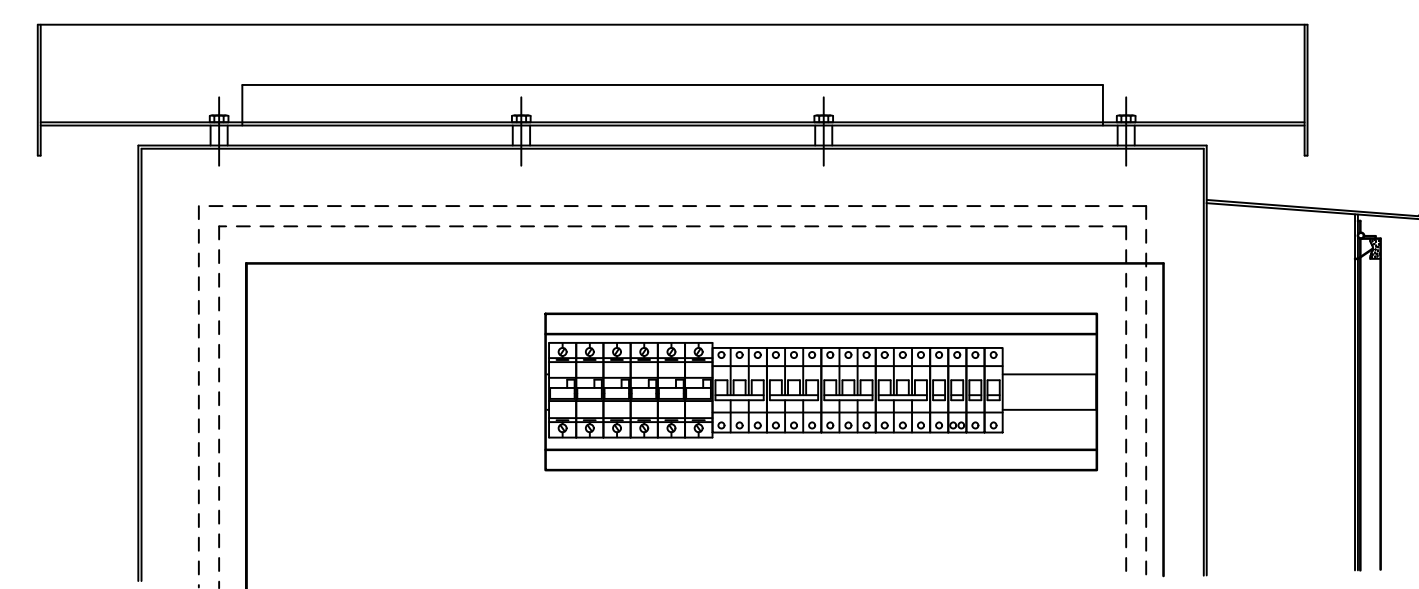

CIRCUIT BREAKERS FRONT VIEW

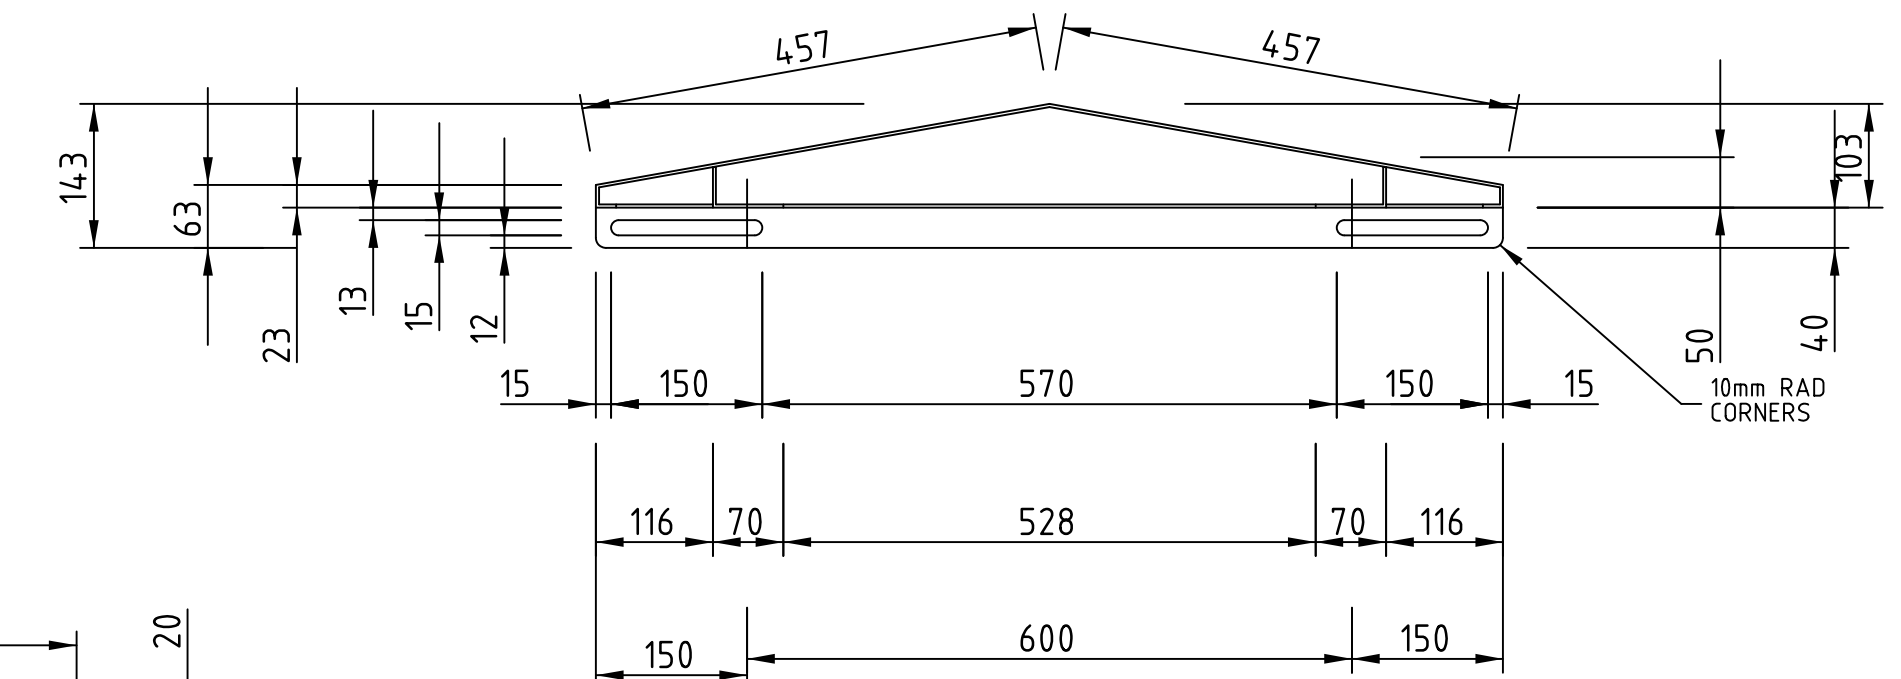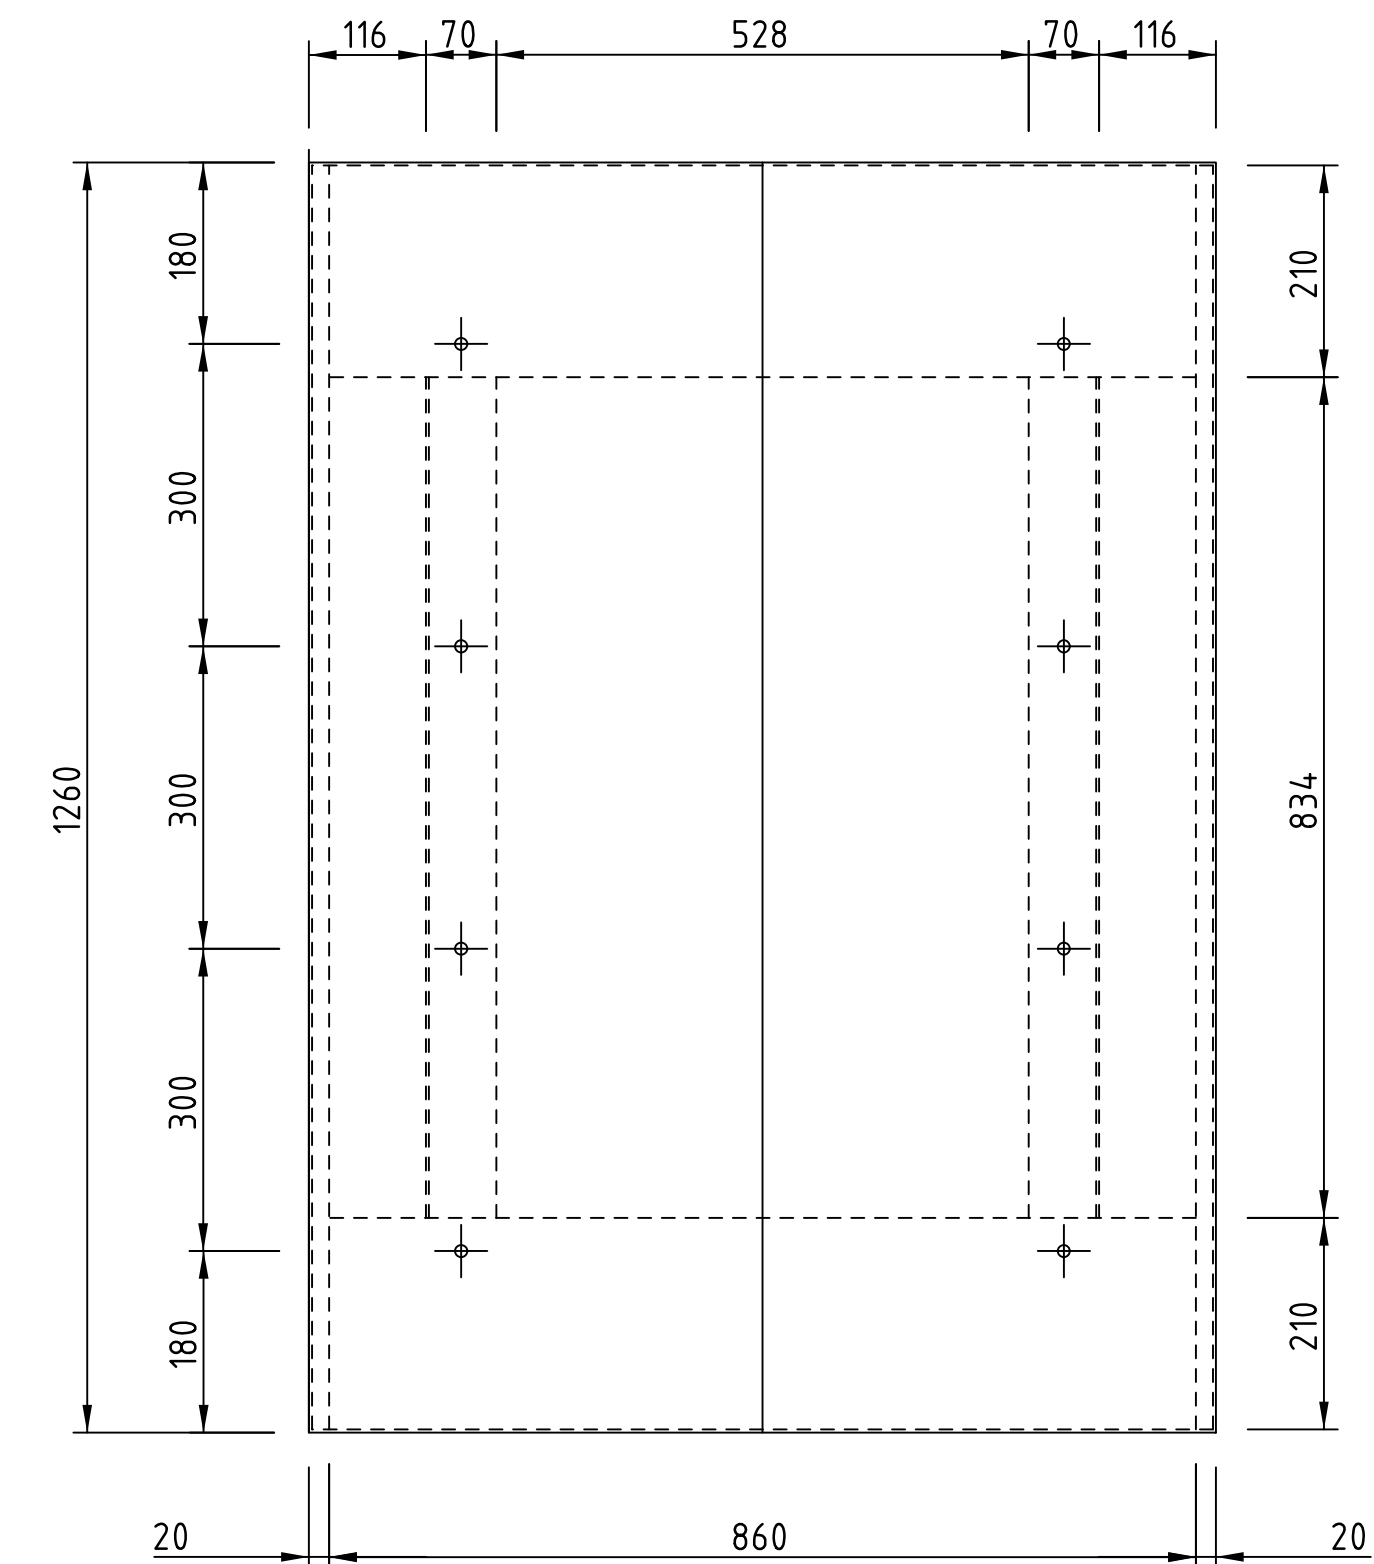

ROOF CANOPY DETAILS

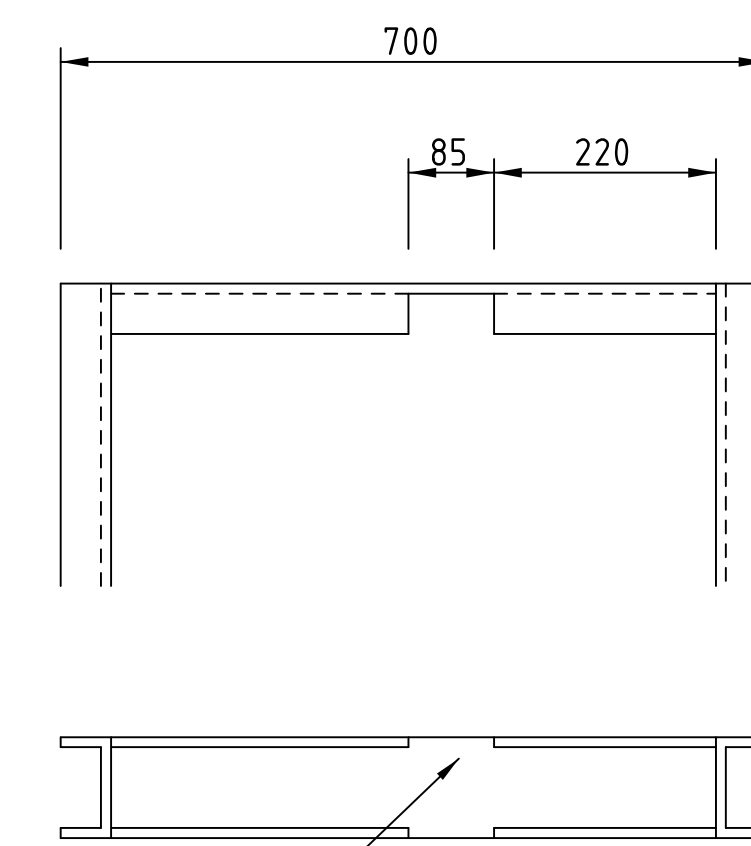

TOP & BOTTOM OF PLINTH TO BE NOTCHED OUT  
FOR Ø40 IN BOTTOM OF CUBICLE

PLINTH DETAILS

NOT TO SCALE

REVISIONS	No.	DATE	DESCRIPTION	APP'D	REFERENCES	PLAN No.	TITLE
	2	19/8/15	ADDED NEW GW SHT - APPROVED STANDARD DRG.	M.S.			
	1	21/5/15	REVISED PUMP CBS TO REFLECT DIN-T6 SERIES.	M.S.			
	0	27/3/15	INITIAL ISSUE.	M.S.	A1-58850	STANDARD SPS - PUMP STATION 7.5kW TO 22kW (SOFT STARTER) - I & C - DRAWING INDEX	

DESIGNED BY:

OPTIMUM  
DRAFTING PTY LTD  
A.B.N. 28 065 272 942

DO NOT SCALE	GIPPSLAND WATER DRAWING STATUS	STANDARD DRAWING	GIPPSLAND WATER FACILITY CODE XXCPXX
CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.	<p>GIPPSLAND WATER</p>		
DESIGNED: 25/03/2015 - M SENANAYAKE	DRAWING No. A1-58869		
DRAWN: 27/03/2015 - OPT/MM	REV. 2		
CHECKED: 01/04/2015 - M SENANAYAKE	STANDARD SEWERAGE PUMP STATION PUMP STATION 7.5kW TO 22kW (SOFT STARTER) BACK TO BACK - PUMP STATION CUBICLE SECTIONAL ARRANGEMENT - SHEET 2 OF 2		