


(OPTION No 1)  
MJK SHUTTLE LEVEL  
TRANSMITTER

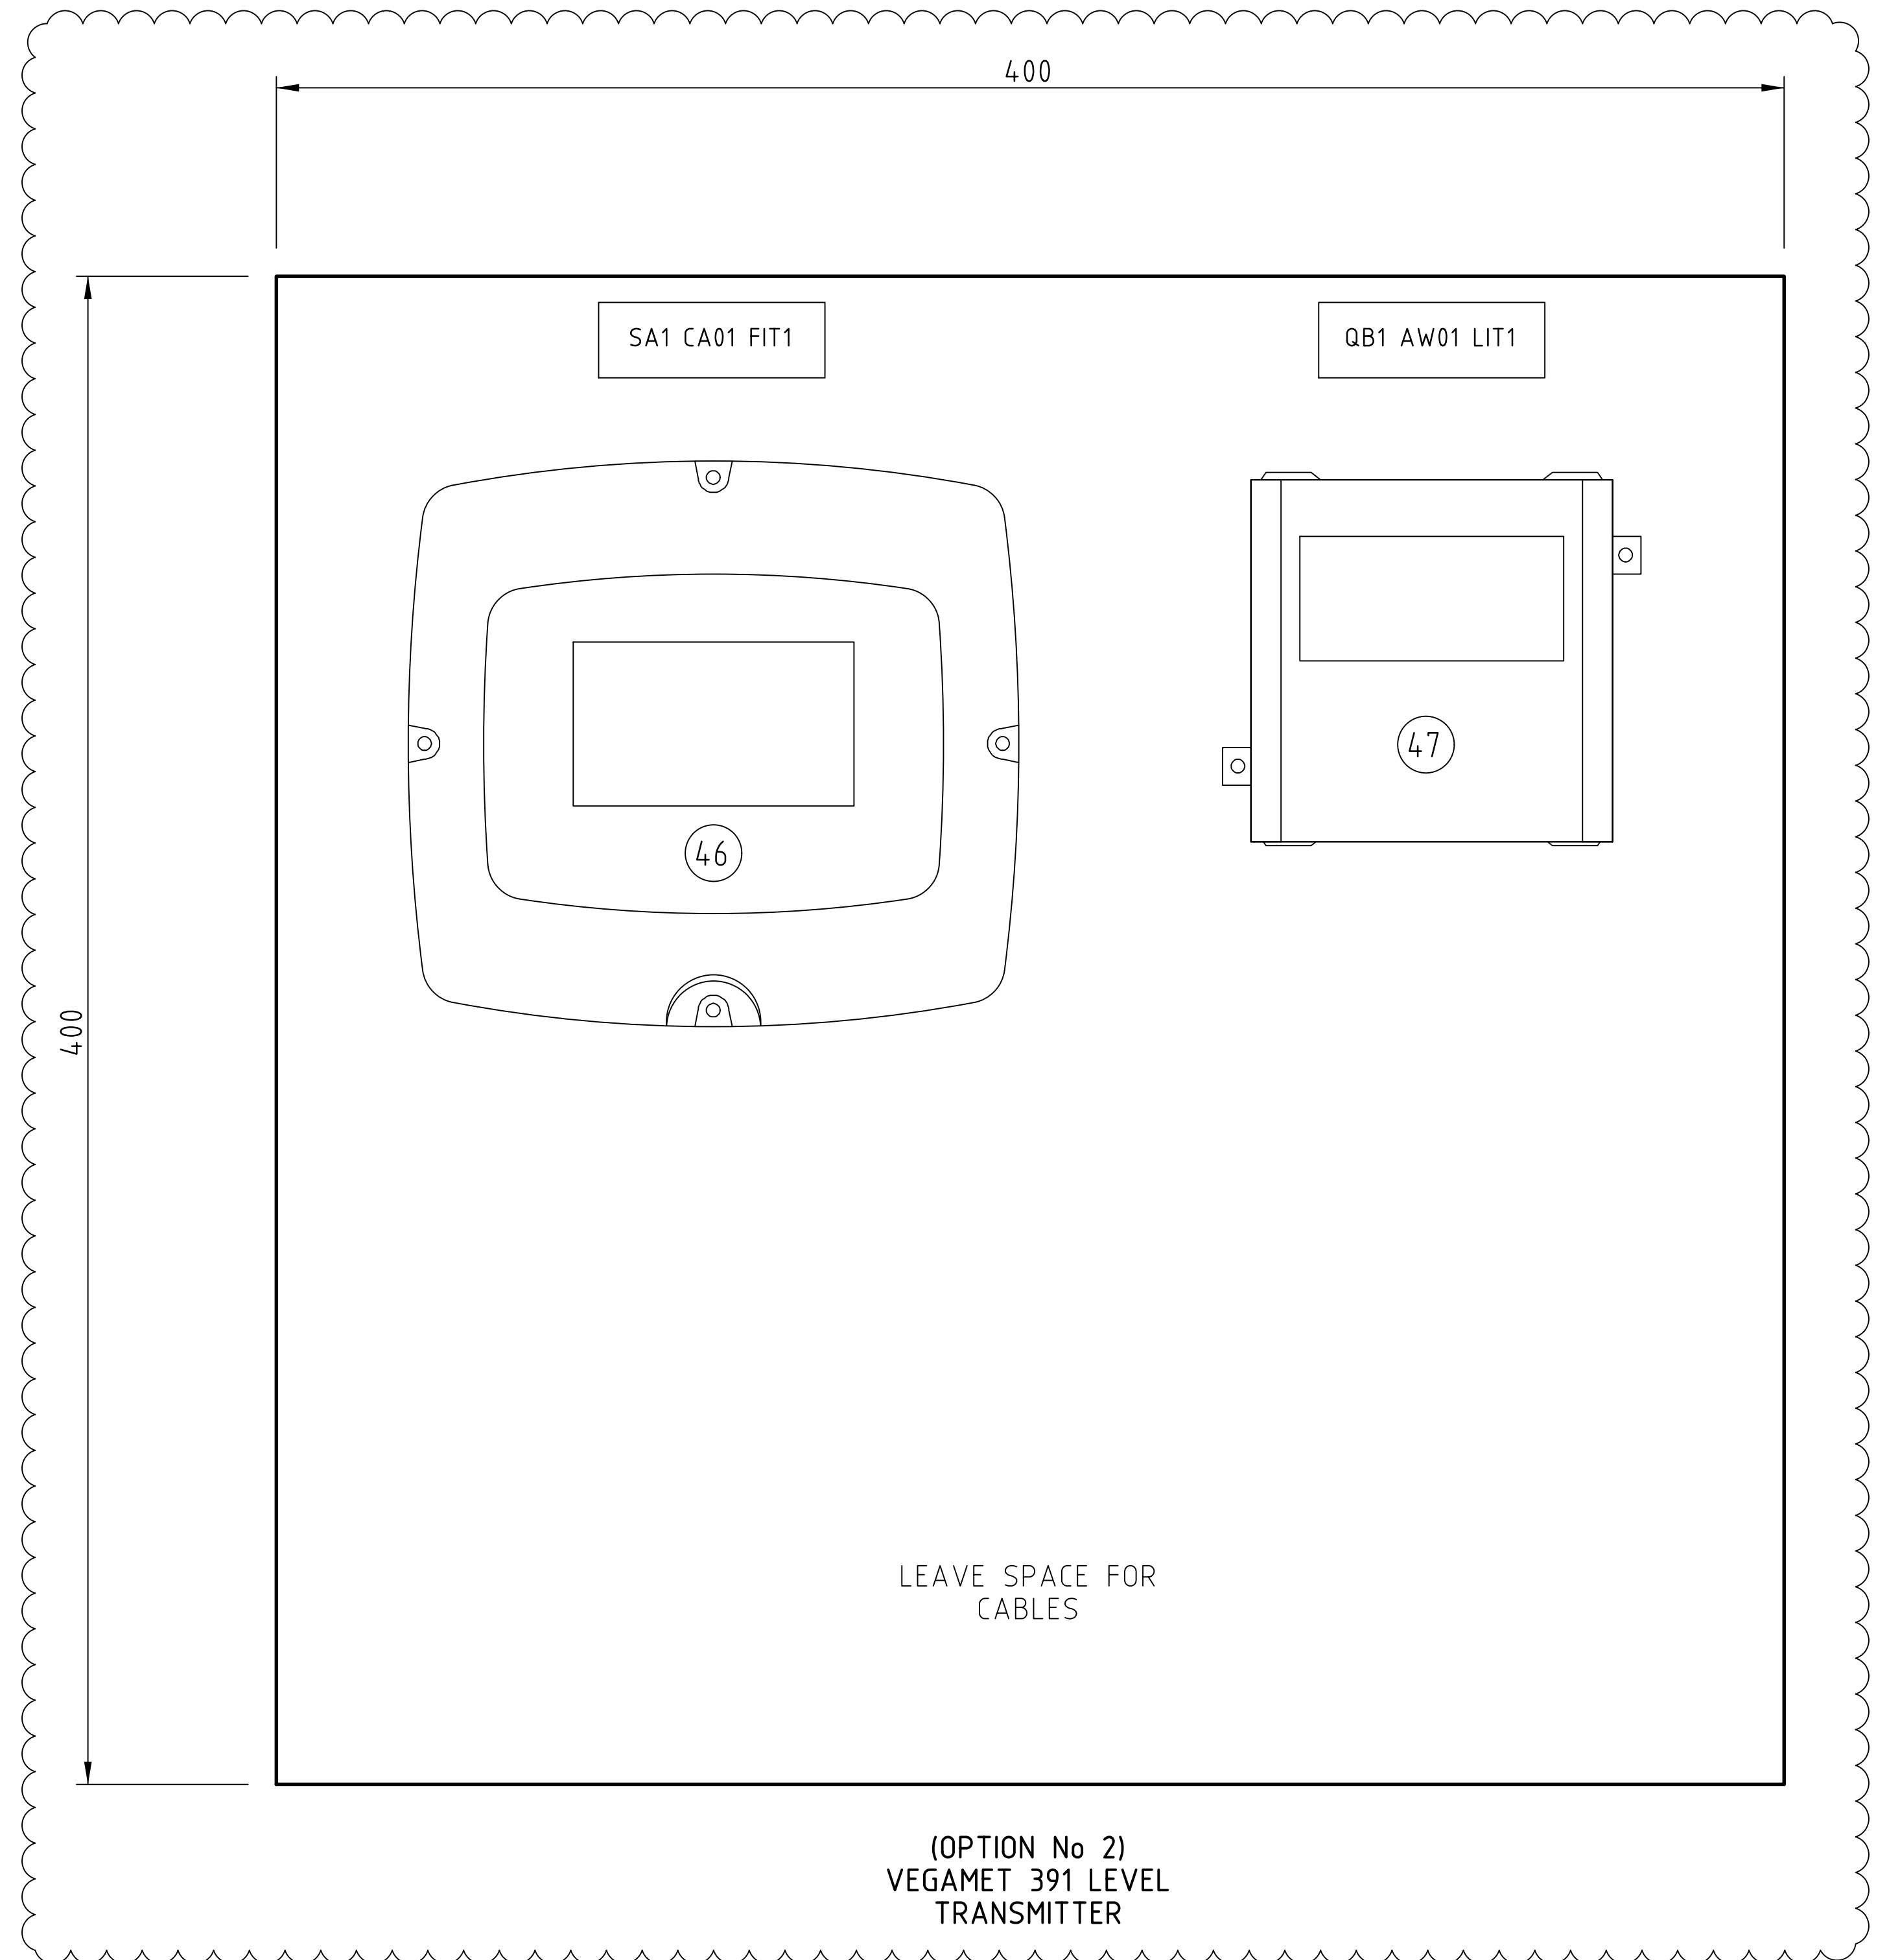

(OPTION No 2)  
VEGAMET 391 LEVEL  
TRANSMITTER

NOT TO SCALE

REVISIONS				REFERENCES			
No.	DATE	DESCRIPTION	APP'D	PLAN No.	TITLE		
2	19/4/17	ADDED VEGAMET 391 LEVEL TRANSMITTER (OPTION No 2).	P.S.				
1	20/8/15	ADDED NEW GW SHT - APPROVED STANDARD DRG.	M.S.				
0	27/3/15	INITIAL ISSUE.	M.S.				
				A1-58850	STANDARD SPS - PUMP STATION 7.5kW TO 22kW (SOFT STARTER) - I & C - DRAWING INDEX		

DESIGNED BY:

OPTIMUM

DRAFTING PTY LTD

A.B.N. 28 065 272 942

DO NOT SCALE

CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.

DESIGNED: 25/03/2015 - M SENANAYAKE

DRAWN: 27/03/2015 - OPT/MM

CHECKED: 01/04/2015 - M SENANAYAKE

GIPPSLAND WATER

STANDARD SEWAGE PUMP STATION  
PUMP STATION 7.5kW TO 22kW (SOFT STARTER)  
INSTRUMENTATION COMPARTMENT  
GEAR TRAY LAYOUT

GIPPSLAND WATER FACILITY CODE  
XXCPXX

DRAWING No.  
A1-58879

REV.  
2