
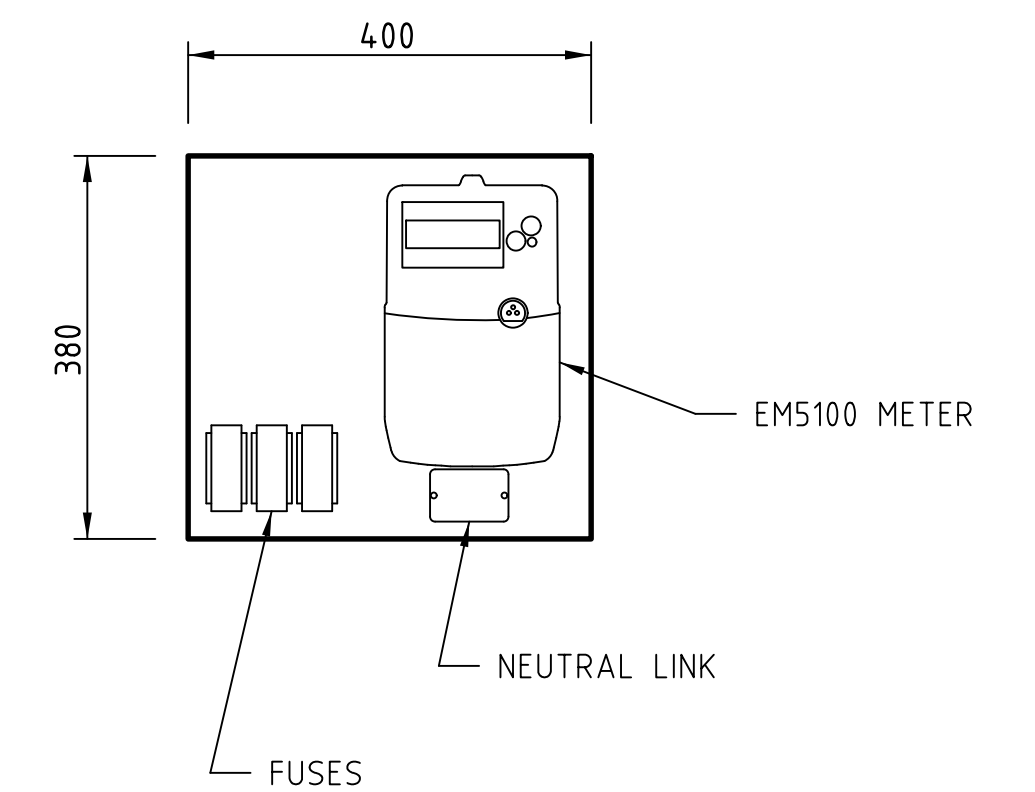
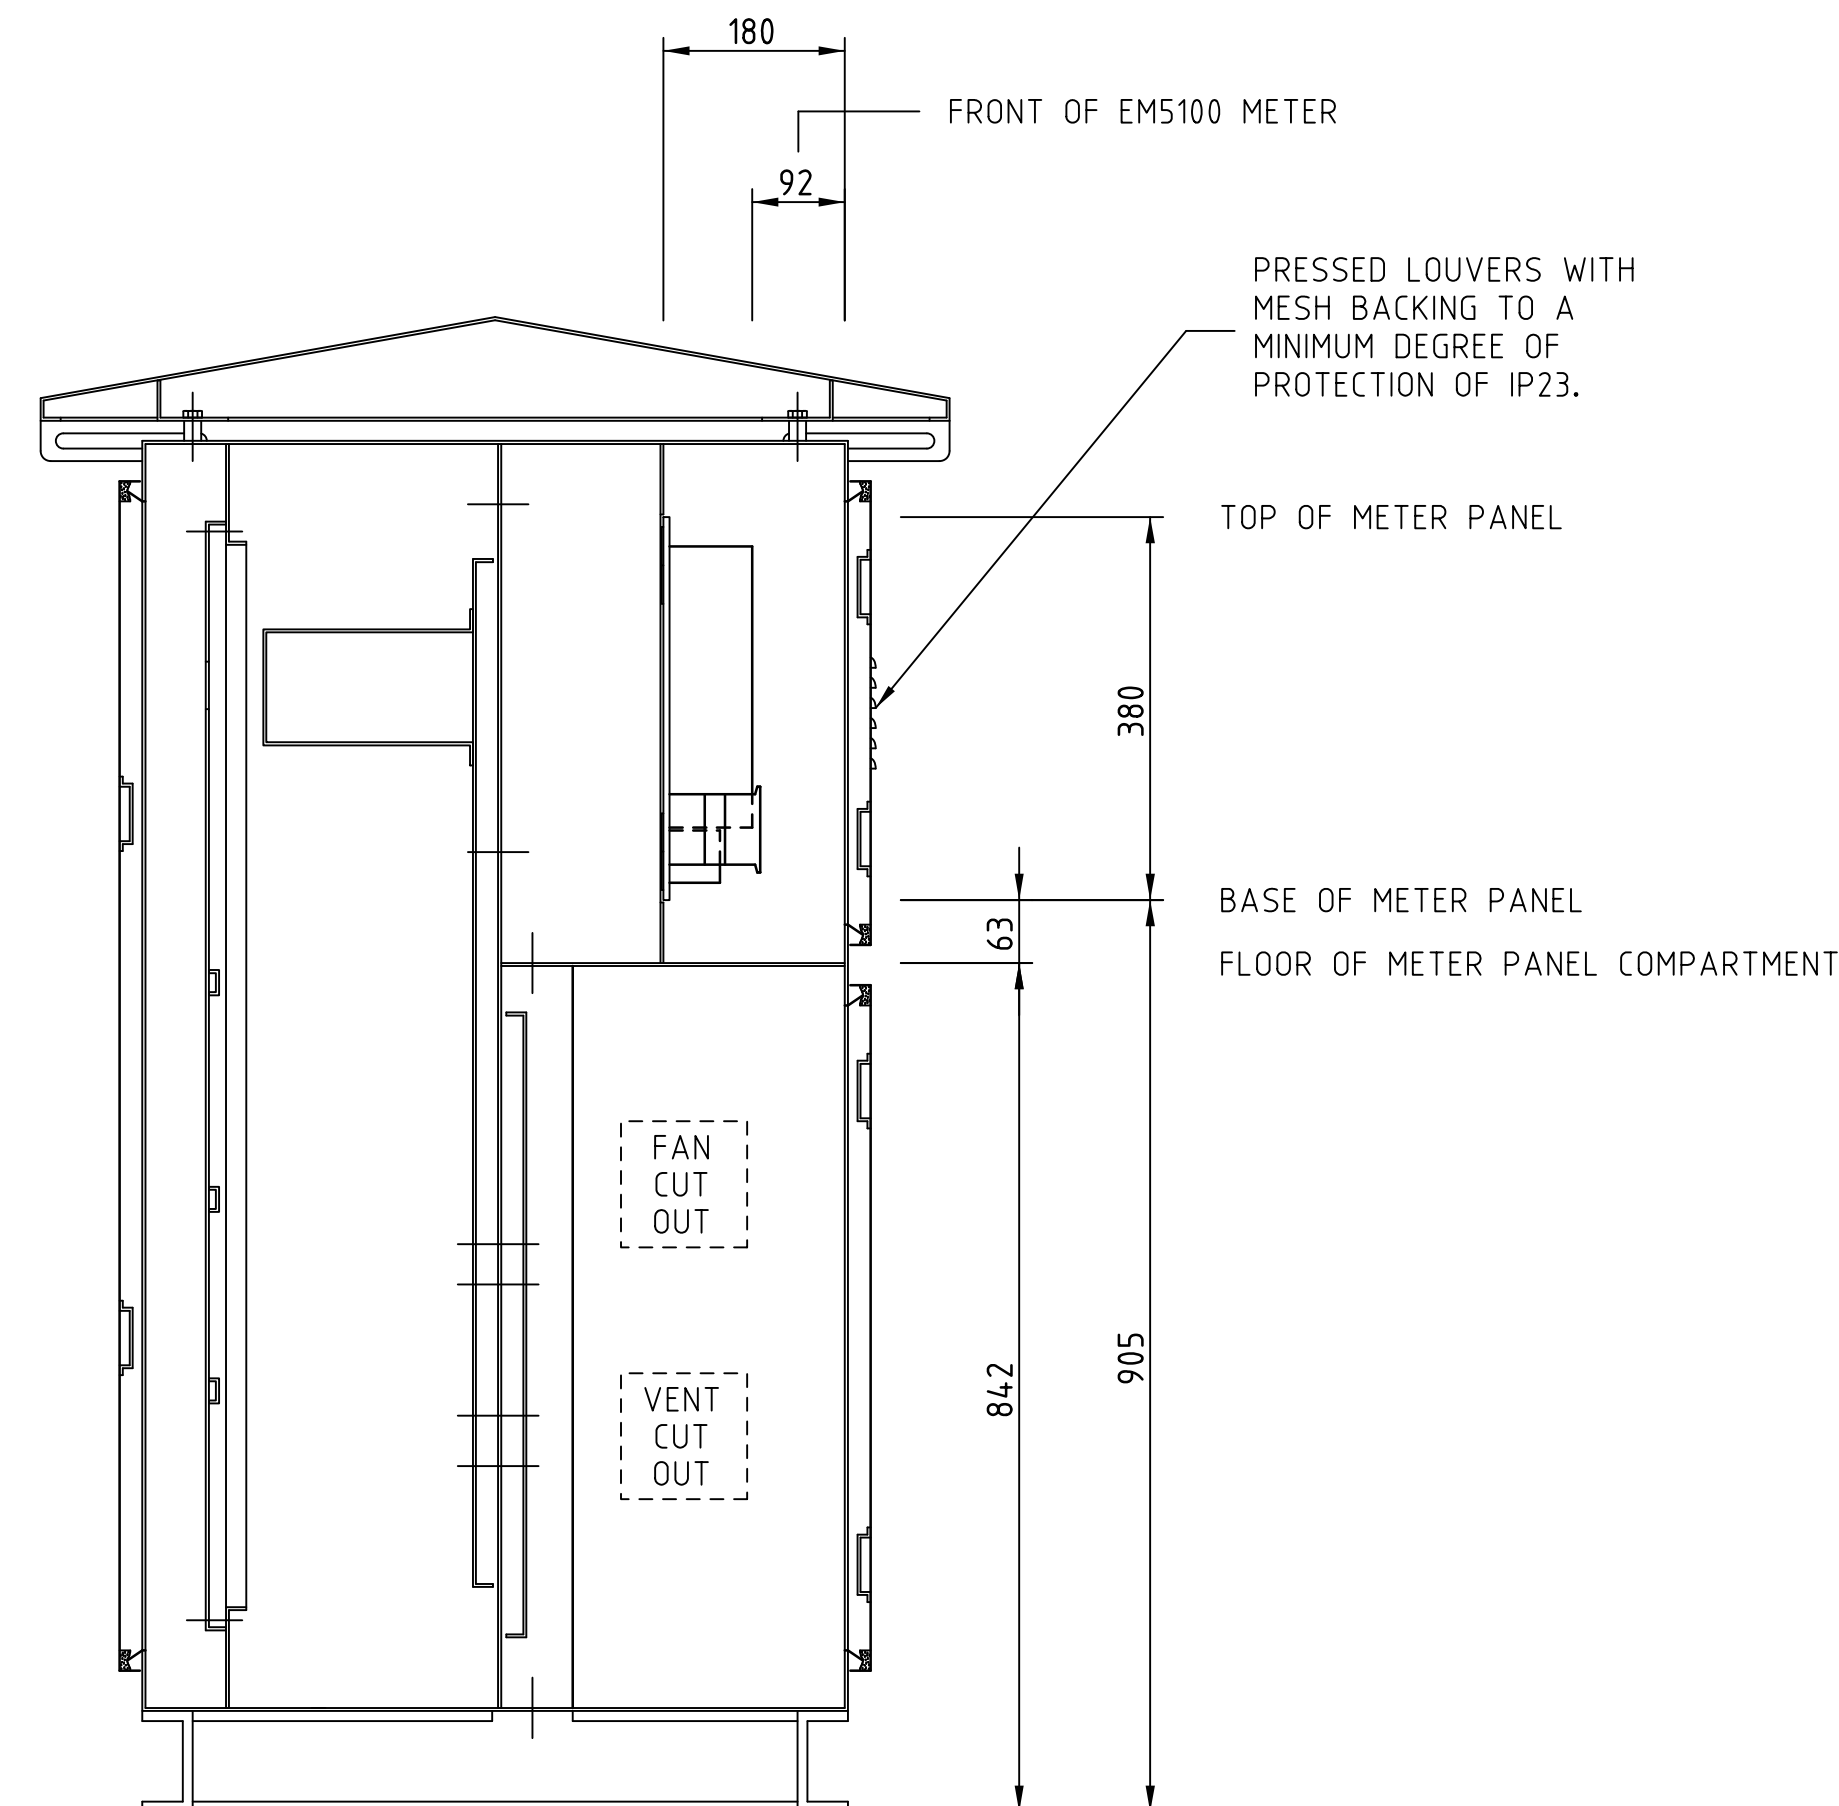
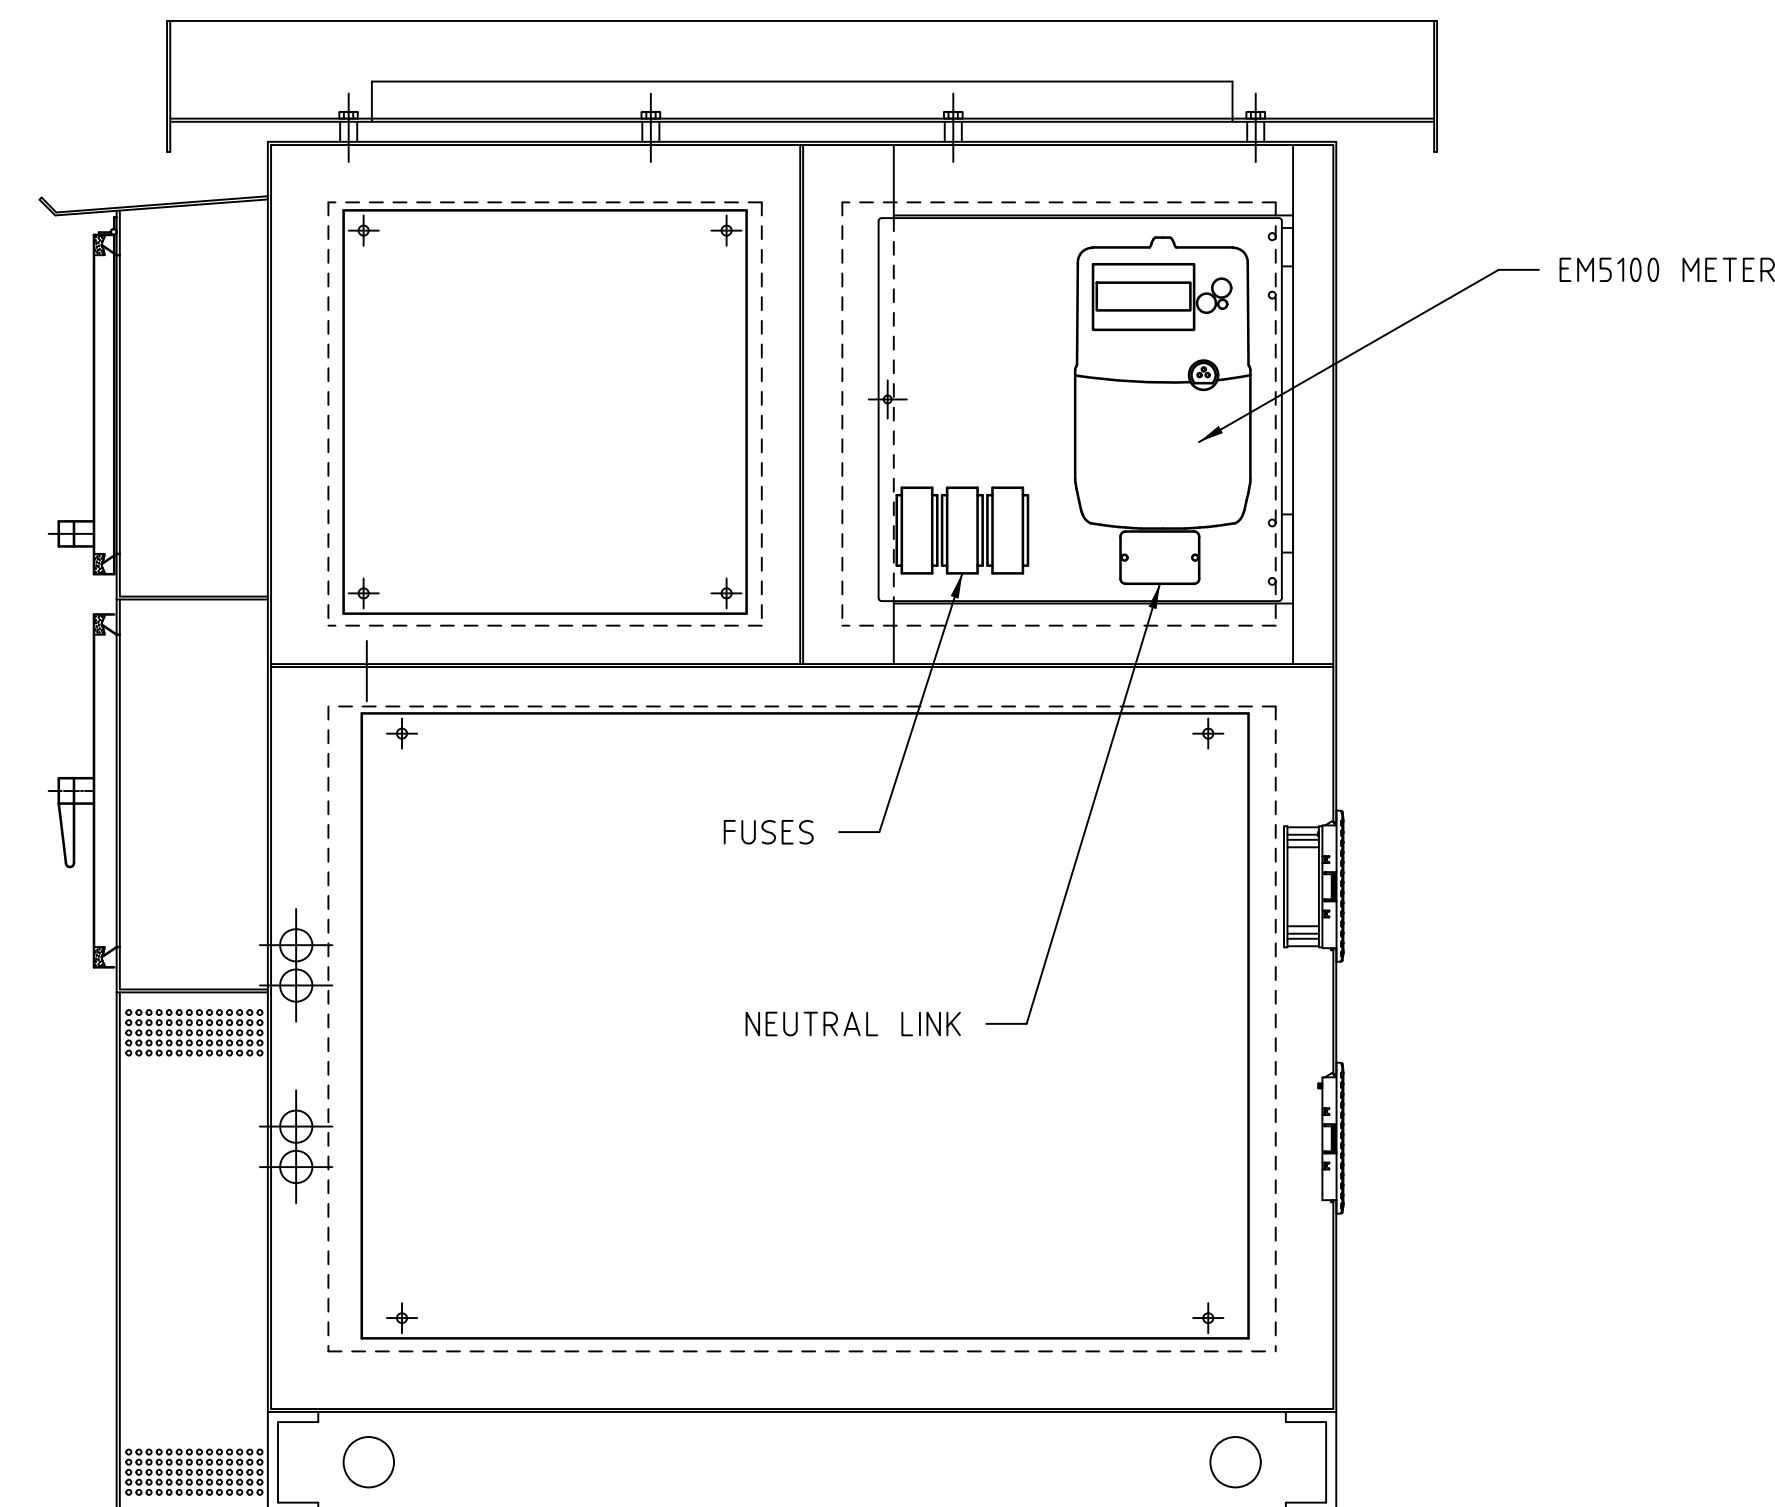


METERING COMPARTMENT DETAILS

SECTIONS SHOWN WITH METERING DOOR AND HINGE ASSEMBLY REMOVED.
CUBICLE IP RATING: IP55
VENTILATION REQUIREMENTS FOR METERING COMPARTMENT:
PRESSED LOUVERS WITH MESH BACKING TO A MINIMUM DEGREE OF PROTECTION OF IP23.

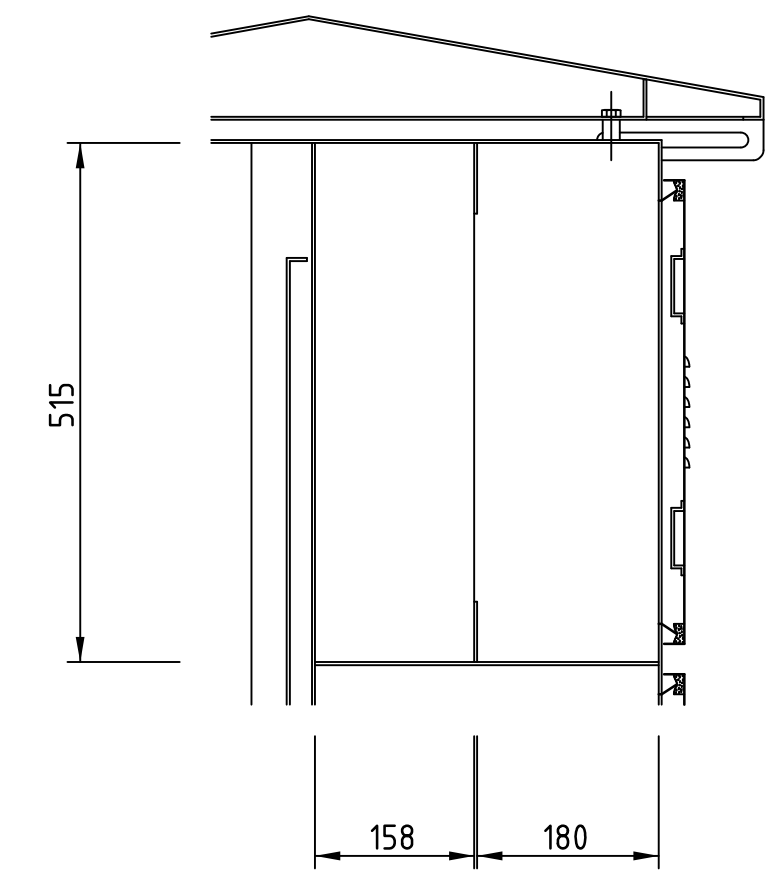

NOT TO SCALE

No.	DATE	DESCRIPTION	APP'D	REFERENCES	PLAN No.	TITLE
2	19/8/15	ADDED NEW GW SHT - APPROVED STANDARD DRG.	M.S.			
1	21/5/15	ADDED HANDLE TO GENERATOR CONNECTION BOX.	M.S.			
0	27/3/15	INITIAL ISSUE.	M.S.			
				A1-58850		STANDARD SPS - PUMP STATION 7.5kW TO 22kW (SOFT STARTER) - I & C - DRAWING INDEX

DESIGNED BY:

OPTIMUM
DRAFTING PTY LTD
A.B.N. 28 065 272 942

DO NOT SCALE	GIPPSLAND WATER DRAWING STATUS	STANDARD DRAWING	GIPPSLAND WATER FACILITY CODE XXCPXX
CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS. DESIGNED: 25/03/2015 - M SENANAYAKE DRAWN: 27/03/2015 - OPT/MM CHECKED: 01/04/2015 - M SENANAYAKE		GIPPSLAND WATER STANDARD SEWERAGE PUMP STATION PUMP STATION 7.5kW TO 22kW (SOFT STARTER) BACK TO BACK - PUMP STATION CUBICLE METERING COMPARTMENT DETAILS	
		DRAWING No.	REV.
		A1-58870	2