








SECTION "B-B"

"A" GENERAL ARRANGEMENT

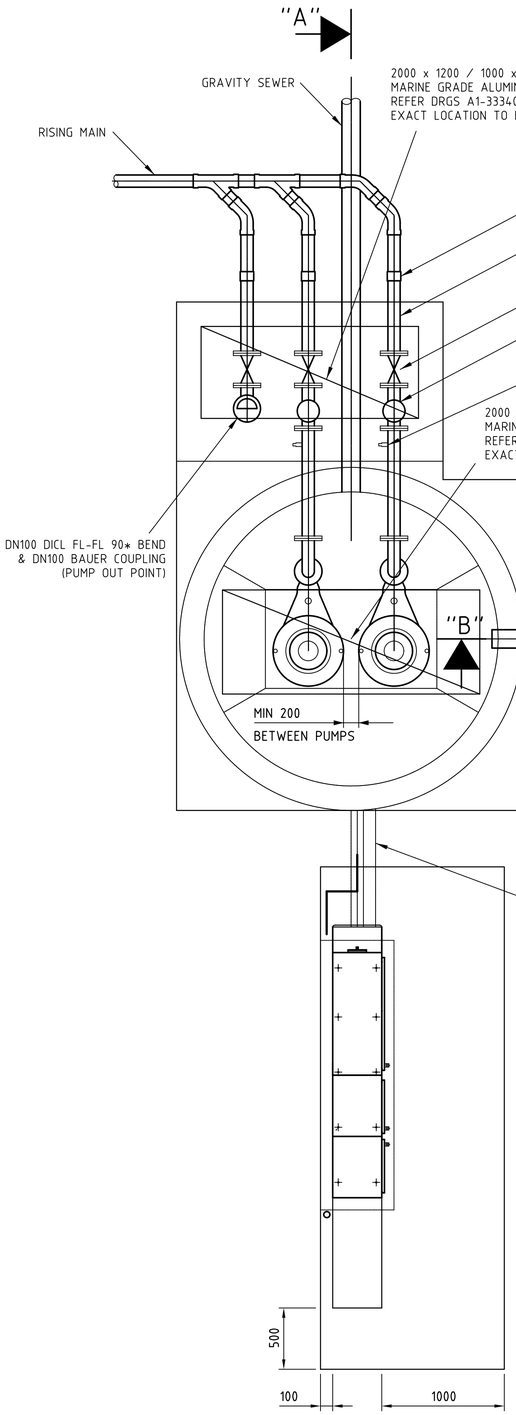

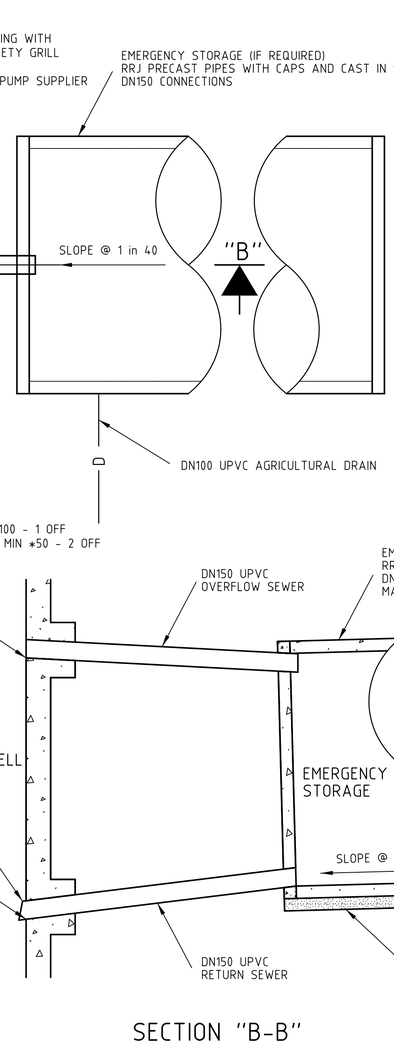
DETAIL A

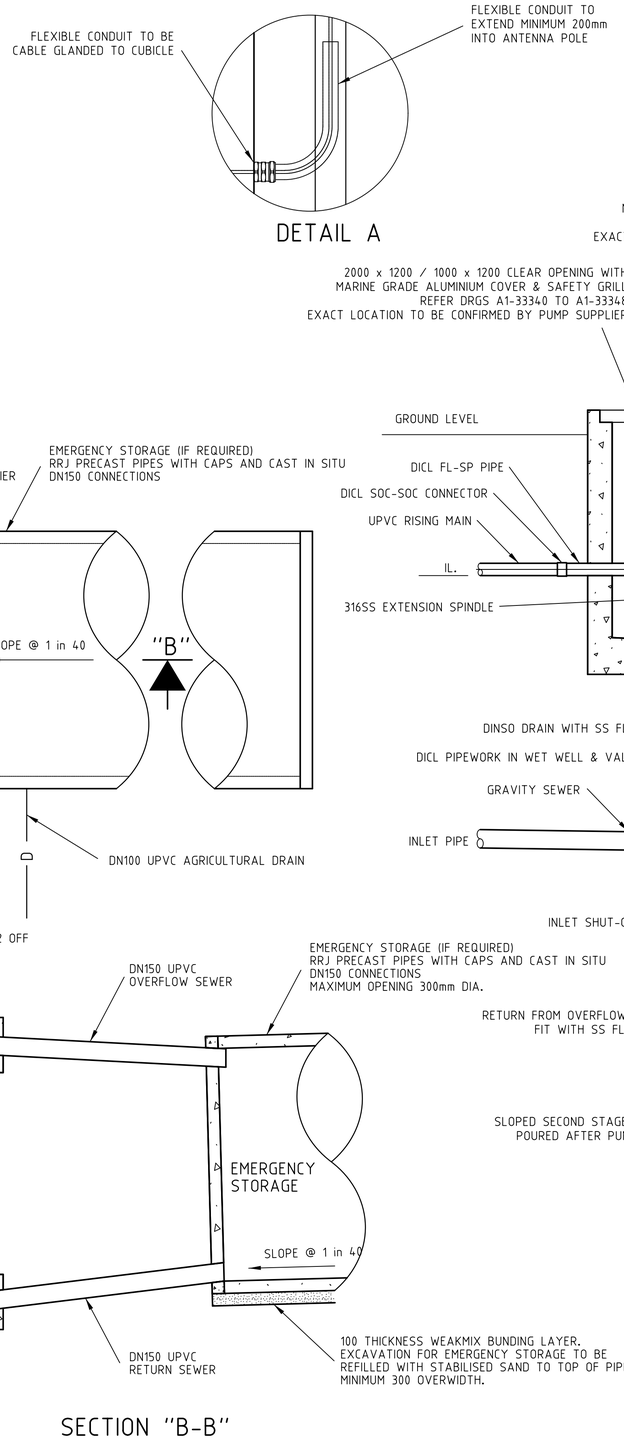


SECTION "A-A"

(1) MJK ULTRASONIC

(2)(3)(4) FLOAT SWITCHES x 3




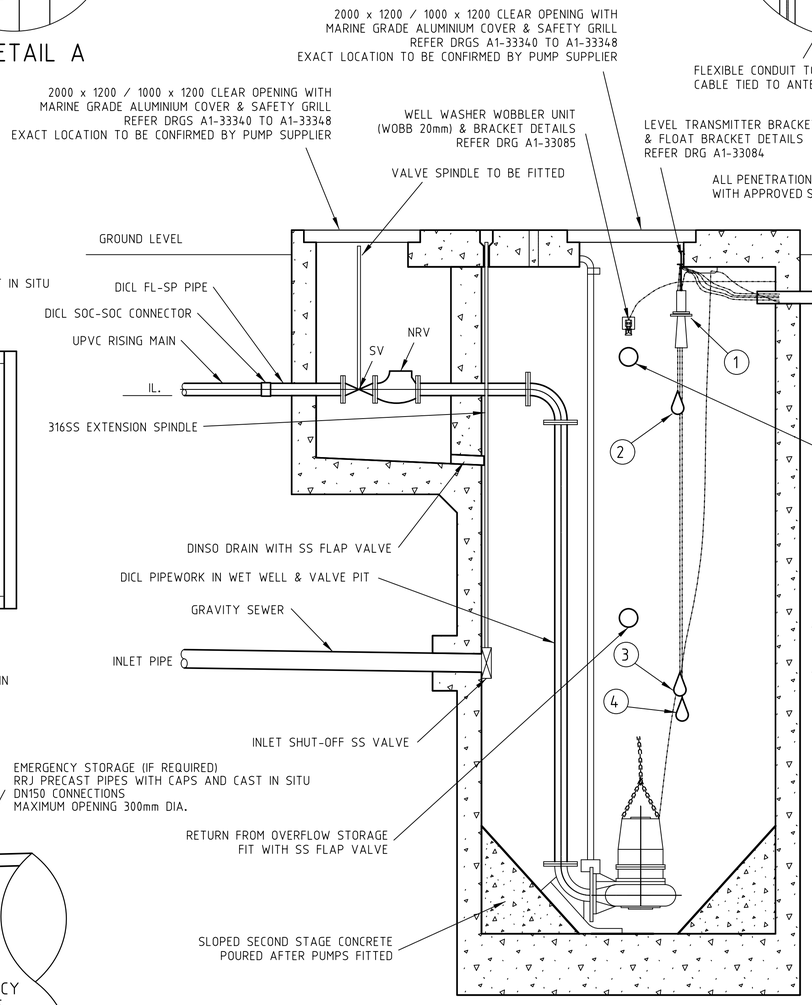


## NOTES FOR LOCATION OF PUMP CONTROL CUBICLE

1. DOORS TO HINGE AWAY FROM WELL.
2. CUBICLE TO BE LOCATED TO ALLOW ACCESS TO CONTROLS SAFELY WHEN WELL COVERS ARE OPEN.
3. WELL COVERS TO BE HINGED SO COVERS CAN BE OPENED FULLY WITHOUT COMING INTO CONTACT ELECTRICAL CUBICLE.

REVISIONS
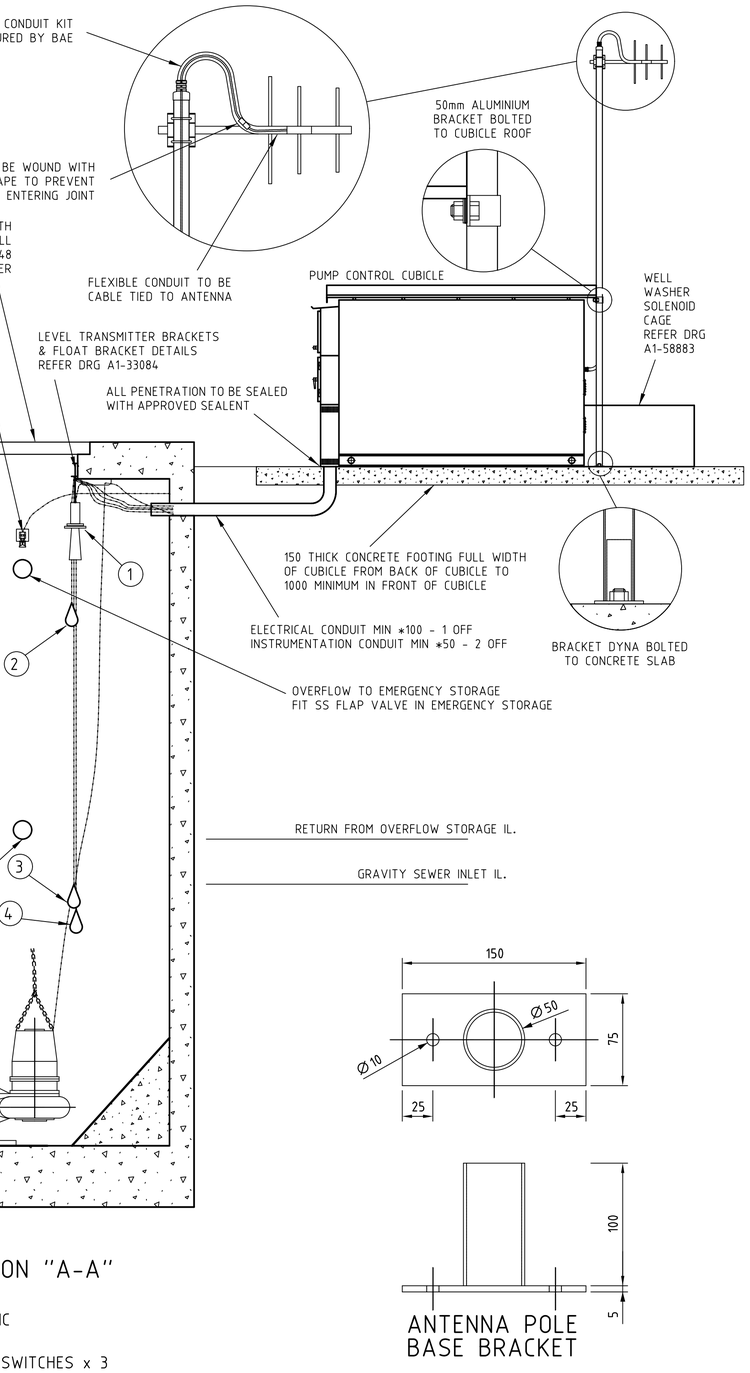
| No. | DATE | DESCRIPTION | APP'D |
|---|---|---|---|
| 2 | 20/8/15 | ADDED NEW GW SHT - APPROVED STANDARD DRG. | M.S. |
| 1 | 21/5/15 | ADDED HANDLE TO GENERATOR CONNECTION BOX. | M.S. |
| 0 | 27/3/15 | INITIAL ISSUE. | M.S. |

REFERENCES

| PLAN No. | TITLE |
|---|---|
| A1-58850 | STANDARD SPS - PUMP STATION 7.5kW TO 22kW (SOFT STARTER) - I & C - DRAWING INDEX |

DESIGNED BY:

OPTIMUM DRAFTING PTY LTD
A.B.N. 28 065 272 942

DO NOT SCALE

CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.
DESIGNED: 25/03/2015 - M SENANAYAKE
DRAWN: 27/03/2015 - OPT/MM
CHECKED: 01/04/2015 - M SENANAYAKE

GIPPSLAND WATER DRAWING STATUS: STANDARD DRAWING

GIPPSLAND WATER FACILITY CODE: XXCPXX

GIPPSLAND WATER

DRAWING No. A1-58885 REV. 2

STANDARD SEWERAGE PUMP STATION
PUMP STATION 7.5kW TO 22kW (SOFT STARTER)
SIDE BY SIDE - PUMP WELL
DETAILS