


(OPTION No 1)
VEGAMET 391 LEVEL
TRANSMITTER

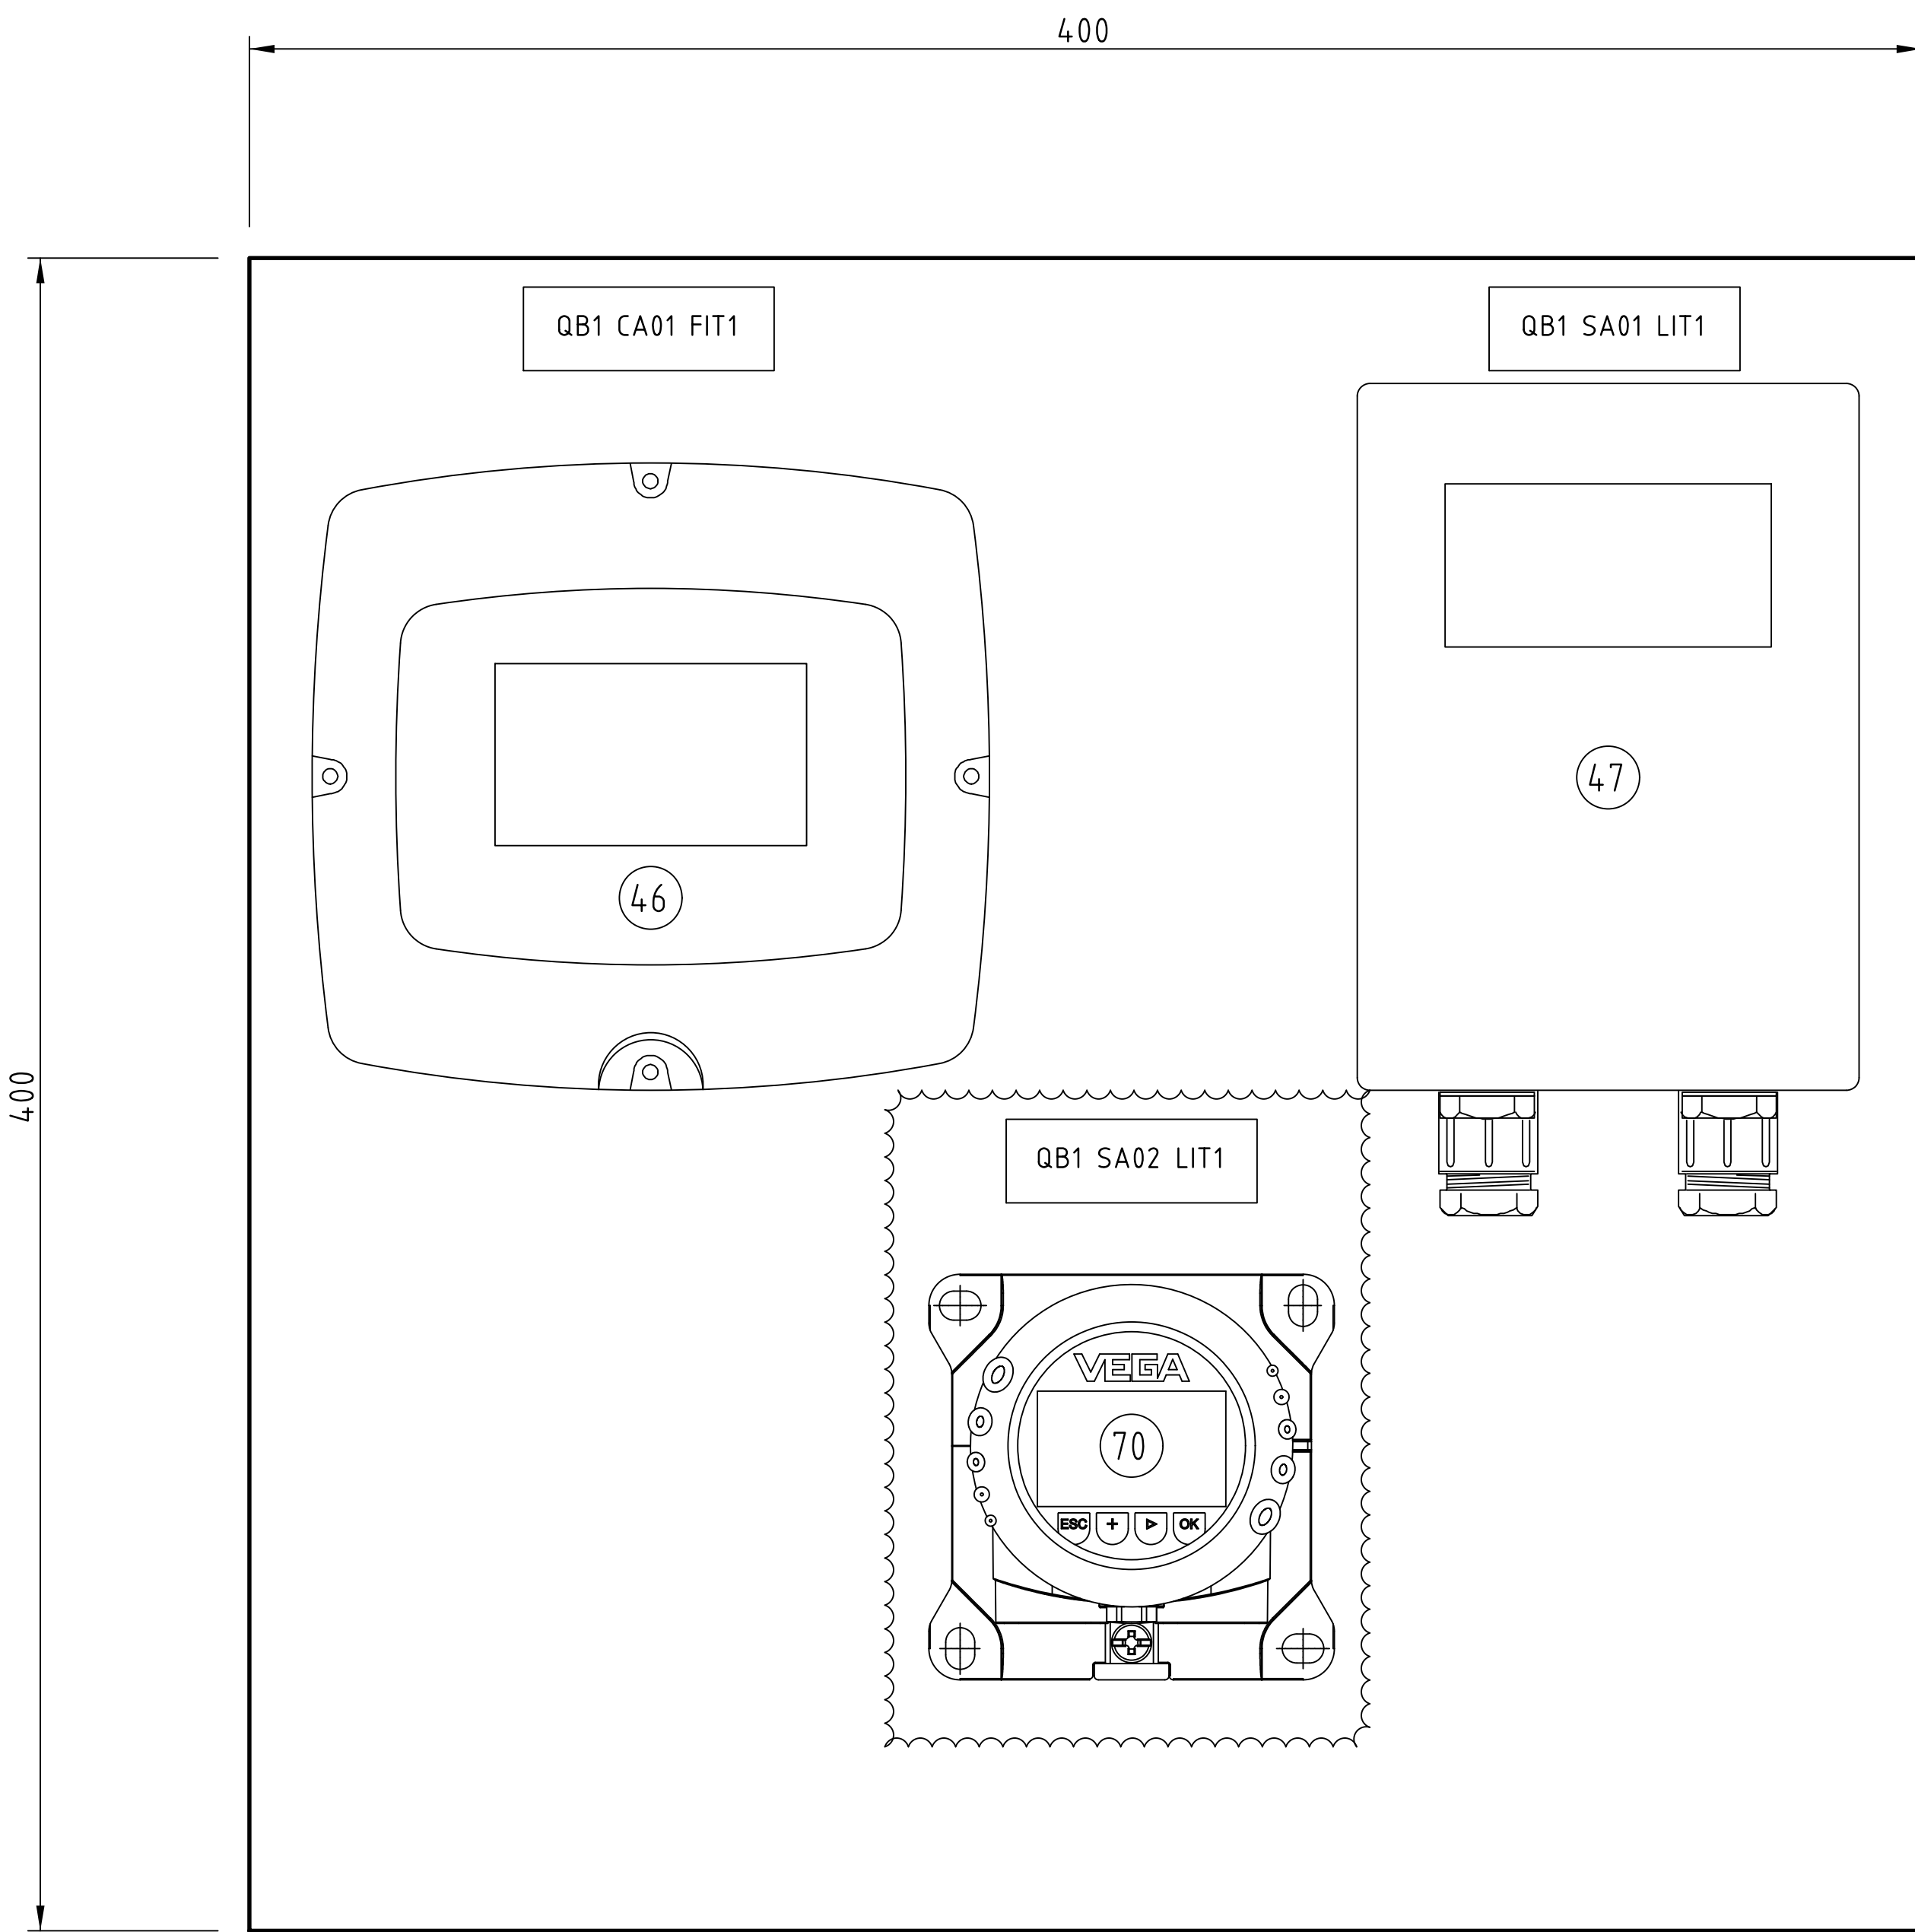

(OPTION No 2)
MJK SHUTTLE LEVEL
TRANSMITTER

NOTE:
VEGA RADAR LEVEL TRANSMITTER TO BE USED WHERE
THE WET WELL IS GREATER THAN 8m DEEP, OR THE
WET WELL IS LESS THAN 2m DIAMETER, OR THE
PUMPS ARE 22kW OR LARGER.

REVISONS	No.	DATE	DESCRIPTION	APP'D	REFERENCES	PLAN No.	TITLE
	11	10/11/20	REVISED OPTION ORDER AND ADDED QB1 SA02 LIT1.	P.S.			
	10	16/11/17	CORRECTED DRAWING TITLE ADDED NOTE.	G.F.			
	9	12/7/17	REDRAWN IN DGN & REVISED ASSET LABELS.	P.S.		A1-47731	STANDARD SPS PUMP STATION UP TO 5.5kW (DOL) - I & C - DRAWING INDEX

DESIGNED BY:




OPTIMUM
DRAFTING PTY LTD
A.B.N. 28 065 272 942

DO NOT SCALE

CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS.
DESIGNED: 12/07/2017 - STD DRG
DRAWN: 12/07/2017 - OPT/RJ
CHECKED: 19/07/2017 - P STEWART

GIPPSLAND WATER
DRAWING STATUS
STANDARD DRAWING



STANDARD SEWERAGE PUMP STATION
PUMP STATION UP TO 5.5kW (DOL)
INSTRUMENT PANEL COMPARTMENT (PF1EC01)
GEAR TRAY LAYOUT

GIPPSLAND WATER FACILITY CODE
XXCPXX

DRAWING No.
A1-47754

REV.
11