
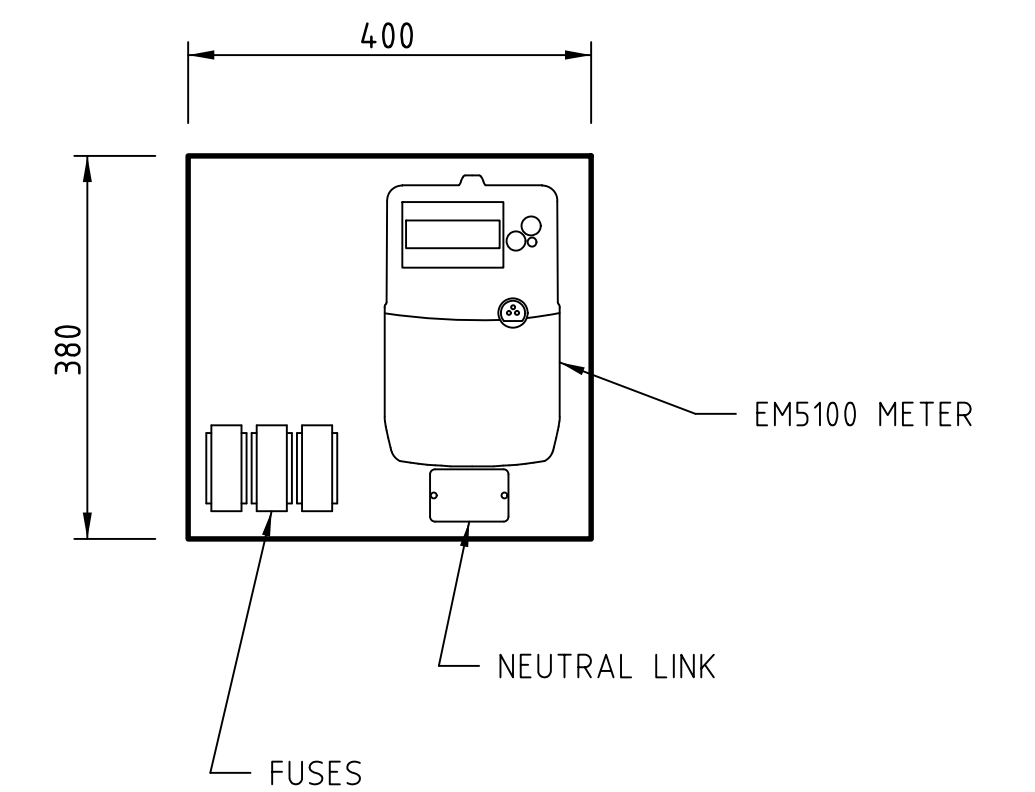
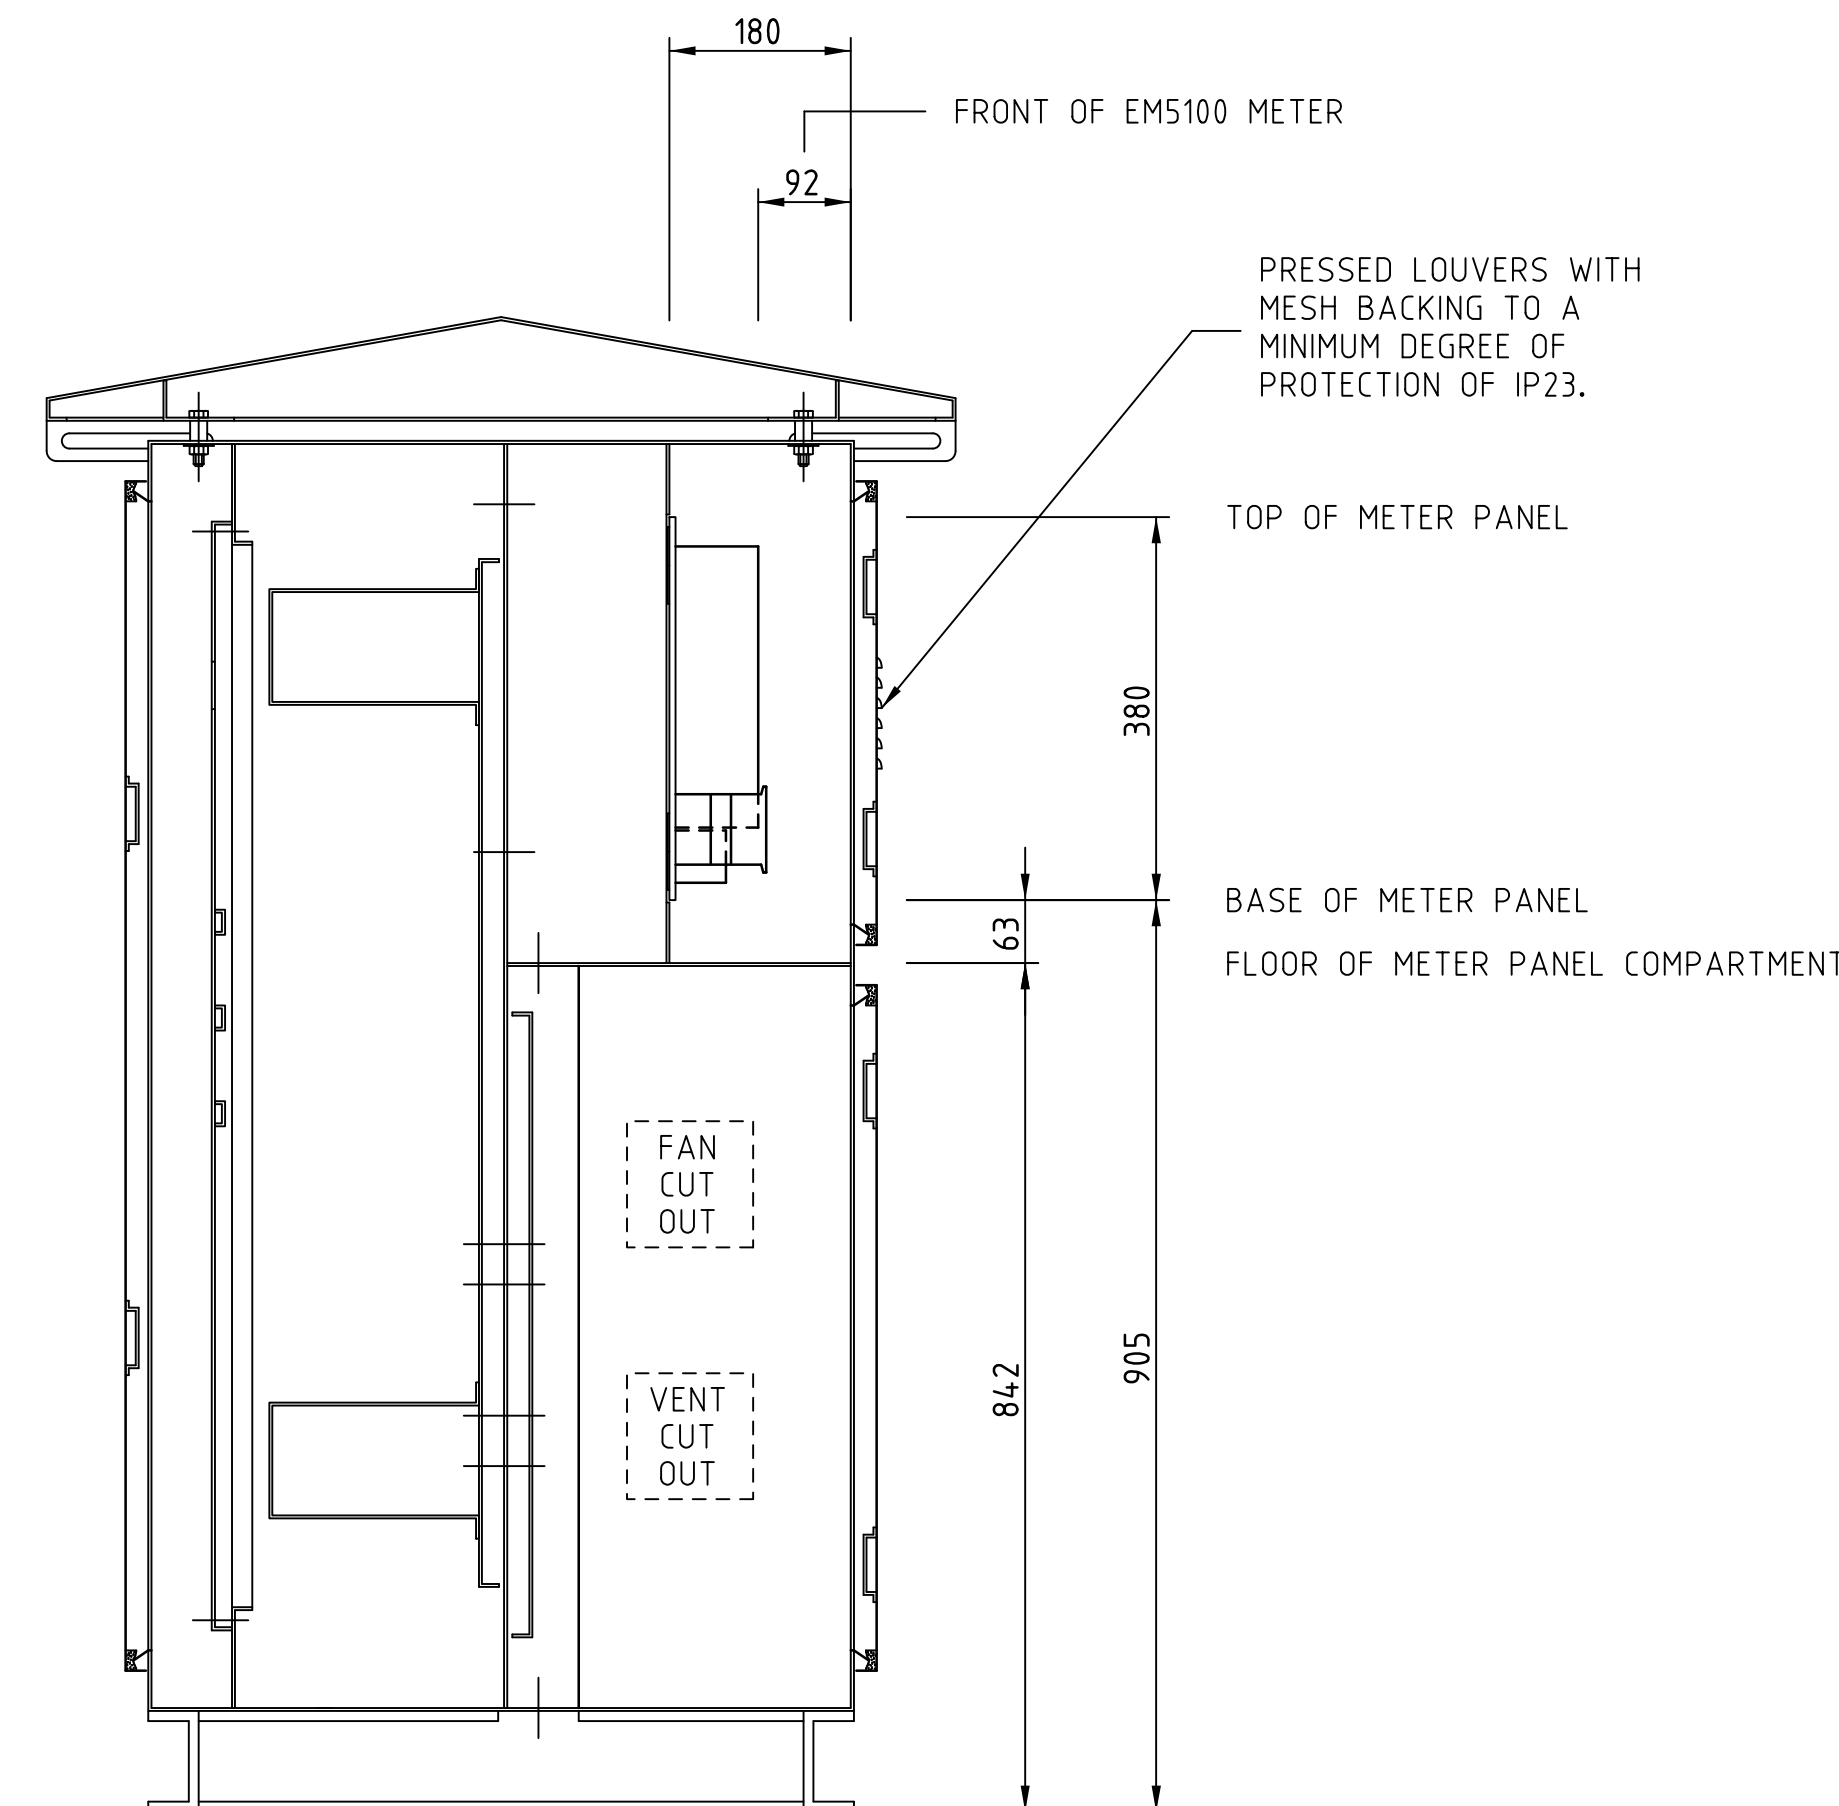
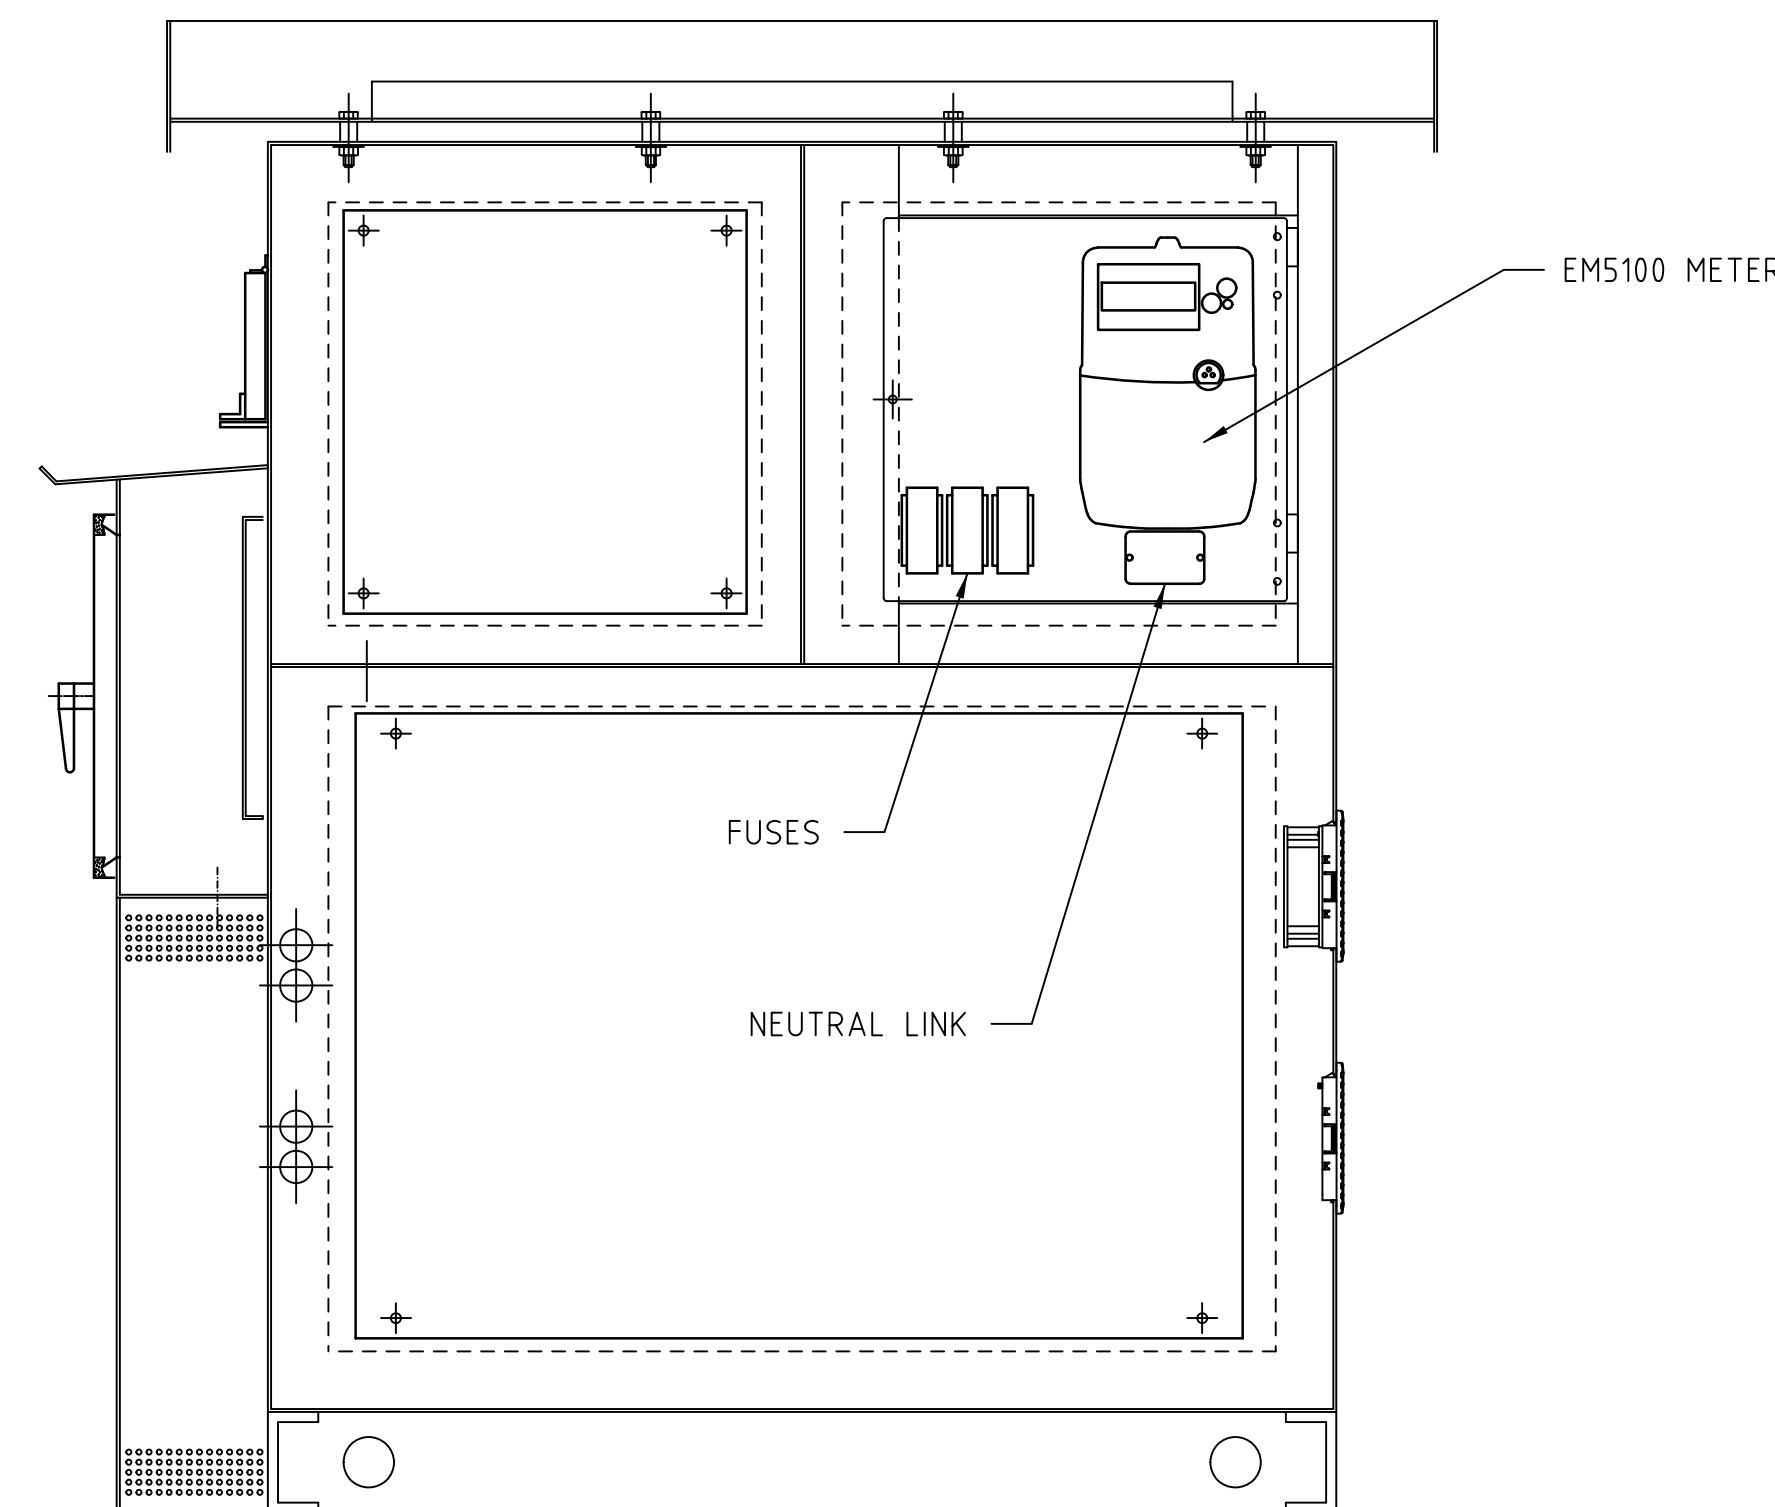


METERING COMPARTMENT DETAILS

SECTIONS SHOWN WITH METERING DOOR AND HINGE ASSEMBLY REMOVED.
 CUBICLE IP RATING: IP55
 VENTILATION REQUIREMENTS FOR METERING COMPARTMENT:
 PRESSED LOUVERS WITH MESH BACKING TO A MINIMUM DEGREE OF PROTECTION OF IP23.

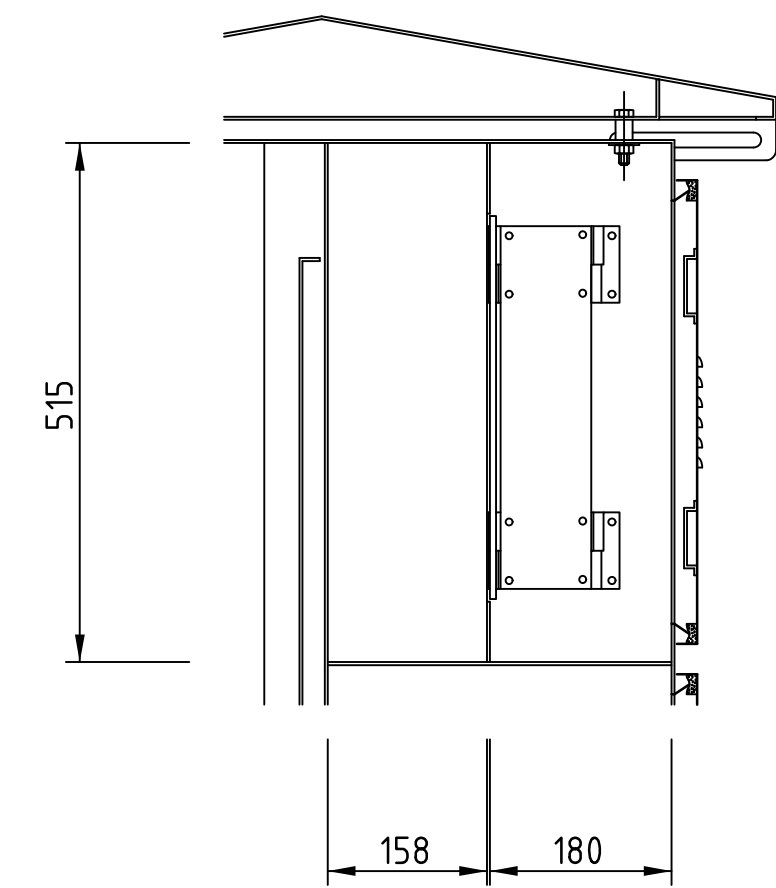

No.	DATE	DESCRIPTION	APP'D	PLAN No.	TITLE
8	10/11/20	REVISED METERING COMPARTMENT INTERNAL DIMENSIONS.	P.S.		
7	16/11/17	ADDED TOP HAT FOR 24VAC/DC CIRCUIT BREAKERS.	G.F.		
6	12/7/17	REDRAWN IN DGN & GENERAL REVISIONS.	P.S.		

DESIGNED BY:

OPTIMUM
DRAFTING PTY LTD
A.B.N. 28 065 272 942

DO NOT SCALE	GIPPSLAND WATER DRAWING STATUS	STANDARD DRAWING	GIPPSLAND WATER FACILITY CODE XXCPXX
CERTIFICATION OF COMPLIANCE WITH GIPPSLAND WATER'S DESIGN & DRAFTING REQUIREMENTS. DESIGNED: 12/07/2017 - GW STD DRG DRAWN: 12/07/2017 - OPT/RJ CHECKED: 19/07/2017 - P STEWART		GIPPSLAND WATER STANDARD SEWERAGE PUMP STATION PUMP STATION UP TO 5.5kW (DOL) BACK TO BACK CUBICLE METERING COMPARTMENT DETAILS	
		DRAWING No. A1-49215	REV. 8